



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण
(सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार)
National Highways Authority of India
(Ministry of Road Transport and Highways, Government of India)
क्षेत्रीय कार्यालय, मदुरै / Regional Office, Madurai
दूसरा व तीसरा तल, विजय कृष्णा प्लाजा, सं. 1, लेक एरिया, मेलुर मैन रोड, माटुतावनी, मदुरै - 625107
2nd & 3rd Floor, Vijay Krishna Plaza, No. 1, Lake Area, Melur Main Road, Mattuthavani, Madurai - 625107
दूरभाष / Tele : +91-452-2588999 वेब / Website : www.nhai.gov.in ई.मेल / E-mail: romadurai@nhai.org



NHAI/15018/3.3/01/2025/RO Madurai/E:273541/ 240

11th February, 2025

INVITATION OF PUBLIC COMMENTS

विषय: भाराराप्रा - क्षे.का. मदुरै- पकाई, कराईकुडी - Requesting permission towards the erection of 22 KV Overhead Electrical Power Transmission Line crossing (across) at Km 43/400 in Trichy - Pudukkottai section of NH-336 (Old NH-210) in the state of TamilNadu - Invitation of Public Comments - Reg.

प्रसंग: PD, Karaikudi Lr. No. 11035/31/2025-PIU KKDI/E-273541/96 dated 30.01.2025.

The Proposal is regarding permission for erection of 22 KV Overhead Electrical Power Transmission Line crossing (across) at Km 43/400 in Trichy - Pudukkottai section of NH-336 (Old NH-210) in the State of Tamil Nadu by M/s. Gautam Power Generation Pvt. Ltd., Pudukkottai has been submitted to this office by the PD, Karaikudi Lr. No. 11035/31/2025-PIU KKDI/E-273541/96 dated 30.01.2025 in accordance with Ministry's latest guidelines dated 22.11.2016.

2) The alignment proposed by M/s. Gautam Power Generation Pvt. Ltd., Pudukkottai for erection of 22 KV Overhead Electrical Power Transmission Line crossing (across) at Km 43/400 in Trichy - Pudukkottai section of NH-336 (Old NH-210) is as detailed under:

| Stretch in Km | Length (m) | Available ROW (m) | Distance of erection from C/L (m) | | Remarks |
|-----------------------------|------------|-------------------|-----------------------------------|-----|--|
| | | | LHS | RHS | |
| Across NH-336: Km 43/400 | 30 | 30 | - | - | Over Headline with minimum vertical clearance of 12.5 m using M+6 tower. |

3) The Right of Way is 30 m in the aforesaid stretch. M/s. Gautam Power Generation Pvt. Ltd., Pudukkottai has proposed for erection of 22 KV Overhead Electrical Power Transmission Line crossing (across) at Km 43/400 in Trichy -

NHAI/15018/3.3/01/2025/RO Madurai/E:273541/ 240

11th February, 2025

Pudukkottai Section of NH-336 (Old NH-210) in the State of Tamil Nadu which is in conformity with Ministry's guidelines dated 22.11.2016.

4) M/s. Gautam Power Generation Pvt. Ltd., Pudukkottai has furnished an Undertaking that they will not cause damage to any other Utility and if any damage, they have to pay the loss to NHAI or concerned agency. Further, mentioned that M/s. Gautam Power Generation Pvt. Ltd., Pudukkottai will shift the Overhead line EB lines/Poles when requested by the NHAI at their own cost.

5) As per the guidelines issued by the Ministry vide letter No.RW/NH-33044/29/2015/ S&R(R) dated 22.11.2016 the proposal submitted by the applicant will be made available for public comments and the comments is invited within 30 days from the day of uploading.

In view of the above, comments of the public on the above proposal is invited to the below mentioned address:

Regional Officer,
National Highways Authority of India,
No.2nd & 3rd Floor, Vijay Krishna Plaza,
No.1, Lake Area, Melur Main Road, Mattuthavani,
Madurai - 625 007.

भवदीय

AJITHKUMAR SENGODAN
Digitally signed by
AJITHKUMAR SENGODAN
Date: 2025.02.11 11:32:55
+05'30'

(एस .अजित कुमार | S.Ajith Kumar)
प्रबंधक (तक) | Manager (Tech)
क्षे.का. मदुरै | RO Madurai

संलग्न: As above

प्रतिलिपि: 1. The NIC, New Delhi - for uploading in the Ministry's website.
2. The PD, Karaikudi - for information.

| List of Correspondences | | | | | | | |
|------------------------------|---|---------|-----------|------------------------|-----------|-------|---------|
| Receipt No. / Issue No. | Subject | Type | Marked As | Attached On | Issued On | Pages | Remarks |
| 1181050/2025/PIU - Karaikudi | Supervision Consultant Letter | Receipt | | 01/02/2025 12:15 PM | | 68-69 | - |
| 1181040/2025/PIU - Karaikudi | Proposal submitted – Approval – Requested | Receipt | | 01/02/2025 12:09 PM | | 1-67 | - |



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण (सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार) National Highways Authority of India

(Ministry of Road Transport & Highways, Government of India)

उप महाप्रबंधक (तकनीकी) सह परियोजना निदेशक के कार्यालय
परियोजना कार्यान्वयन इकाई - कारैकुडी

Office of the Deputy General Manager (Tech) & Project Director
Project Implementation Unit - Karaikudi

नं.1, दूसरी मंजिल, सुब्रमण्यपुरम तीसरी स्ट्रीट, कारैकुडी - 630 002

No. 1, 2nd Floor, Subramaniapuram 3rd Street, Karaikudi - 630 002

दूर / Tele : +91- 4565 230707 ई-मेल / E-mail : karaikudipiu@gmail.com, karaikudi@nhai.org



11035/31/2025- PIU KKDI/E-273541/96

30th January 2025

To

The Regional Officer,
National Highways Authority of India,
Regional Office, Madurai.

Sir,

Sub: NHAI - PIU, Karaikudi - Requesting permission towards the Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu - Proposal submitted - Approval - Requested - Reg.

Ref: 1. The Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai, Lr. No. Nil, dated 08.01.2025 (Received on 10.01.2025) (Application No: 20250109/1/4/35166/14161).
2. Resident Engineer, M/s. L.N. Malviya Infra Projects Pvt. Ltd., Karaikudi Lr.No. LNMIPPL/PO/PD/NHAI/T-K/2024-25/30, dt:18.01.2025.

It is to submit that the Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai vide reference 1st cited has submitted the proposal seeking permission for the erection of a 22KV Electrical Over Head Transmission line across @ Km.43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210).

2. The same has been forwarded to the Supervision Consultant for offering their comments. The Resident Engineer, M/s. L.N. Malviya Projects Pvt. Ltd., Karaikudi vide reference 2nd cited has informed that the site has been inspected and verified the proposal and found to be in order.

3. On scrutiny of the proposal, the following details are submitted:

- The Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai has proposed the erection of 33KV Electrical Over Head Transmission line across @ Km.43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) for a total length of 30.00m.
- The said proposal has been submitted in NOC portal and its application No. 20250109/1/4/35166/14161.
- The width of the Existing ROW is 30 m.
- The strip plan showing the details of the proposed erection of a 22KV Electrical overhead transmission line with poles and the necessary checklist are furnished along with the proposal.

National Highways Authority of India

- e) The Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai has given an undertaking that they will relocate electrical lines/utilities at their cost notwithstanding the permission granted within such time as stipulated by NHAI for future 4 laning or any other development.
 - f) The Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai has given an undertaking on non-judicial stamp paper, that they will pay the fee/rent as mentioned in the MoRT&H Guidelines / Circular No.RW/NH-33044/29/ 2015/S&R (R) dated 22.11.2016 as and when asked by NHAI.
 - g) The track rent and restoration charges to be collected from the agency are calculated as per the MoRT&H Guidelines / Circular No.RW/NH-33044/29/ 2015/S&R (R) dated 22.11.2016.
 - h) The cost of restoration charges for the erection of a 22KV Electrical Over Head Transmission line with poles is worked out as **Rs.1,00,000/- (Rupees One Lakh only)** for which the applicant is required to furnish the BG having validity up to one (1) year as per the Annexure-I.
 - i) The track rent to be collected for the erection of a 22KV Electrical Over Head Transmission line across the road is for five years as **Rs.1,98,877/- (Rupees One Lakh Ninety-Eight Thousand Eight Hundred and Seventy-Seven Only)** for which the applicant is required to be remitted in Bharatkosh Portal valid for up to Five (5) years period as per the Annexure-II.
 - j) The statement showing the list of utility services already approved by the Competent Authority is enclosed as Annexure-III.
 - k) Certificate by the undersigned is enclosed as Annexure-IV.
 - l) The site will be restored to the original condition by the applicant.
4. In view of the above, it is requested that the necessary permission may please be granted to the Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai for the erection of a 22KV Electrical Over Head Transmission line across @ Km.43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu at an early date.

Encl: 1 No. of Original Proposal with references.

Yours faithfully,



(B. Arun Prasad),
DGM(T) & Project Director,
PIU, Karaikudi.

National Highways Authority of India

ANNEXURE-I

Performance security against the restoration work for the erection of a 22KV Electrical Over Head Transmission line across @ Km.43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

| Sl. No. | Description | Length in mtrs. | |
|-------------|--|-----------------|-------------------|
| A. | erection of a 22KV Electrical Over Head Transmission lines across the road in one location | | |
| | Km.43/400 | = | 1 |
| | Cost of Restoration Charges @ Rs.1,00,000/- per Crossing (1 x 100000) | = | 100000 |
| Grant Total | | | 100000 |
| | | | Say Rs.1.00 Lakhs |


B. ARUN PRASAD
 DGM(T) & Project Director
 National Highways Authority of India
 PIU - KARAİKUDI

LICENSE FEES FOR PPRIVATE UTILITY
Utilized NH Land area X Prevailing Circle Rate of Land per Unit area X 10% per annum

ANNEXURE-II

| SL. NO | NAME OF VILLAGE | CHAINAGE IN KM | | SIDE | LENGTH (L) (in mt) | DIA OF THE PIPE (D) (m) | UTILIZED NH LAND AREA (D x L) (sq.m) | PREVAILING CRICLE RATE OF LAND PER UNIT AREA (sq.m) (Rs) | LICENSE FEE (PRIVATE UTILITY) (Rs) |
|--------|-----------------|------------------------------|----|----------|-----------------------|-------------------------------|--|--|---|
| | | FROM | TO | | | | | | |
| 1 | | 43/400 | | crossing | 30 | 2.4 | 72.00 | 4900 | 35280 |
| TOTAL | | | | | 30 | | 72.00 | | 35280 |
| | | Add: 6% per annum for 2 year | | | | | | | 37397 |
| | | Add: 6% per annum for 3 year | | | | | | | 39641 |
| | | Add: 6% per annum for 4 year | | | | | | | 42019 |
| | | Add: 6% per annum for 5 year | | | | | | | 44540 |
| | | Lic. Fee for 5 years | | | | | | | 198877 |

| | |
|------------------------------|-------|
| Minimum License Fee | 10000 |
| Add: 6% per annum for 2 year | 600.0 |
| Add: 6% per annum for 3 year | 636.0 |
| Add: 6% per annum for 4 year | 674.2 |
| Add: 6% per annum for 5 year | 714.6 |

| | |
|---|-------|
| Minimum License Fee for Private Utility for 5 years | 56371 |
|---|-------|


B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAIKUDI

[Enclosure to Ministry Circular No.RW/NH-33044/17/2000-S&R dated 29.09.2000 and dated 23.07.2009]

Format for Maintaining Records of Right-of-Way permission granted for laying OFC Line

(to be maintained separately for every NH and State)


1. Name of State : TAMIL NADU
 2. Name of Agency : NATIONAL HIGHWAYS AUTHORITY OF INDIA, PIU, KARAIKUDI
 3. NH Number : TRICHY - KARAIKUDI SECTION OF NH 210 (NEW NH 336, 36 & 536)

| Sr. No. | Location (chainage in km) | Left or Right side of NH (towards increasing chainage / km direction) | Section and reach | Kind of Service | Name of License and contact address | Date of signing agreement | Date of validity of agreement | Date of last inspection of site | Any deviation from MoRT&H Standard norms | Remarks |
|---------|--|---|--|-----------------|---|---------------------------|-------------------------------|---------------------------------|--|---------|
| 1 | Km.10/000 to Km.24/200; Km.28/200 to Km.44/400 (RHS) & from Km.54/800 to Km.63/000 (LHS) and across at Km.24/200; Km.28/200; Km.44/400 & Km.63/000 | BHS | Trichy - Karaikudi section of NH 210 | OFC | Reliance Jio Infocomm Ltd., Chennai | 20.08.2013 | 20.08.2018 | - | - | - |
| 2 | Km.28/400 to Km.29/000; Km.29/700 to Km.31/600 & Km.33/400 to Km.34/100 (LHS) | LHS | Trichy - Karaikudi section of NH 210 | OFC | Bharathi Airtel Ltd., Chennai | 20.08.2013 | 20.08.2018 | - | - | - |
| 3 | Km.65/000 to Km.76/400 (LHS) and across at Km.65/000 & Km.76/400 | LHS | Trichy - Karaikudi section of NH 210 | OFC | DE (Telecom), BSNL, OFC, Madurai | 01.07.2014 | 30.06.2019 | - | - | - |
| 4 | Km.16/500 | Across | Trichy - Karaikudi section of NH 210 | OFC | DE (Telecom), BSNL, OFC, Tirunelveli | 14.10.2014 | 13.10.2019 | - | - | - |
| 5 | Km.28/785 | Across | Pudukkottai - Trichy section of NH 336 | UG LPG Pipeline | IOCL, Pipelines, Trichy | 10.08.2015 | 09.08.2020 | - | - | - |
| 6 | Km.71/899 to Km.91/054 (RHS) & Km.76/286 to Km.76/686 (LHS) | LHS | Trichy - Karaikudi section of NH 210 | Water Pipeline | Executive Engineer, TWAD Board, Project Division, Karaikudi | 23.03.2022 | 22.03.2027 | - | - | - |
| 7 | Km.86/800 to Km.91/054 (RHS) | RHS | Trichy - Karaikudi section of NH 210 | Water Pipeline | Executive Engineer, TWAD Board, Project Division, Karaikudi | 23.03.2022 | 22.03.2027 | - | - | - |
| 8 | Across at Km.7/510; Km.8/137; Km.10/290; Km.18/490 & Km.20/400 | Across | Trichy - Karaikudi section of NH 210 | OFC | General Manager(P-2), TANFINET, Chennai | 26.06.2023 | 25.06.2028 | - | - | - |

National Highways Authority of India

| | | | | | | | | | | |
|----|---|--------------|--|-----------------------------|---|------------|------------|--|--|--|
| 9 | Km.87/000 to Km.90/600 (RHS) | RHS | Trichy - Karaikudi section of NH 210 | OFC | Bharti Airtel Ltd., Chennai | 30.05.2024 | 29.05.2029 | | | Letter sent to M/s. Jio Digital Fibre Pvt. Ltd., reg requested to remit/furnish the License Deed, License fee and Performance Security amount on 26.06.2024. |
| 10 | Km.20/070 - 20/270 (LHS) | LHS & Across | Pudukkottai - Trichy Section of NH-336 | OFC | Jio Digital Fibre Private Ltd | | | | | |
| 11 | Km.14/400 to Km.18/500 (LHS) and across @ Km.20/350 in Trichy - Karaikudi section of NH 536 | LHS & Across | Thirumayam - Karaikudi Section of NH-536 | OFC | DE (Telecom), BSNL, OFC, Madurai | 17.12.2024 | 19.12.2029 | | | |
| 12 | Km 10+ 650 to Km 15+500 (LHS) and across @ 10+650 and Km 14+450 in Thirumayam-Karaikudi section of NH 536 | LHS & Across | Thirumayam - Karaikudi Section of NH-536 | undergro und water pipeline | Executive Engineer, TWAD Board, Project Division, Karaikudi | | | | | Letter sent to Executive Engineer, TWAD Board, requested to remit/furnish the License Deed, License fee and Performance Security amount on 08.08.2024. |

National Highways Authority of India


B. ARUN PRASAD
 DEPUTY & Project Director
 National Highways Authority of India
 PIU - KARAİKUDI

National Highways Authority of India**ANNEXURE-IV****CERTIFICATE OF THE PROJECT DIRECTOR**

NAME OF THE WORK: - Proposal for the erection of a 22KV Electrical Over Head Transmission line across @ Km.43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

It is certified that,

1. The proposal is found in order as per the Ministry Circular.
2. The proposal if implemented will not affect design stability & traffic safety.
3. The proposal if approved will be entered in the register for records of permission.
4. The proposal for crossing if implemented will not get affected due to the widening of the road in the near future. Further, the Managing Director, M/s. Gautam Power Generation Private Limited, Pudukkottai has given an undertaking that they will relocate overhead transmission lines at their own cost notwithstanding the permission granted within such time as stipulated by NHAI for future development.

B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAIKUDI

CIN No: U35105TN2023PTC161311

GSTIN: 33AAKCG5382Q1ZX

TAN No: CHEG20617C

GAUTAM POWER GENERATION PRIVATE LIMITED

No.104, Charles Nagar, Pudukkottai-622005

Tamil Nadu, INDIA

98422 97117

mmurugesan170171@gmail.com

Date: 08.01.2025**To**

The Project Director,
Project implementation Unit,
National Highways Authority of India,
No.1, Second Floor,
Subramaniapuram 3rd Street,
Karaikudi – 630 002

Sub: Requesting permission towards Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu
-Reg

Sir,

With reference to the above cited subject, we M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai establishing a 10MW Solar Power Generation project at Survey no. 36 in Nathampannai Village, Pudukkottai District.

In this connection 22 KV Overhead Electrical Power Transmission will be laid across (crossing) at Km. 43/400 from our Solar Power Plant in Pudukkottai Sipcot on RHS to Pudukkottai EB substation on LHS in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

The proposal is hereby submitted as per the MoRTH guideline dated 22.11.2016 and necessary undertaking & License deed as prescribed are attached for your kind perusal. We kindly request your good office to accord permission for the same at the earliest.

Thanking You**Yours faithfully,****Encl:** 5 Nos. of booklets (2 Original + 3 Copies)

For GAUTAM POWER GENERATION PRIVATE LIMITED

Managing Director

**PROPOSAL FOR GETTING PERMISSION TOWARDS ERECTION OF
22KV OVERHEAD ELECTRICAL POWER TRANSMISSION LINE
CROSSING AT KM. 43/400 IN TRICHY - PUDUKKOTTAI SECTION OF
NH 336 (OLD NH-210) IN THE STATE OF TAMIL NADU**

SUBMITTED TO



**THE PROJECT DIRECTOR
NATIONAL HIGHWAYS AUTHORITY OF INDIA
PROJECT IMPLEMENTATION UNIT
KARAIKUDI**

HIGHWAY ADMINISTRATION



**THE REGIONAL OFFICER
NATIONAL HIGHWAYS AUTHORITY OF INDIA
REGIONAL OFFICE
MADURAI**

APPLICANT

**M/s. GAUTAM POWER GENERATION PRIVATE LIMITED,
No. 104, CHARLES NAGAR,
PUDUKKOTTAI - 622005**

| Application Details [20250109/1/4/35166/14161] | |
|---|--|
| Highway | NH336 [NH336] |
| Name of Highway Authority | NHAI Dwarka New delhi |
| Highway Administration Address | RO-Madurai RO-Madurai |
| Whether the Fuel Station is part of Rest-area complex | No |
| Name of Applicant/Oil Company | SUGUMAR K Address: 318 CM NAGAR VANDIYUR, MADURAI (TAMIL NADU), PIN: 62020 Phn: 9976153486 Email: ksugumar4141@gmail.com |
| Application Category | Public Utility |
| Utility | Towers |
| State | TAMIL NADU |
| Type | New |
| Remarks | Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu |
| Submitted On | 09 Jan 2025 20:01:24 |

| Details | | |
|---|--|--------|
| 1. Length in Meters * | | 30.00M |
| 2. Width of available ROW | | |
| I. Left side from center line towards increasing chainage OR km direction * | | 15.00M |
| II. Right side from center line towards increasing chainage OR km direction * | | 15.00M |
| 3. Proposal to lay the utility | | |
| I. Left side from center line towards increasing chainage OR km direction * | | 13.50M |
| II. Right side from center line towards increasing chainage OR km direction * | | 13.50M |
| 4. Proposal to acquire the land | | |
| I. Left side from center line * | | Nil |
| II. Right side from center line * | | Nil |
| 5. Whether proposal is in the same side where land is not to be acquired * | | No |
| If not then where to lay the cable * | | NA |
| 6. Details of already laid services if any along the proposed route * | | NA |
| 7. Number of Existing lanes * | | 2 Lane |
| 8. Proposed number of lanes * | | 4 Lane |
| 9. Service road Exists * | | No |

| | | |
|--|--|-------------|
| 10. Proposed Service road | | |
| Left side from center line | | NA |
| Right side from center line | | NA |
| 11. Whether proposal to lay cable is after the service road or between the service road and main carriageway * | | Edge of ROW |
| 12. Whether carrying OFC Cable has been proposed on highway /bridges, If yes then mention the methodology proposed for the same * | | NA |
| 13. Is crossing of the road involved? If Yes, is shall be either encased in pipes or through structure of conduits specially built for the purpose at the expense of the agency owing the line * | | Yes |
| I. Whether the existing drainage structures are allowed to carry utility pipeline. * | | NA |
| II. Is it on a line normal to NH? * | | No YES |
| III. What is the distance of crossing the utility pipelines from the existing structure? Crossings shall not be too near the existing structures on the National Highway, the minimum distance being 15 mtrs. * | | 0.00 |

| | | |
|---|--|-----------------|
| IV. The casing pipe (or conduit pipe in the case of electric cable) line carrying the utility line shall be of steel, cast iron or reinforced concrete and have adequate strength and be large enough to permit ready withdrawal of carrier pipe/cable Mention type of casting. * | | NA |
| V. Ends of the casing/conduit pipe shall be sealed from outside, so that is does not act as a drainage path * | | NA |
| VI. The casing/conduit pipe should be as minimum extend from drain in cuts toe of slope in fills. * | | NA |
| VII. The installation of Casing pipe shall be as per attachment-1 of Ministry's Guidelines dated 22.11.2016 * | | NA |
| VIII. Mention the methodology proposed for crossing of road for the proposed sewerage / gas pipeline crossing shall be boring method (HDD) (Trenchless Technology) specially where the existing road pavement is of cement concrete of dense bituminous concrete type. * | | Manual Erection |
| 14. Whether the proposal satisfies the following: | | |

| | | |
|--|--|-----|
| I. Where the ROW is more than 45 M then the duct cable shall be laid at the edge of right of way within the utility corridor of 2 M width, duly keeping in view the future widening. * | | NA |
| II. Where land is yet to be acquired for 4 laning and the position of new carriageway has been decided then the cable shall be laid at the edge of right of way within the utility corridor of 2 M width, on that side of existing carriageway where extra land is not proposed to be acquired for 4 laning. * | | NA |
| III. Where the widening plan for 4 laning is not yet decided and available ROW is around 30 M or less, a judicious decision would need to be taken for permitting the laying of cable/duct. This could be within 1.5 M to 2m of utility corridor at the edge of existing ROW, duly keeping in view the possible widening plans. * | | Yes |
| IV. Where ROW is restricted and adequate only to accommodate the carriageway, central verge, shoulders and drains (e.g. Highways in cutting through hilly/rolling terrain), the cable shall be laid clear of the drain. * | | NA |

| | | |
|--|--|-----|
| V. Where land strip for utility corridor can't be conveniently earmarked (available ROW restricted to the toe of the embankment) for laying of cable/ducts, the permission may be refused. * | | NA |
| 15. Document/Drawings enclosed with the proposal * | | Yes |
| I. Cross section showing the size of trench for open trenching method (is it normal size of 1.2m (min.) deep x 0.3 wide) * | | NA |
| II. Cross section showing the size of pit and location of cable for HDD method * | | NA |
| III. Strip plan/ Route plan showing the OFC, Chainage width of ROW, distance of proposed, cable from the edge of ROW, important mile stone, intersections, cross drainage works etc. * | | Yes |
| IV. Methodology of laying of the Utility Pipeline/OFC * | | NA |
| V. Open trenching method (may be allowed in utility corridor only where pavement is neither cement concrete nor dense bituminous concrete type) If yes what is the Methodology of refilling of trench * | | NA |

| | | |
|--|--|----|
| (a) The trench width should be at least 30 cms but not more than 60 cms wider than the outer diameter of the pipe * | | NA |
| (b) For filling of the trench, bedding shall be to a depth of not less than 30 cms. It shall consist of granular material, free of lumps, clods, cobbles and graded to yiled firm surface without sudden change in the bearing value, unsuitable soil and rock edges should be excavated and replaced by selected material * | | NA |
| (c) The backfill shall be completed in two stages, i) Side fill to the level of the top of the pipe and ii) Overfill to the bottom of the road crust * | | NA |
| (d) The side fill shall consist of granular material laid in 15 cms, layers each consolidated by mechanical tampering and controlled addition of moisture to 95% of the proctor density. Overfill shall be compacted to the same density as the material that has been removed. * | | NA |

| | |
|---|-----|
| (e) The road crust shall be built to the same strength as existing crust on either side of the trench. Care shall be taken to avoid the formation of a dip at the trench. * | NA |
| (f) The excavation shall be protected by flagman, signs and barricades and red lights during night hours. * | NA |
| (g) If required, a diversion shall be constructed at the expense of agency owing the utility line. * | NA |
| VI. Horizontal Directional Drilling (HDD) Method * | NA |
| VII. Laying OFC through CD Works and Method of laying (Whether to be hung outside parapet). * | NA |
| 16. Draft license Agreement signed by two witnesses. * | Yes |
| I. The license fee estimate as per Ministry's guidelines issued vide circular no. RW/NH/33044/29/2015/S&R dated 22.11.2016. * | Yes |
| 17. Whether Performance Bank Guarantee is as per Ministry's guidelines issued vide circular no. RW/NH/33044/29/2015/S&R, dated 22.11.2016. * | Yes |
| I. Confirmation of BG has been obtained as per MoRTH guidelines * | Yes |
| 18. Affidavit/Undertaking from the Applicant for following is to be furnished | |

| | | |
|--|--|-----|
| a) Undertaking not to Damage to other utility, if damage then to pay the losses either to NHAI or the concerned agency. * | | Yes |
| b) Undertaking Renewal of Bank Guarantee as and when asked by MoRTH. * | | Yes |
| c) Undertaking Confirming all standard condition of Ministry's guidelines. * | | Yes |
| d) Undertaking for indemnity against all damages and claims * | | Yes |
| e) Undertaking for management of traffic movement during laying of utility line without hampering the traffic * | | Yes |
| f) Undertaking that if any claim is raised by the concessionaire/ contractor then the same has to be paid by the applicant. * | | Yes |
| g) Undertaking that prior approval of the NHAI shall be obtained before undertaking any work of installation, shifting or repairs, or alteration to the utility located in the National Highway Right of Ways. * | | Yes |

| | | |
|--|--|---|
| h) Undertaking that expenditure is any incurred by NHAI for repairing any damage cause to the NH by laying, maintenance of shifting of the utility line will be borne by the applicant agency owing the line. * | | Yes |
| i) Undertaking that text of the license deal is as per verbatim of format issued by MoRTH vide circular no. RW/NH/33044/29/2015/S&R dated 22.11.2016 * | | Yes |
| j) Undertaking for shifting of utility as and when asked by MoRTH/ NHAI. * | | Yes |
| k) Certificate from the applicant in the following format | | |
| l) We do undertake that I/we will relocate service road/approach road/utilities at my/our own cost not withstanding the permission granted within such time us will be stipulated by NHAI for future six laning or/any other development | | |
| 19. Who will sign the agreement on behalf of Applicant agency? Power of Attorney to sign the agreement is available or not. * | | The Managing Director will sign the agreement on behalf of the Applicant agency. Hence, Power of Attorney is not available. |
| 20. The Power of Attorney is in favour of authorized signatory? * | | No |

| Locations | | | | | | |
|-----------|------------|-------------|---|--|--|------|
| Sno | State | District | Highway /Stretch | Start Point | End Point | View |
| 1 | TAMIL NADU | PUDUKKOTTAI | NH336 [NH336] (0.000-44.000) From Km: 10 To Km: 43.6 | Chainage Point: 43.4 Lat: 10.419 Lng: 78.787 | Chainage Point: 43.4 Lat: 10.419 Lng: 78.787 | View |

| Documents | | | | |
|-----------|------------------|---|-----------|--------|
| Sno | Stage | Document | Mandatory | Action |
| 1 | Under Submission | Layout and Drawings | Yes | View |
| 2 | Under Submission | Any Other Supporting Document | No | View |
| 3 | Under Submission | Any Document to indicate commercial activities are allowed on the land. | No | -- |
| 4 | Under Submission | Safety Clearance from Directorate of Electricity | No | -- |
| 5 | Under Submission | Safety Clearance from Chief Controller of Explosives | No | -- |
| 6 | Under Submission | Safety Clearance from Petroleum and Explosives Safety Organisation | No | -- |
| 7 | Under Submission | Safety Clearance from Oil Industry Safety Directorate | No | -- |
| 8 | Under Submission | Safety Clearance from State/Central Pollution Control Board | No | -- |
| 9 | Under Submission | Any Other Statutory Clearance as applicable | No | -- |

| Applicable Fee Details | | | | | |
|------------------------|--------------|--------------------|--------------|--------|--------|
| Sno | Fee Head | Stage | Fee | Amount | Status |
| 1 | Utility Fees | Technical Approval | License Fees | 0 | |

CHECKLIST

Guidelines for project directors for processing the proposal for Erection of overhead Electrical pole in the land at National Highways vested with NHAI.

Permission for 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu

Relevant circulars: -

- 1) Ministry Circular No. NH-41 (58)/68 dated 31.01.1969
- 2) Ministry Circular No. NH-III/P/66/76 dated 19.11.1976
- 3) Ministry Circular No. RW/NH-III/P/66/76 dated 11.05.1982
- 4) Ministry Circular No. RW/NH-11037/1/86-DOI (ii) dated 28.07.1993
- 5) Ministry Circular No. RW/III-11037/1/86-DOI (ii) dated 19.01.1995
- 6) Ministry Circular No. RW/NH-34066/2/95/S&R dated 25.10.1999
- 7) Ministry Circular No. RW/NH-34066/7/2003 S&R (B) dated 17.09.2003
- 8) Ministry Circular No. RW/NH-III-34044/27/2005-S&R dated 21.09.2010
- 9) Ministry Circular No. RW/NH-III-34044/27/2005-S&R dated 33.11.2016

Check list for getting approval for Erection of Overhead

Electrical line on NH land

| S.No | Item | Information /Status | Remarks |
|------|-----------------------------------|---|---------|
| 1.0 | General Information | | |
| 1.1 | Name and Address of the Applicant | M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai | |
| 1.2 | National Highway Number | NH-336 (Old NH-210) | |
| 1.3 | State | Tamil Nadu | |
| 1.4 | Location | Trichy - Pudukkottai section of NH-336 | |

For GAUTAM POWER GENERATION PRIVATE LIMITED

M. M. Sengodan
Managing Director 22

B. Arun Prasad
B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAUKUDI

| | | | |
|------|--|---|--|
| 1.5 | Chainage In km | Crossing at Km.43/400 | |
| 1.6 | Length in Meters | Crossing -30.00 m Along the road -0.00 m | |
| 1.7 | Width in available ROW | | |
| | (a) Left side from center line towards increasing chainage/km Direction | 15.00 m | |
| | (b) Right side from center line towards increasing chainage/km Direction. | 15.00 m | |
| 1.8 | Proposal to erection of EB Line | | |
| | (a) Left side from center line towards increasing chainage/km Direction | 13.50m (Erection of Multi-Purpose Tower) | |
| | (b) Right side from center line towards increasing chainage/km Direction | 13.50m (Erection of Multi-Purpose Tower) | |
| 1.9 | Proposal to acquire land | | |
| | (a) Left side from center Line | Nil | |
| | (b) Right side from center Line | Nil | |
| 1.10 | Whether proposal is in the same side where land is not be acquire, if not then where to lay the underground electrical line. | LA Completed | |
| 1.11 | Details of already laid services, if any along the proposed route | NA | |
| 1.12 | Number of lanes (2/4/6 lanes) Existing | 2 lane | |
| 1.13 | Proposed Number of lanes (2lanes with paved shoulders/4/6/8 lanes | NA 4 lane | |
| 1.14 | Service road Existing or not | No | |

For GAUTAM POWER GENERATION PRIVATE LIMITED

M. Meed
Managing Director

B. Arun Prasad
B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAUKUDI

| | | | |
|------|---|----------------|--|
| | If yes then which side | | |
| | (a) Left side from center Line | Nil | |
| | (b) Right side from center Line | Nil | |
| 1.15 | Proposed Service Road | | |
| | (a) Left side from center Line | Not Applicable | |
| | (b) Right side from center Line | Not Applicable | |
| 1.16 | Whether proposal to erection of overhead line is after the service road or between the service road and main carriage way. | Edge of Row | |
| 1.17 | The permission for erection of overhead line shall be considered for approval/rejection based on Ministry Circular mentioned as above. (a) Carrying of Sewage /gas pipelines in highway bridges shall not be permitted Fumes/gases pipe can be accelerate the process of corrosion or may cause explosions, thus being much more injurious of water. (b) Carrying of water pipelines on bridges shall be discouraged. However, if the water supply authorities seem to have no other viable alternative and approach the highway authority well in time before the design of the bridges is finalized, they may be permitted to carry the pipeline in independent superstructure, supported on extended portions of piers and abutments in such a manner that in the final arrangement enough free spade around the superstructure of the bridge remains available for inspection and repair, etc., © Cost of required extension of the substructure as well as that of the supporting structure shall be borne by the agency-in - charge of the utilities, (d) Services are not being allowed indiscriminately on the parapet/any part of the bridges; | Not Applicable | |

For GAUTAM POWER GENERATION PRIVATE LIMITED

| | | | |
|------|---|---|--|
| | safety of the bridges has to be kept in view while permitting various services along bridge. Approvals are to be accorded in this regard with the concurrence of the Ministry's Project Chief Engineers only. | | |
| 1.18 | No of application on the same stretch | First | |
| 2 | Document/Drawings enclosed with the proposal | Yes | |
| 2.1 | Cross section showing the size of trench for open trenching method (Isit normal size of 1.2 m deep X0.3m wide) | | |
| | <p>(a) Should not be greater than 60cm in wider that the outer diameter of the pipe.</p> <p>(b) Located as close to the extreme edge of the right of way as possible but not less than 15 meters from the center lines of the nearest carriageway</p> <p>(c) Shall not be permitted to run along the NH when the road formation is situated in double cutting. Nor shall these be laid over the existing culverts and bridges.</p> <p>(d) These should be so laid that their top I at least 0.6 m below the ground level so as not to obstruct drainage of the road land.</p> | Not Applicable | |
| 2.2 | Cross section showing the size of pit location of cable for HDD method | Not Applicable | |
| 2.3 | Strip plan/Route plan showing the Overhead Electrical line, Chainage, Width of RoW distance, Important mile stone, and intersections etc. | Yes, Shown in diagram | |
| 2.4 | Methodology for erection of overhead electrical line. | Manual erection of Multi-purpose Towers (2 nos) | |

For GAUTAM POWER GENERATION PRIVATE LIMITED

25

| | | | |
|------|--|---|--|
| 2.41 | Open Trenching method. (May be allowed in utility corridor only while pavement is neither cement concrete nor dense bituminous concrete type. If yes, Methodology of refilling of trench | Not Applicable | |
| 3 | Draft License Agreement signed by Two witness | YES NO | |
| 4.0 | Performance Bank guarantee | Would be obtained after approval of the proposals | |
| 4.10 | Performance BG as per ministry's Circular No. RW/NH- 33044/27/2005-S &R ® dated 33.11.2016 to be obtained @ Rs 100/- per meter length | Applicable at later date | |
| 4.2 | Confirmation of BG gas been obtained as per NHAI guidelines | To be obtained at the time of execution of Agreement. | |
| 5.0 | Affidavit/Undertaking from the Applicant | Undertaking is enclosed is herewith | |
| 5.1 | Not be Damage to other utility, if damaged then to pay the losses either to NHAI or to the concerned agency | Yes | |
| 5.2 | Renewal of Bank Guarantee | Yes, will be obtained after submission of BG | |
| 5.3 | Confirming all standard condition of NHAI's Guideline | Yes | |
| 5.4 | Shifting of OH line as and when required by NHAI at their own cost | Yes | |
| 5.50 | Shifting due to 6laning/widening of NHAI | Yes | |
| 5.6 | Indemnity against all damages and claims clause (XXIV) | Yes | |
| 5.7 | Traffic movement during laying of water supply pipeline to be managed by the applicant | Yes | |
| 5.8 | If any claim is raised by the concessionaire, then the same has to be paid by the applicant | Yes | |

For GAUTAM POWER GENERATION PRIVATE LIMITED


 Managing Director



| | | | |
|------|---|---|--|
| 5.9 | Prior approval of the NHAI shall be obtained before undertaking any work of installation, shifting of repairs, or alternations to the showing water supply pipeline located in NH right of ways | Yes | |
| 5.10 | Expenditure if any incurred by NHAI for repairing any damage caused to the NH by laying maintenance or shifting of the water supply pipe line will be borne by the agency owning the line. | Yes | |
| 5.11 | If the NHAI considers it necessary in future to move the utility line for any work of improvement or repairs to the road, it will be carried out as desired by the NHAI at the cost of agency owning the utility line within a reasonable time (not exceeding 60 days) of the intimation given | Yes | |
| 5.12 | Certificate from the applicant in the following format (a) Laying of overhead electrical line will not have any deleterious effects on any of the bridge components and road way safety for traffic (b) For 4/6-laning "we do undertake that I will relocate service road /approach road /Utilities at my own cost notwithstanding the permission granted within such time as will be stipulated by NHAI" for future Four/six – laning or any other development." | Yes | |
| 6 | Who will sign the agreement? | The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai | |
| 7 | Certificate from the Project Director | | |

For GAUTAM POWER GENERATION PRIVATE LIMITED

27


B. ARUN PRASAD
 DGM(T) & Project Director

| | | | |
|-----|--|---|--|
| 7.1 | Certificate for confirming of all standard condition issued vide Ministry circular No.RE/NH-33044/17/2000-S&R dated 29.09.2000 and NHAI's guidelines issued vide no. NHAI/OEC/2K/VOL II dated 7.11.2000 NAD Minsistry Circular No RW/NH-33044/27/2005- S&R ® (pt) dated 06.08.2013 and Ministry Circular No. RW/NH-33044/27/2005-S &R ® dated 33.11.2016 | Yes | |
| 7.2 | Certificate for 4/6-laning from PD in the following format | | |
| | <p>(a) Where Feasibility is available "I do certify that there will be Hindrance to proposed six laning based on the feasibility report considering proposed structure at the said location".</p> <p>(b) In case feasibility report is not available "I do certify that sufficient ROW is available at site for accommodating proposed Four/six laning".</p> | Yes | |
| 8 | If NHAI section proposed to be taken up by NHAI on BOT basis a clause is to be inserted in the agreement. " | N/A | |
| 9 | Who will supervise the work of erection of overhead electrical line | Filed officers of NHAI and consultant/ Concessionaire, TNEB/TANGEDCO/TN GECL- Distribution Officials | |
| 10 | Who will ensure that the defects in road portion after erection of overhead electrical line are corrected and if not corrected then what action will be taken | The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai Bank Guarantee will be encashed. Claim amount will be determined according | |


For GAUTAM POWER GENERATION PRIVATE LIMITED

| | | | |
|----|--|--|--|
| | | to the nature and seriousness to the nature and seriousness of damages (if any defects in road portion, BG will be encashed by NHAI) | |
| 11 | Who will pay the claims for damages done/disruption in working of Concessionaire if asked by the Concessionaire | The applicant should pay the claims | |
| 12 | A certificate from Project Director that he will either the proposed permissions in the register of records of the permissions in the prescribed Performa (Copy Enclosed) issued vide ministry circular No. RW/NH/33044/17/2000/S&R R dated 23.07.2003 & 06.08.2013 and Ministry Circular No. RW/NH- 33044/27/2005-S&R ® dated 33.11.2016. | Yes | |
| 13 | If any previous approval is accorded for erection of overhead electrical line, then photocopy of register of records of permission accorded as maintained by Project Director then copy be enclosed | No | |

X

For GAUTAM POWER GENERATION PRIVATE LIMITED


 Managing Director


E. ARUN PRASAD
 DGM(T) & Project Director
 National Highways Authority of India
 PIU - KARAIKUDI

Proposed for Permission for 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu

GENERAL TO ACCOMPANY ALL PROPOSALS

CHECKLIST

GENERAL

| | | |
|---|---|--|
| 1 | Whether the site plan is drawn to scale of 1:5000 or 1:2500 and enclosed | Not to scale |
| 2 | Whether the details for 100 m either side of utility laying have been furnished | No |
| 3 | Does the plan is shown in full | Yes |
| | a. NHAI boundary line with distance from center line of the road marked at salient points where the land width is changing and also 200 m interval. | Yes |
| | b. The berm, line distance form center line at 200m intervals and also salient points of change of widths of NHAI land | Yes |
| | c. Center line of pavement and pavement edge line marked distinctly | Yes |
| | d. Median if any marked to scale | NA |
| | e. The locations of the utility UG cable line of proposal with Change showing exact location and distance from NHAI Center line | Yes |
| | f. The Existing culverts/ drainage works with diversions | Yes |
| A | Purpose of the proposal in details | Erection of 22KV Multi - Purpose Towers (2 nos) for crossing Overhead Electrical Power Transmission Line |
| B | Exact Location of the proposal | Erection of 22KV Multi - Purpose Towers (2 nos) crossing at Km. 43/400 |
| C | Whether the applicant is private agency or Govt. Agency | Private Agency |

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director



B. ARUN PRASAD
DOM(T) & Project Director
National Highways Authority of India
PIU - KARAİKUDI

| | | |
|---|---|--|
| D | Any time schedule fixed for the completion of the proposal made | As quickly as Possible |
| E | Reason why the proposal could not be accommodated outside the NH land | Overhead Electrical Line from EB Substation abutting on LHS of the NH-336 have to cross the existing NH land to reach the Pudukkottai SIPCOT abutting on the RHS of the NH-336 |
| F | Whether any other location other than this difficult or costly | NA |
| G | Whether the proposal, if implemented, will affect the design stability and traffic safety of national Highways | No |
| H | Whether the proposal, if implemented now will affect any likely future improvement, such as improvements in geometric | No |
| I | If there any proposal improvements, in this stretch of likely to be sanctioned in the near future where they will be affected by this | No |


CERTIFICATE

1. This proposal when implemented will not affect the design stability and traffic safety of National Highways Authority of India.
2. This proposal implemented now, will not affect any likely future improvements such as improvements to geometrics.
3. There is no proposal for improvements in this stretch likely to be sanctioned near future.
4. This proposal is in accordance with the Government of India specifications.
5. No other location is possible other than this route.
6. The application has not laid/crossed the proposed 22KV Overhead Electrical line in the proposed stretches so far.
7. The Licensee shall have to provide safety measures like barricading, danger lighting and other necessary caution boards while executing the work.

The above-mentioned rules have been noted for guidance.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director


B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAİKUDI



தமிழ்நாடு தமில்நாடு TAMILNADU

08.01.2025

EY 026989

GAUTAM POWER GENERATION
PRIVATE LIMITED/PUDUKKOTTAI

உதா. நாதாசாமிசுவாமிநாதன்
முத்தியைத்தாள் நிற்பனையாளர்
நீதி யன்ற வளாகம்,
உ.எண் : 363/ஆ 1/2004
24/1 வாழ்க வளமுடன் தெரு,
L.G.உ.காம்பலுண்டு,
Y.M.R.பட்டி திண்டுக்கல்.

LICENCE DEED FOR ERECTION OF OVERHEAD ELECTRICAL LINE ACROSS NATIONAL HIGHWAY LAND

Agreement to Erection of 22 KV Over Head Electrical Power Transmission Line & 2 nos of Multi-purpose Towers crossing at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

This Agreement made this _____ days of _____(month) of _____(year) between _____ acting in his executive capacity through _____(hereinafter referred to as the "Authority" which expression shall unless excluded by or repugnant to the context, include his successes in office and assigns) on the one part, and **The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai, Tamil Nadu State** (hereinafter called the "Licensee") which expression shall unless excluded by repugnant to the context, include his successors/administrator assignees on the second part.

WHEREAS the National Highway Authority of India is responsible for the development and maintenance of the National Highway Road from Km. 10/000 to Km. 43/600 of Trichy - Pudukkottai Section of NH-336 (Old NH-210).

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

WHEREAS the Licensee is a Company and has been given a licensee by the Government of India, Ministry of Communication to Provide long distance network services in the State of Tamil Nadu.

WHEREAS the Licensee has applied to the NHAI for the Erection of 22 KV Over Head Electrical Power Transmission Line & 2 nos of Multi-purpose Towers crossing at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

AND WHEREAS the NHAI have agreed to grant such permission on the terms and conditions herein after mentioned.

Now, this agreement witnesses that subject to the conditions hereinafter contained and on the part of the Licensee to be observed and performed. NHAI hereby grant to the licensee permission to erection of 22 KV Over Head Electrical Power Transmission Line & 2 nos of Multi-purpose Towers in accordance with the predetermined route and the approved drawing and methodology attached hereto as annexure subject to the following conditions, namely:

1. ROW permissions are only enabling in nature. The purpose of extending the way leave facility on the National Highway ROW is not for enhancing the scope of activity of a utility service provider, either by content or by intent. Further enforceability of the permission so granted shall be restricted only to the extent of provisions/scope of activities defined the in the licensee agreement: & for the purpose for which it is granted.
2. No Licensee shall claim exclusive right on the ROW and any subsequent user will be permitted to use the ROW, either above or below or by the utilities laid by the first user, subject to technical requirements being fulfilled. Decision of the Authority in relation to fulfilment of technical requirement shall be final and binding on all concerned parties. In case any disruption/damage is caused to any existing user by the subsequent use, the Authority shall not be accountable or liable in any manner.
3. The Licensee shall be responsible for undertaking all activities including, but not limited to site identification, survey, design, engineering, arranging, finance, project management, obtaining regulatory approvals & necessary clearness, supply of equipment material, construction, erection, testing and commissioning. Maintenance and operation and all other activities essential or required for efficient functioning of their own utility/industrial infrastructure facilities.
4. The Licensee shall pay licensee fees @Rs...../Sq m/ month to the Authority. The Licensee fee become payable from the date of handing over of ROW land to the Licensee, for laying of overhead electrical line/ utilities/cables/conduits/pipelines for infrastructure/service provider. As regards Tariff and Terms and conditions for providing common utility ducts along National Highways, there shall be a separate agreement regime.

For GAUTAM POWER GENERATION PRIVATE LIMITED

X


Managing Director

5. Fee shall have to be paid in advance for the period for which permission is granted for entering into a license agreement. In case of removal, rate prevailing at the time of removal shall be charged. Delay in deposition of fee shall attract interest @ 15% per annum compounded annually.

6. Present policy of the MoRT&H is to provide a 2.00m wide utility corridor on either side of the extreme edge of ROW. In cases where utility ducts with sufficient space are already available along NH, the utility services shall be laid in such ducts subject to technical requirements being fulfilled.

7. The utility services shall be laid at the edge of the ROW. In case of restricted width of ROW, which may be adequate only to accommodate the carriageway, central verge, shoulders, slopes of embankment drains, other side furniture etc utility services shall be laid beyond the toe line of the embankments and clear of the drain.

8. The Licensee shall make own arrangement for crossing of cross drainage structure, rivers etc below the bed. In case this is not feasible, the utility services may be carried outside the railing/parapets and the bridge superstructures. The fixing and supporting arrangement with all details shall be required to be approved in advance from the concerned Highway Administration. Additional cost on account of fixing and supporting arrangement as assessed by the Authority shall be payable by the Licensee.

9. In exceptional cases, where ROW is restricted the utility services can be allowed beneath the carriageway of service road, if available, subject to the condition that the utility services be laid in concrete ducts, which will be designed to carry traffic on top. The width of the duct shall not be less than one lane. In such cases, it also needs to ensure the maintenance of the utility services shall not interface with the safe and smooth flow of traffic. The cost of operation and maintenance will have to be borne by the Licensee. 10. It is ensured that at no time there is interference with the drainage of the road land and maintenance of the National Highways. Forwards this, the top of the utility services shall be aesthetically provided for / landscaped with required safety measures as directed by concerned Authority.

11. The utility service shall be permitted to cross the National Highway either through structure or conduits specially built for that purpose. The casing/conduit pipe should as minimum, extend from drain to drain in cuts and toe of slope to toe of slope in the fills and shall be designed in accordance with the provision of IRC and executed following the specifications of the Ministry.

12. Existing drainage structures shall not be allowed to carry the lines across.

13. That the licensee shall at all time permit any duly authorized officer (or) servant of the NHAI to inspect the said erection/crossing of Overhead Electrical line.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

14. The casing services shall cross the National Highways preferable on a line normal to it or nearly so as practicable.

15. The casing/conduit pipe for crossing the road may be installed under the embankment either by boring or digging a trench. Installation by boring method shall be preferred.

16. That in case of any burst or leak of Erection/crossing of Electrical line, the licensee shall bear the entire cost of the restoration or damage caused to the road.

- a. That the licensee shall be liable for any loss or damage caused to the NHAI by drainage obstruction or any other like caused due to the said erection of electrical pole.
- b. The backfill shall be completed in two stages (i) side-fill to the level of the top of pipe (ii) Overfill to the bottom of the road crust.
- c. The road cross shall be built to the same strength as the existing crust on the either side of the trench or to thickness and specifications stipulated by the Highway Authority.

17. The licensee shall ensure making good the excavated trench for laying utility services by proper filling and compacting, so as to restore the land in to the same condition as it was before digging the trench, cleaning debris/loose earth produce due to execution of trenching at least at least 50m away from the edge of the right of way.

18. All required restoration works subsequent to laying of the cable shall be required to be undertaken by the consultation with the Authority as per Predetermined time schedule and quality standards.

19. Prior to commencement of any work on the ground a performance Bank Guarantee @ Rs..... per sq m with validity of one year initially (extendable if require till satisfactory completion of work) shall have to be furnished by the Licensee to the Authority/its designated agency as a security against improper restoration of group in terms of filling/unsatisfactory compaction damages caused to other underground in terms of filling/ unsatisfactory compaction damages caused to other underground insulation/ utility services & interference, interruption, disruption or failure caused there of any services etc. In case of the Licensee failing in discharge the obligation of making good of the excavated trench/ other restoration work, the Authority shall have a right to make good the damages caused by excavation at the cost the licensee and recover the amount by forfeiture of the Bank Guarantee.

20. In case, the Performance Bank Guarantee is invoked as mentioned above, the Licensee shall be required to replenish and restate the required the performance Bank Guarantee within one month of such invoking. In case the work contemplated herein is not completed in the satisfaction of the

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

Authority, which has granted the permission within a period of 11 month from the date of issue of the Bank Guarantee, the Licensee shall either furnish a fresh guarantee or extend the guarantee for a further period of one year. Notwithstanding this, the Licensee shall be liable to pay full compensation to the aggrieved Authority/its designated agency for any damage sustained by them by reason of the exercise the ROW facility.

21. The Licensee shall shift the Overhead Electrical line within 90 days (or as specified by the respective Authority) from the date of issue of the notice by the concerned Authority to shift/relocate the Overhead Electrical line, in case it is so required for the purpose of improvement widening of the road/highway or construction of flyover/bridge and restore the road/land to its original condition at his own cost and risk.

22. The Licensee shall be responsible to ascertain from the respective agency in coordination with Authority, regarding the location of other utilities/ underground installations/facilities etc. The Licensee shall ensure the safety and security of already existing Overhead lines/underground installations/utilities/facilities etc. before commencement of the excavation/using the existing cable ducts. The Licensee shall procure insurance from a reputed insurance company against damages to already existing Overhead lines/ underground installations/utilities/facilities etc.

23. The Licensee shall be solely responsible / liable for full compensation/ indemnification of concerned agency/aggrieved Authority for any direct, indirect or consequential damage caused to them/claims or replacements sought for, at the cost and risk of the Licensee. The concerned agency in coordination with Authority shall also have a right to make good such damages/recover the claim by forfeiture of Bank Guarantee.

24. If the Licensee fails to comply with the condition to the satisfaction of the Authority, the same shall be executed by the Authority at the cost and risk of the Licensee.

25. Grand of Licensee is subject to the Licensee satisfying (a) minimum disruption of traffic and (b) no damage to the highways. As far as possible, the Licensee should avoid cutting of the road for crossing highway, and other roads any try to carry out the work by trenchless technology. In case any damage is caused to the road pavement in this process, the Licensee will be required to restore the road to the original condition at its cost. If due to unavoidable reasons the road needs to be cut for crossing or laying utility services, the Licensee has to execute the restoration work in a time bound manner at its cost either by itself or through is authorized representative in consultative with the Authority as per predetermined time schedule and quality standards. In case of the Licensee failing to discharge the obligation of making good of the excavated trench/ other restoration work, the Authority shall have a right to make good the damage caused by excavation, at the cost of the Licensee and recover the amount by forfeiture of the Bank Guarantee.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

X

26. The Licensee shall inform/give a notice to the concerned agency designated by the Authority at least 15 days in advance with route details prior to digging trenches, for fresh or maintenance/repair works. A separate performance Bank Guarantee for maintenance/repair works shall have to be furnished by the Licensee.

27. Each day, the extent of digging the trenches should be strictly regulated so that Utility services are laid and trenches filled up before the close of the work that day. Filling should be completed to the satisfaction of the concerned agency designated by the Authority.

28. The Licensee shall indemnify the concerned agency in coordination with Authority, against all damages and claims, if any, due to the digging of trenches for laying cable/ducts.

29. The permission for laying utility services is granted maximum for 5 years at a time, which can thereafter be considered for renewal. On payment of additional fee at the time of renewal, the permission shall automatically be renewed, unless defaults exist. In case of renewal, rate prevailing at the time of renewal shall be charged. Delay in deposition of fee shall attract interest @ 15% per annum compounded annually.

30. The permission shall be valid only for the period it is issued and fee deposited. However, the Authority also has a right to terminate the permission or to extent the period of Agreement.

31. That the Licensee shall not undertake any work of shifting, repairs or alteration to the utility services without prior written permission of the concerned agency in coordination with the Authority.

32. The permission granted shall not in any way be deemed to convey to the licensee any ownership right or any interest in route/road/highway land/property, other than what is herein expressly granted. No use of ROW will be permitted for any purpose other than that specified in the Agreement.

33. During the subsistence of this Agreement, the Overhead Electrical line/Ducts located in highway land/property shall be deemed to have been constructed and continued only by the consent and permission of the Authority so that the right of the Licensee to the use thereof shall not become absolute and indefeasible by lapse of time.

34. The Licensee shall bear the stamp Duty charged on this Agreement.

35. Three copies of 'as laid drawings' of utilities (hard and soft copies) with Geo-tagged photographs and Geo-tagged video recordings of laying of overhead lines (with respect to the NH) and after complete restoration shall be submitted to the Authority verification and record wit in a month of completion of works.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

36. The Licensee shall allow free access to the site at all times to the authorized representatives of Authority to inspect the project Facilities and to investigate any matter within their Authority and upon reasonable notice shall provide reasonable assistance necessary to carry out their respective duties and functions.

37. The utility services shall not be made operational by the Licensee unless a completion certificate in the effect that the utility services has been laid in accordance with the approved specification and drawings and the trenches have been filled up to the satisfaction of the concerned agency in coordination with the Authority has been obtained. Notwithstanding anything contained herein, this Agreement may be cancelled at any time by the Authority for breach of any condition of the same and the Licensee shall neither be entitled to any compensation for any loss caused to it by such cancellation nor shall it be absolved from any liability already incurred.

38. The Licensee shall ensure adherence to relevant India standards and follow best industry practices, methods and standards for the purpose of ensuring the safe efficient and economic design, construction, commissioning, operation, repair and maintenance of any part of the utility lines/ industrial infrastructure facilities and which practices, methods and standards shall be adjusted as necessary to take account of;

- a. Operation, repair and maintenance guidelines given by the manufactures.
- b. The requirements of Law.
- c. The physical conditions at the site, and
- d. The safety of operating personnel and human beings.

39. The Licensee shall have to provide safety measures like barricading, danger lighting and other necessary caution boards while executing the work.

40. While laying utility services, at least one lane of road shall be kept open to traffic at all time. In case of single lance roads, diversions shall be constructed. If any traffic diversion works are found necessary the working period such diversion shall be provided at the cost of Licensee.

41. After the termination /expiry of the agreement, the licensee shall remove the Overhead electrical line /cable/ducts within 90 days and the site shall be brought back to the original condition failing which licensee shall furnish a Bank Guarantee to the Authority for a period of one year for an amount assessed by the Authority as a security for making good the excavated trench by proper filling and compaction, Clearing debris, loose earth produced due to excavation of trenching at least 50 m away from the edge of the ROW.

42. Any disputes in interpretation of the terms and conditions of this Agreement or their implementation shall be referred to the redress mechanism

For GAUTAM POWER GENERATION PRIVATE LIMITED

X


Managing Director

preventing in ministry and decision of the redress mechanism shall be final and binding on all.

43. For PPP Project in caste of any financial loss incurred by the respective project concessionaires due to such erection of overhead electrical line/ laying and shifting of utility services by the licensee, compensation for the same shall be required to be borne by the Licensee in mutual agreement with the respective project concessionaires. MORTH & NHAI/Implementing Authorities for the project not liable to the concessionaire in any way in this regard.

This Agreement has been made in duplicate, each on a Stamp paper; each party to this Agreement has retained one stamped copy each

IN WITNESS WHEREOF THE PARTIES HERE TO HAVE CAUSED THIS AGREEMENT TO BE EXECUTED THROUGH THEIR RESPECTIVE AUTHORISED REPRESENTATIVES THE DAY THE YEAR FIRST ABOVE WRITTEN

SIGNED ON

SIGNED SEALED ON

α

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

The Managing Director,
M/s. GAUTAM POWER
GENERATION PRIVATE
LIMITED, Pudukkottai

DELIVERED FOR AND ON BEHALF
OF AUTHORITY

(Signature, Name & Address with stamp)

IN THE PRESENCE OF (WITNESS);

1

2.



தமிழ்நாடு தமில்நாடு TAMILNADU

08.01.2025

EY 026987

GAUTAM POWER GENERATION
PRIVATE LIMITED / PUDUKKOTTAI

ஆர்.நாதாசாமிசுவாமி
முத்திரைத்தாள் கிற்பனையாளர்
நீதி யன்ற வளாகம்.
உ.எண் : 363/ஆ 1/2004
24/1 வாழ்க வளமுடன் தெரு.
L.G.B.காம்பவுண்டு.
Y.M.R.பட்டி திண்டுக்கல்.

IDEMNITY BOND

Name of the work: Requesting permission towards Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

Indemnity against all damages and claims as per SI.No. 5.6 Of Checklist:

We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai or in do here by indemnity Project Director, NHAI, PIU, Karaikudi binding ourselves to pay all the losses and claims in respect of Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu or maintenance thereof and against all claims, proceedings, damages, costs, charges and expenses or maintenance thereof and against all claims, proceedings, damages, costs, charges and expenses whatsoever in respect thereof in relation there to. Failing such payments of claims in the above work we abide in accepting for recovery of such claims affected from any of our assets.

For GAUTAM POWER GENERATION PRIVATE LIMITED

[Signature]
Managing Director

Enclosure to Ministry of Road Transport & Highways Letter no.RW/NH-33044/27/2005/S&R (R) (PT.) dated 33.11.2016

Annexure-1

GUIDELINES FOR GRANTING RIGHT OF WAY PERMISSIONS TO TELECOM SERVICE LICENSEES / INFRASTRUCTURE PROVIDERS FOR LAYING OF TELECOM CABLES/DUCTS/OVERHEAD LINES ON NHAI LAND

Government has realized the need for creating a robust telecommunication infrastructure with adequate bandwidth at affordable rates in order to promote development and proliferation of Information Technology, Electronic Governance, E-Commerce convergence of information, communication, and entertainment sectors so as to improve the state of economy, enhance the quality of life of the citizens and to ensure development of urban and rural areas with equity throughout the country.

The Department of Telecom (DoT), Ministry of communications, Government of India has issued the National Telecom Policy 2012 in recent past which enunciates the need to review and simplify sectoral policy for granting Right of Way (Row) for laying cable networks among others.

Keeping the above objectives in view, the following broad guidelines are being recommended by the Ministry of Road Transport & Highways(MoRTH), under which row permissions may be granted to licensed telecom operators and registered infrastructure providers for laying Telecom Cables including Optical Fiber Cable (OFC)/ ducts under, over, along, across, in or upon a property vested in or under the control or management of local authority or of any other person including public authority, public corporation, autonomous body, State Govt. or Central Govt. in their respective licensed service area during the currency of their license.

1. Any authorized License of DoT/Registered Infrastructure Provider is eligible to seek/avail RoW facility/permission. However, enforceability of the permission so granted shall be restricted to the extent of provisions/scope of service contained, defined in the license agreement of that licensee & for the purpose for which it is granted.
2. Either by content or by intent, the purpose of extending RoW facility is not to enhance the scope of license of a licensee or such RoW permissions are only enabling/facilitating in nature.
3. The cable shall always be laid at the edge of the RoW. In case of restricted width of RoW, which may be adequate only to accommodate the carriageways, central verge, shoulders, slopes of embankment and drains, the cables shall be laid beyond the toe line of the embankments and clear of the drain. In cases where cables ducts with sufficient spaces are already available along with NHAI, the cables shall be laid in such ducts subject to technical requirements being fulfilled. Present policy of the MoRTH is to provide a 2.00m wide utility corridor on either

For GAUTAM POWER GENERATION PRIVATE LIMITED

α


Managing Director

41

side of the extreme edge of RoW where required RoW of at least 30m is available, which includes provision of OFC Ducts.

4. The facility of RoW for laying underground Telecom cables, shall be available to all licensees (irrespective of existing or future) and registered/licensed infrastructure providers, without discrimination and without payment of any compensatory charges/levy/lease rentals/license fee/free bandwidth/revenue share/cashless equity etc. subject to the condition that this row shall be available to licensees to the extent of provisions contained in their license agreements and reinstatement charges shall be borne by such licensees.

5. A Performance Bank Guarantee @ RS.100 per route meter with a validity of one year initially (expandable if required till satisfactory completion of work) shall have to be furnished by each license to the Authority /its designated agency as a security against improper restoration of ground in terms of filling /unsatisfactory compaction charges damages caused to other underground installations /utility services & interference, interruption, disruption or failure caused thereof to any services etc. the above charge of Rs.100/m is liable to be reviewed every 5 years. For clarification, it is hereby mentioned that all required restoration works subsequent to laying of the cable shall be required to be undertaken by the licensees its cost either by itself or through its authorized representative in consultation with the authority as per predetermined time schedule and quality standards. In case of the licensee failing to discharge the obligation of making good of the excavated trench/other restoration work, the Authority shall have a right to make good the damages caused by excavation, at the cost of the licensee and recover the amount of forfeiture of the Bank Guarantee. In case, the performance Bank Guarantee is invoked as mentioned above the license shall be required to replenish and reinstate the required Performance Bank Guarantee within one month of such invoking. In case the work contemplated herein is not completed to the satisfaction of the Authority, which has granted the permission, within a period of 11 months from the date of issue of the Bank Guarantee, the licensee shall either period furnish a fresh guarantee or extend the guarantee for a further period of one year.

Notwithstanding this, the License shall be liable to pay full compensation to the aggrieved Authority its designated agency for any damage sustained by them by reason of the exercise of the Row facility.

6. In order to expedite RoW clearances to the Licensees in a time-bound manner through an appropriate and effective approval mechanism, a committee under the chairmanship of Chief Secretary to the respective State Govts. may act as single window to coordinate all activities in this regard. Each State Govt. may select a Nodal Person/Secretary of a Dept. to function as Secretary to this Single Window Clearance Committee. However, in case of NHAI land, licenses would be required to take permission from the highway administration for lying of cables. As regards NHAI routes executed by the State PWD, the concerned state Chief Engineer (NH) may act as nodal point/single window to coordinate the activities whereas in

For GAUTAM POWER GENERATION PRIVATE LIMITED

X


Managing Director

respect of the NHAI routes held by NHAI & BRDB, designated officers of NHAI & BRDB may be assigned this task.

For work involving laying of cables along National Highways Authority of India in different States or National Highway Authority of India Project of length exceeding 500 Km. in one state, Project Director (Standards, Research & Technology) (R), MoRTH shall be the approving authority under whom a Single Window Facilitation Committee will be created.

Highway Administrator Nodal Officer shall maintain a record of all Row permissions granted in the Format given in Annexure - III including permissions given at Ministry level.

7. RoW permissions may be granted by the said nodal office to a Licensee within a period of four weeks from the date of submission of completed application subject to the Licensee's application being complete with route details (including authority/ownership of concerned sections of the route) and compliance to eligibility requirement, furnishing of requisite Bank Guarantee and execution of an Agreement having operational details. The above stated Single Window Clearance committee may be responsible to co-ordinate in the case of any dispute for ownership of property and expedite grant of RoW clearance thereof so as to adhere to the stipulated time-frame.

8. In case any shifting or alteration in the position of the laid Telecom Cables is required due to widening of highways and constructing of flyovers of bridges, the Licensee shall do the same at his own cost at a later date within specified period indicated by the respective agency.

9. In order to avoid repeated digging on the same routes in cases where cable ducts with sufficient space are already available along NHAI, laying of cables shall be encouraged in such ducts subject to technical requirements being fulfilled. In cases where such ducts are not available, the first incumbent shall be allowed to lay voluntarily extra ducts/conduits with extra capacity so as to take care of future needs. The capacity/excess capacity can be commercialized by the incumbent with suitable mutual agreements with the excess capacity by the first incumbent shall not be a pre-condition for giving RoW clearances. The Central/State roadways authorities may consider laying ducts/conduits at the time of construction of roads to facilitate laying Telecom Cables for which suitable charges could be imposed.

10. Licensee shall ensure safety and security of all underground installations / utilities / facilities and shall be solely responsible for compensation / indemnification of concerned authority for damage caused / claims or replacements sought for at the cost and risk of Licensee.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

11. Licensee shall be liable to give a notice of 15 days with route details prior to trenching for fresh or maintenance / repair works. A separate performance Bank Guarantee for maintenance / repair works shall be furnished by Licensee.

12. The period of validity of RoW permission shall be co-terminus with the validity of license.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

For the M/s. GAUTAM POWER GENERATION
PRIVATE LIMITED, Pudukkottai.



தமிழ்நாடு தமில்நாடு TAMILNADU

08-01-2025

EY 026985

GAUTAM POWER GENERATION
PRIVATE LIMITED/PUDUKKOTTAI

ஆர்.நாதாசுரீசுவரன்
முத்தியார்த்தன் விற்பனையாளர்
நீதி மன்ற வளாகம்.
உ.எண்: 353/ஆ 1/2004
2டி/1 வாழ்க வளமுடன் தெரு.
L.G.B.காம்பவுண்டு,
Y.M.R.யுடி திண்டுக்கல்.

UNDERTAKING

We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai seeking Permission for Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

We hereby undertake the standing conditions of NHAI Guidelines.

1. **Not to damage to other utility, if damaged then to pay the losses either to NHAI or to the concerned agency:** Regarding the location of other Overhead Electrical lines / Pipelines, underground installation / utilities etc., the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall be responsible to ascertain from the respective agency in coordination with NHAI. The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall be responsible for safety of all construction works such as erection of towers, stringing of line along and across the NH Road.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director 45

2. **Renewal of Bank Guarantee:** The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai furnishes a bank guarantee @ Rs. 100 per square meter to the NHAI, for a period of one year initially (extendable if required till satisfactory completion of work) as a security for ensuring/making good the excavated trench for laying the cables/ducts by proper filling and compaction, clearing debris/loose earth produce due to execution of trenching at least 50m away from the edge of the right of way. No payment shall be payable by the NHAI to the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai for clearing debris /loose earth. In case the work contemplated herewith is not completed to the satisfaction of the NHAI, which has granted the permission, within a period of 11 months from the date of issue of the bank guarantee, the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall either furnish a fresh guarantee or extend the guarantee for a further period of one year. In case of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai falling to discharge the obligation of making good the excavated trench, NHAI shall have an amount by invoking the bank guarantee furnished by the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai.

3. **Confirming all standard conditions of NHAI:**

- i. The period of validity of way leave permission shall be co-terminus with the validity of licensee given by the Ministry of communication/DOT.
- ii. Existing CD works will not be utilized for Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu and shall be crossed by providing 2 nos of Multi-purpose Towers on either side by the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai.
- iii. The NHAI has a right to terminate the permission or to extend the period of agreement. In case the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai wants shifting, repair or alteration to overhead lines, it will have to furnish a separate bank guarantee.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

- iv. The Licensee shall not without prior permission in writing from the NHAI Govt. of India or its authorized agency undertake any work of Shifting, repairs or alterations to the said erection of overhead line.
- v. The permission granted shall not in any way be deemed to convey to the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai any ownership right or any interest in route/ road/ highway/ land/ property, other than what is herein expressly granted.
- vi. During the subsistence of this agreement, the laying overhead lines /ducts located in highway land / property shall be deemed to have been constructed and continued only by the consent and permission of the NHAI so that the right of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai to the use thereof shall not become absolute and indefeasible by laps of time.
- vii. The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall bear the stamp duly charged for the agreement.
- viii. The overhead lines shall not be brought in to use by the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai unless a completion a certificate to the effect that the laying Overhead transmission line has been laid in accordance with the approved specifications and drawings and the trenches have been filled up to the satisfactions of the concerned agency in co-ordination with the owner has been obtained.
- ix. Notwithstanding anything NHAI contained herein this agreement may be cancelled at any time by the breach of any condition of the same and the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall neither be entitled to any compensation for any loss caused to it by such cancellation not shall it be absolved from any liability already incurred.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

- x. The licensee shall have to provide barricading, danger lighting and other necessary caution boards while executing the work and during maintenance. If NHAI is required to do some emergent work, the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai will provide an observer within 24 hours. NHAI will not responsible for any damage of any kind by what so ever means natural or otherwise.
4. The enforceability of the ROW permission granted herd in shall be restricted to the extent of provisions/scope of service contained/defined in the licensee agreement of the licensee with the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai and for the purpose for which it is granted. Either by content or by intent the purpose extending this ROW facility is not enhance the scope of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai.
5. **Shifting of OH Electrical line as and when required by NHAI**, the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall shift the pipelines within 90 days (or as specified by the respective agency/owner) from the date of issue of the notice by the NHAI, Govt. of India to shift/relocate the Overhead electrical lines. In case, it is so required for the purpose of improvement/widening of the road/route/highway or construction of flyover/bridges and restore the road/land to its original condition at its own cost and risk for shifting of OHL.
6. **Shifting due to 4/6laning/widening of NH:** After the termination/expiry of the agreement, the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall remove the Overhead electrical lines within 90 days and the site shall be brought back to the original condition failing which the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai will lose the right to remove the overhead electrical lines. However, before taking up the work of removal of overhead lines the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai is hall furnish a bank guarantee to the owner for a period of one year for an amount assessed by the owner for making good the erection of electrical overhead lines should be 6.5m vertical clearance.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

7. **Traffic movement during laying of OHL to be managed by the applicant:** If any traffic diversion works are found necessary during the working period such diversion shall be provided at the cost of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai.
8. **If any claim is raised by the concessionaire, then the same has to be paid by the applicant:** The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall be solely responsible/liable for full compensation/ indemnification of concerned agency/aggrieved owner for any direct, indirect or consequential damage caused to them/claims or replacement sought for, at the cost and risk of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai. The concerned agency in co-ordination with NHAI shall also have a right to make good such damages/recover the claims by way of invoking of bank guarantee furnished by the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai fails to comply with the condition 5 and 6 above to the satisfaction of the NHAI, the same shall be got executed by the NHAI, the same shall be got executed by the NHAI at the risk and cost of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai.
9. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby do undertake to furnish a Performance Bank Guarantee @ 100/- per square meter and @ Rs. 1 lakh per crossing for a period of one year initially (extendable if required till satisfactory completion of work) as a security against improper restoration of ground in terms of filling/ unsatisfactory compaction/damages caused to other underground installation utility services & interference Interruption, disruption of failure caused thereof to any services etc. In case, the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai failing to discharge the obligation of making good the damages caused due to excavated trench, the NHAI shall have a right to make good the damages caused due to excavation at the cost of the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai and recover the amount by invoking the bank guarantee.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

In case the work contemplated is not completed to the satisfaction of NHAI, which has granted the permission within a period of 11 months from the date of issue of the bank guarantee. The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall either furnish a fresh guarantee or extend the guarantee for a further period of one year.

10. Not to damage to other utility, if damaged, then pay the losses either to NHAI or to the concerned agency.
11. We shall inform the officers of NHAI at least 15 days in advance before starting the work.
12. We shall not, without the prior permission in writing of the concern officers of the NHAI undertake the any shifting and other alteration works of this erection of power lines.
13. NHAI shall not be responsible for any damage caused to the power supply lines or by any activity of our side on the permitted highway. The parties are agreed that we are laying the power supply lines on the permitted highway at its own cost.
14. The excavated tower pit shall be properly back filled, so as to restore the land in the same in the condition as it was before the excavation of the pits and shall clear the debris/loose earth produced from the execution of the towers/EB pole pits.
15. In case the work contemplated is not completed to the satisfaction of NHAI, which has granted the permission within a period of 11 months from the date of issue of the bank guarantee. The Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai shall either furnish a fresh guarantee or extend the guarantee for a further period of one year.
16. We will relocate the overhead electrical lines/utilities at our own cost notwithstanding the permission granted within such times as swill is stipulated by NHAI for future six lining or any other development.
17. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby undertake that the existing avenue plantation is not affect due to the present proposed erection of Permission for Erection of 22KV Overhead Electrical Power

For GAUTAM POWER GENERATION PRIVATE LIMITED

X


Managing Director

Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.

18. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby undertake that the existing avenue plantation is not affect due to the present proposed erection of Permission for Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu.
19. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby undertake to erection of electrical supply line will not have any deleterious effects on any of the bridge components and road way safety for traffic.
20. We agree indemnity against all damages and claims clause XXIV
21. We are confirming the standard conditions of NHAI's Guidelines.
22. We shall be responsible for shifting of the electrical line as and when required by NHAI at their own cost.
23. We shall undertake the Vertical clearance is 12.5 meter from FRL (Finished Road Level).
24. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby undertake that the pay the fee/rent as mentioned in the Ministry's Guidelines Lr. No. RW/NH-33044/29/2015S&R/ dated 22.11.2016 as and when asked by NHAI.
25. We the Managing Director, M/s. GAUTAM POWER GENERATION PRIVATE LIMITED, Pudukkottai hereby undertake that the crossing of all cross roads at grade separators, at grade junctions and wherever required and in the buildup areas as per the instructions of NHAI officials.
26. Lr. No. RW/NH- 34044/27/2005-S&R dated 21.09.2016 as and when asked by NHAI. Reference circular issued by Ministry of Road Transport & Highways, GOI, Circular No. Lr. No. RW/NH-III-34044/27/2005-S&R dated 26.11.2016. Where in, the last paragraph that "The Highway Administration Rules 2004 will be modified according this circular will come in to effect from the date of notification of the modified "Highway Administrative Rule".

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

So, we hereby give our consent to abide by the content of this circular from the date of its notification by MoRT&H, GOI and agree to pay the ground rent any other charges applicable for the section as applied by us.

For GAUTAM POWER GENERATION PRIVATE LIMITED

x


Managing Director

For the M/s. GAUTAM POWER GENERATION
PRIVATE LIMITED, Pudukkottai.

TAMILNADU GREEN ENERGY CORPORATION LIMITED

From
Er. R.K.Vinothan B.E., M.I.E.,
Chief Engineer/NCES,
TNGECL,
2nd Floor, Eastern Wing,
144, Anna Salai,
Chennai – 2.

To
✓ M/s. Gautam Power Generation Private Limited,
104, Chales Nagar,
Pudukottai – 622 005.
E.Mail Id : mmurugesar170171@gmail.com

Lr.No.CE/NCES/L23/F. M/s.Gautam Power Generation Private Limited – 10MW/D.No 2596
/2024, dated 05.09.2024.

Dear Sirs,

Sub : NCES - M/s. Gautam Power Generation Private Limited - Reg.No 358(T) 23-24 dated 30.01.2024 - Establishment of 10MW solar PV power plant at Pudukottai Sipcot, Pudukottai District for Captive use under Non-REC Scheme – Communication of Load flow study results - Reg

Ref:

1. Reg.No 358(T) 23-24 dated 30.01.2024
- 2.Hon'ble TNERC Order No.9 of 2020 dt 16.10.2020.
- 3.B.P. No. 34 dated 17.02.2021.
4. Letter dated received on 15.12.2023 from M/s. Gautam Power Generation Private Limited
- 5, Lr.No. CE/NCES/L11/F.M/s. Gautam Power Generation Private Limited– 10MW/ D.No. 378/2023 dated 30.01.2024..
- 6.Lr.No:SE/NCES/TIN/AEE/AE/Tech/F.Gautam/D.No.366/24 dated 20.02.2024.
7. U.O. No. CE/Plg& RC/SE/SS/EE – II/AEE1/F. Study 01 (24-25)D.80/2024 dated 12.01.2024.

With reference to your proposal received vide ref (4) above and in continuation to correspondence vide ref (6) above, load flow study has been conducted for the 10MW SPV Plant proposed by you for wheeling of power to Captive use under Non-REC Scheme under Intra State Open Access System and registered Reg.No 358(T) 23-24 dated 30.01.2024 and the result is as follows:

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

53

Page 1 of 5

Load flow study has been conducted by considering 2024-2025 network condition to determine the transmission system for the connectivity and evacuation of power from your proposed solar power Plant and the following parameters have been taken into consideration :

| | | | | |
|--|---|--|---|-------------|
| Name of the Substation | : | 110/33-22KV Pudukottai Sipcot Sub- Station | | |
| Power Transformer capacity in 110/33-22KV Pudukottai Sipcot Sub- Station | : | Pr.Tr.-I 16MVA (110/22KV) = 16MVA Pr.Tr.-II 16MVA (110/22KV) = 16MVA Pr.Tr.-III 16MVA (110/33KV) = 16MVA Pr.Tr.- IV 16MVA (110/33KV) = 16MVA Total = 64 MVA Existing Generation Load = 20.1MW Already Proposed = 10MW Now Proposed = 10MW Total = 40.1MW | | |
| Proposed SPP is to be connected at 110/33-22KV Pudukottai Sipcot Sub- Station in 16MVA Power Transformer – I, at 22KV side. | : | Existing Generation Load | : | Nil |
| | | Already Proposed | : | Nil |
| | | Now Proposed | : | 10MW |
| | | Total | : | 10MW |

Based on the above parameters, load flow study was conducted and the line loading and Power Transformer loading are found to be normal, the following transmission scheme has been finalized :

"Your proposed 10MW solar power plant can be interfaced through newly Proposed 22KV Solar Feeder which are to be connected at **110/33-22KV Pudukottai Sipcot Sub-Station** at 22KV Level with necessary breaker and protection arrangement".

As per Section 10(1) of Electricity Act, 2003, you have to establish, operate and maintain the dedicated transmission line from the power plant to substation.

The applicable O&M charges for 22KV would be intimated separately, and is subject to revision. As DSM is implemented, the generation details shall be made available at **110/33-22KV Pudukottai Sipcot Sub- Station** through data connectivity.

For GANTAM POWER GENERATION PRIVATE LIMITED


Managing Director

Further M/s. Gautam Power Generation Private Limited has to provide the following at their cost:

1. Breakers and necessary protection arrangement at your plant Switchyard end as per TANGEDCO norms.
2. ABT meters for recording your supply as per CERC/TNERC Regulations in force.
3. Cost towards provision of data as Ethernet data at Jurisdiction LD centre (JLDC) end either by VSAT or any other communication.
4. For data connectivity to jurisdiction LD centre you have to pay Rs 2,00,000/-+ GST Rs.36,000/- (Rupees Two Lakhs and Thirty six thousand only) to TANTRANSCO towards terminal equipment to be provided by TNEB at JLDC
5. The speech communication to adjacent stations can be provided either by land line or PLCC depending on the infrastructure available at the premises.

In view of the above, you are requested to execute an Undertaking to the effect that you shall not claim any compensation or responsibility for any unforeseen outage or scheduled maintenance outage of **110/33-22KV Pudukottai Sipcot Sub- Station**

You are also requested to ensure that Harmonics are maintained within the prescribed limit as per the CEA norms to maintain the grid discipline. **The Harmonic study shall be conducted within two months for taking necessary action to limit the level of Harmonics as per CEA norms.** The SPV plant generator has to maintain power factor at their plant end as per IEGC.

You have already made payment for an amount of Rs. 50,00,000/- (Rupees Fifty Lakhs only) towards 50% of the applicable refundable security deposit vide **Doc.No. 2350867660** dated 23.01.2024 at the time of Registration.

In order to consider the proposal further, you are requested to furnish the following documents within one month from the date of issue of this communication. Further, it may be noted that failure to submit the documents within one month, further time extension upto 3 months from the date of communication of load flow study result would be permitted subject to deduction of 10% of Security Deposit paid for every one month delay or part thereof. No further extension of time period will be permitted and the reserved power evacuation facility in the respective SS will be automatically cancelled with/without any notice or information whatsoever.

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

55

It is requested to submit the following documents:

I - For verification of CGP status:

1. Intra State Open Access application Form.
2. Certificate of Incorporation of the generating company.
3. A certificate issued by the Chartered Accountant who signs the annual financial statement of the company /practicing Company Secretary who files the annual return of the Company providing details of Total equity, Authorised, Issued, Subscribed and Paid up equity share capital with voting rights in the Captive Generating Plant by the captive user.
4. Certified copy of MoA /AoA and its amendments issued from time to time.
5. Copy of Latest Annual Return – MGT7 filed by the generators with the registrar of Companies showing shareholding details filed by the generators/captive users with the Registrar of Companies.
6. A copy of Board's Resolution authorizing the signatory of the company .The Authorized signatory of the company shall be the Managing Director or whole time director or company secretary or any other officer approved by the Board.
7. Any revocation for approval for captive generation by the Board of the generating company by way of amendment to MoA or AoA shall be intimated 30 days from the date of such change to the Licensee.
8. H.T. Service Connection Detail/H.T.Bill Copy along with Open Access Application.

II - Project Documents:

1. Copy of land document duly attested by Notary Public (Registered sale Deed or lease deed)
2. Detailed Project Report.
3. General Layout of the proposed power plant.
4. Village map and topo sketch.
5. H.T.Bill Copy of the Service for which captive adjustment is sought for.

The due date for commissioning your project shall be within 12 months from the date of issuance of Noted on Record letter. In case of failure to commission the plant as above, further extension of time period of upto 4 months shall be permitted with a penalty of 20% of total SD amount paid for every one month delay or part thereof. In case of failure to commission the project Within 16 months, security deposit paid by you will be completely forfeited and this 'Noted for Record' letter shall stand automatically cancelled without any further notice or information whatsoever. In addition to forfeiture of the security deposit,

For GANTAM POWER GENERATION PRIVATE LIMITED

56


Managing Director

the noted on record letter shall stand automatically cancelled with/without any notice or information whatsoever.

The operation and maintenance of the newly erected equipment in the SS related to the project would be intimated separately.

In this regard, it is to be informed that further action will be taken by TNGECL subject to fulfillment of the above said terms

Yours Sincerely,


Superintending Engineer/Solar
for Chief Engineer/NCES 4/4

Copy to the Superintending Engineer/Pudukottai/EDC.
Copy to the Superintending Engineer/NCES/Tirunelveli.


For GAUTAM POWER GENERATION PRIVATE LIMITED

X


Managing Director



CROSS SECTION SHOWING THE PROPOSED 22KV OVERHEAD TRANSMISSION LINE FOR PUDUKKOTTAI SIPCOT SUBSTATION BY M/S. GAUTAM POWER GENERATION PRIVATE LIMITED CROSSING AT KM. 43/400 OF NH-336 (OLD NH-210) IN TRICHY TO PUDUKKOTTAI SECTION IN STATE OF TAMIL NADU

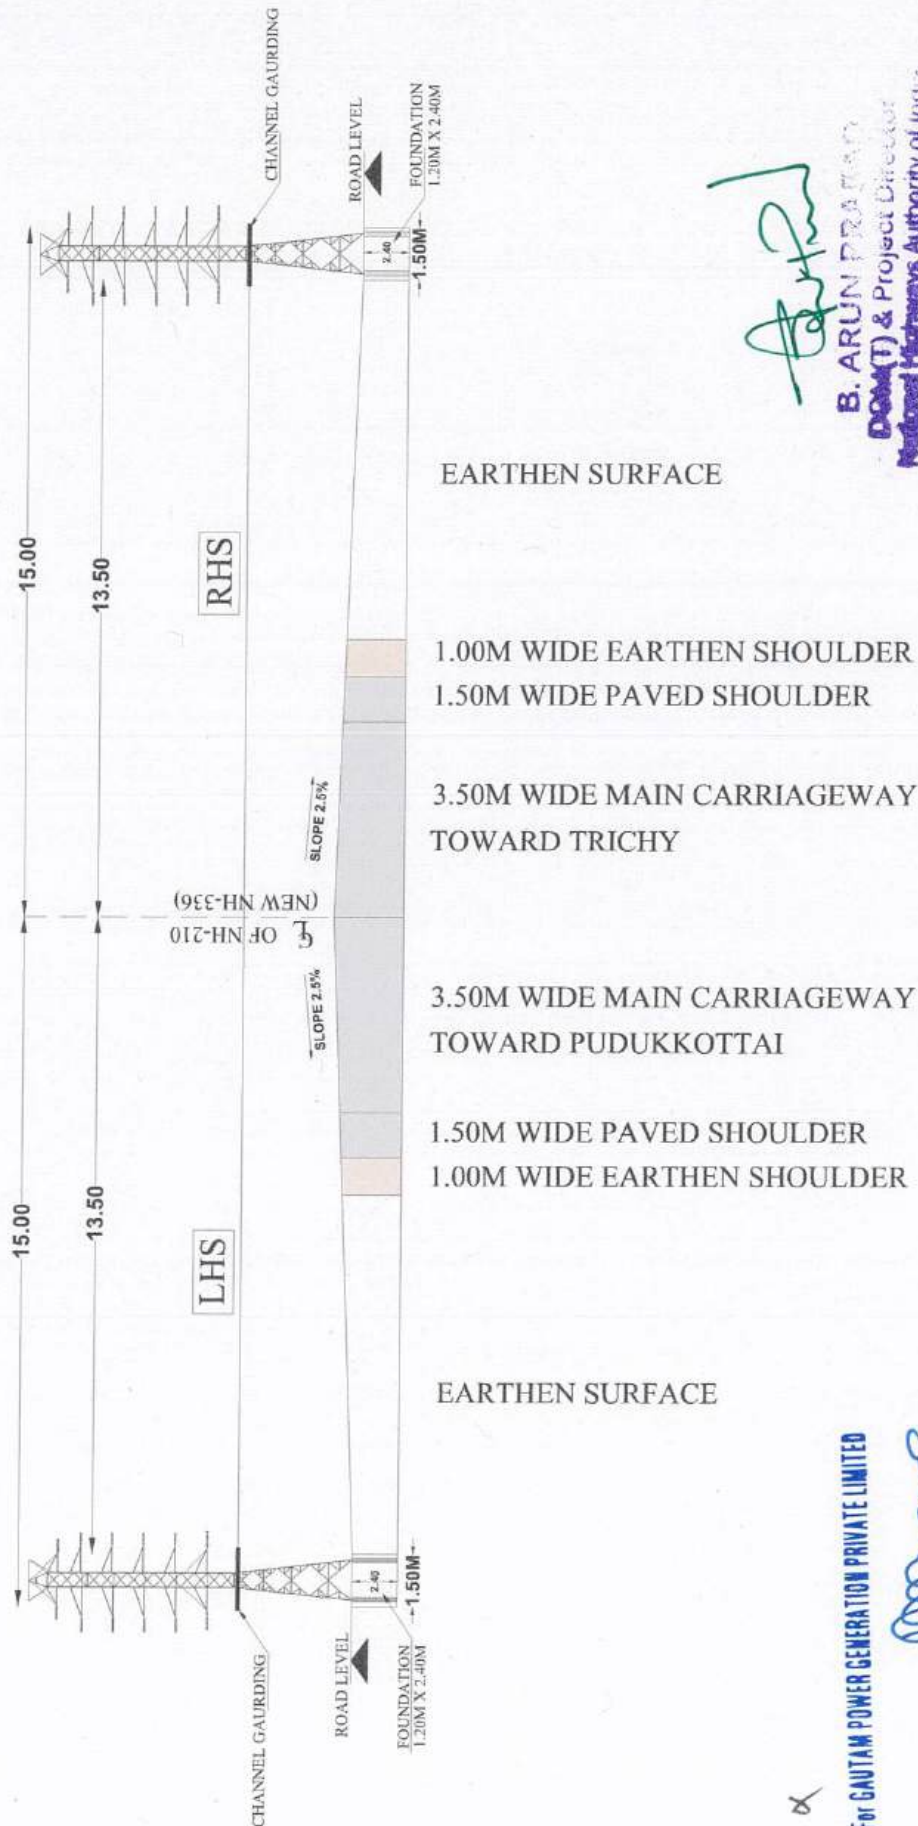

For GAUTAM POWER GENERATION PRIVATE LIMITED


Managing Director

B. ARUN PRASAD
DDM(T) & Project Director
National Highways Authority of India
PIU - KARAIKUDI

ALL DIMENSIONS ARE IN "M"

SCALE : NOT TO SCALE

HOT DIPPED GALVANIZED STEEL MULTI PURPOSE TOWER TRANSMISSION LINE CROSSING CLEARANCE DETAILS ACROSS THE ROAD

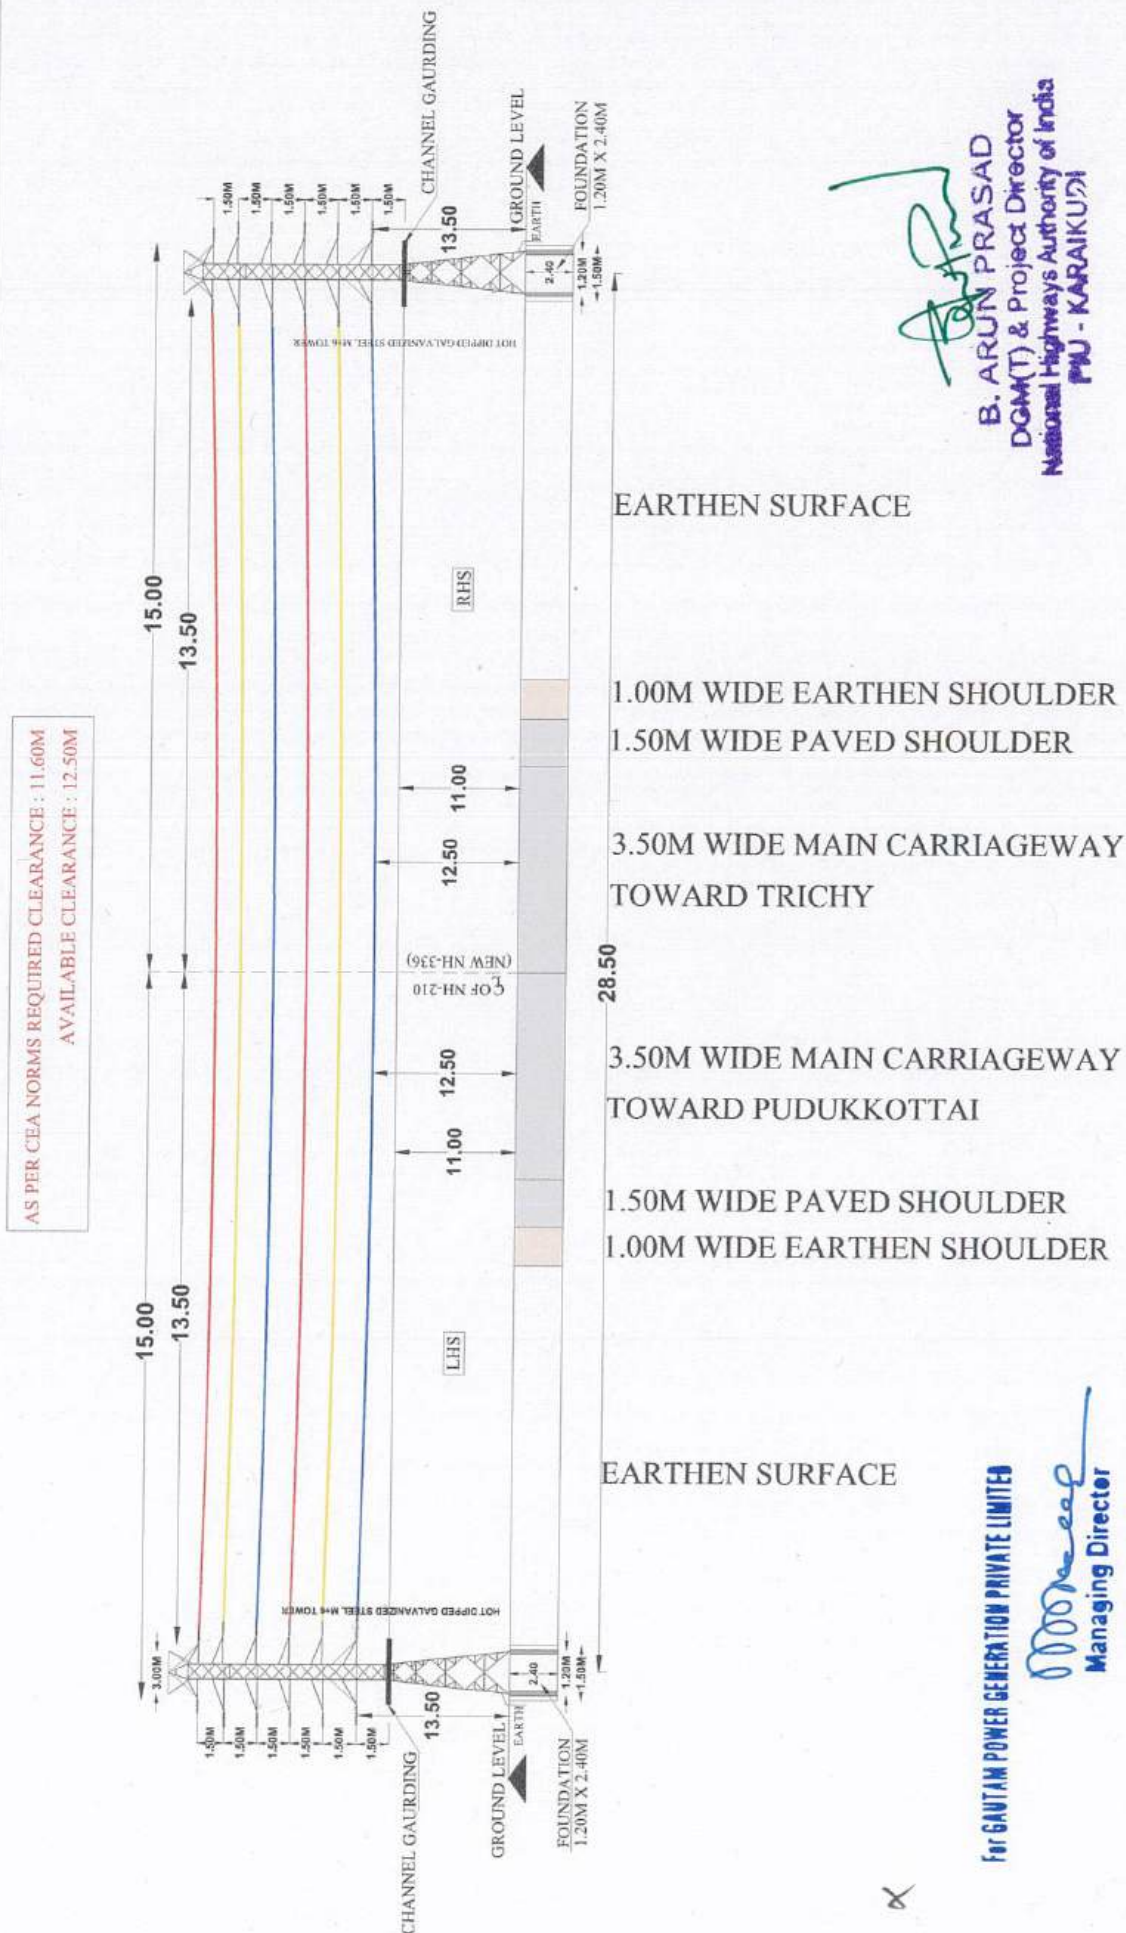

B. ARUN PRASAD
DGM(T) & Project Director
National Highways Authority of India
PIU - KARAIKUDI

ALL DIMENSIONS ARE IN "M"

CROSSING AT KM. 43/400

SCALE : NOT TO SCALE

District : Pudukkottai

Survey No : 36

Taluk : Pudukkottai


Area : Hect 03 Ares 54.50

Village : Nathampannai [11]

Scale : 1 : 5576

**KULATHUR TALUK**

Thiruchappalli 46.4 K. M.

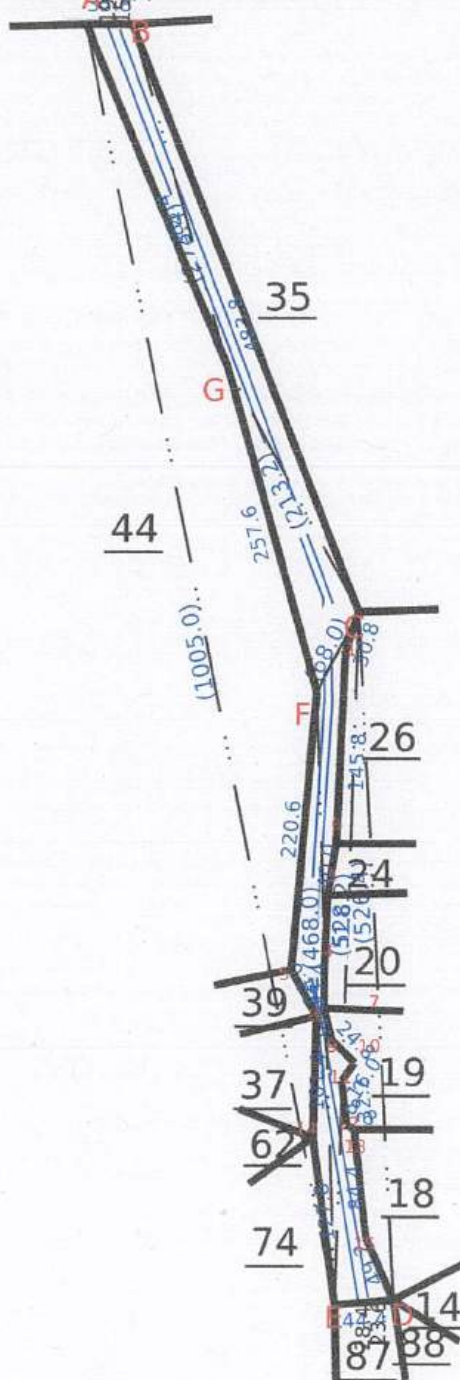

For GAUTAM POWER GENERATION PRIVATE LIMITED

Managing Director

Signed By Tahsildar

Name of approver : stam

Date of Approval : 12-01-2018



Date of Issue: 07-01-2025 15:26:22

அ-பதிவேடு விவரங்கள்

மாவட்டம் :Pudukkottai(22)

வட்டம் :Pudukkottai(01)

இராணம் :Nathampennai(011)

| | | | |
|---------------------------|-------------|-----------------------------|---------|
| 1. புல எண் | 36 | 9. மண் வயனமும் ரகமும் | 0-0 |
| 2. உட்பிரிவு எண் | - | 10. மண் தரம் | 0 |
| 3. பழைய புல உட்பிரிவு எண் | 36 | 11. தீர்வை (ரூ - ஹெ) | 0.0 |
| 4. பகுதி | - | 12. பரப்பு (ஹெக்டேர் - ஏர்) | 3-54.50 |
| 5. அரசு / ரயத்துவாரி | அரசு | 13. மொத்த தீர்வை (ரூ - பை) | 0.0 |
| 6. நிலத்தின் வகை | புறம்போக்கு | 14. பட்டா எண் | 0 |
| 7. பாசன ஆதாரம் | - | 15. குறிப்பு | - |
| 8. இரு போகமா | இல்லை | 16. பெயர் | - |

குறிப்பு 1:



மேற்கண்ட தகவல் / சான்றிதழ் நகல் விவரங்கள் மின் பதிவேட்டிலிருந்து பெறப்பட்டவை. இவற்றை தாங்கள் <https://clip.tn.gov.in/clip> தளத்தில் உறுதி செய்துகொள்ளவும்.

1. ஆவண விவரங்களை மேலும் உறுதி செய்துக்கொள்ள வேண்டுமெனில் தாங்கள் வட்டாட்சியர் அலுவலகத்தை அணுகி உறுதிப்படுத்தலாம்.

Further Certificate confirmation and details, you may approach Tahsildar concerned.

Print

For GAUTAM POWER GENERATION PRIVATE LIMITED

X

Managing Director

Resize Text



Reset

Screen Reader



பதிவுத்துறை

REGISTRATION DEPARTMENT

TAMIL NADU

For Complaints and
Clarifications, please
contact:

9498452110 /

9498452120 /

9498452130

(Monday to Friday 10 AM
to 5.45 PM, excluding
Government holidays)For queries related to
software, please
contact:

1800 102 5174

(Monday to Friday 8 AM to
8 PM, Saturday 10 AM to 5
PM excluding Government
holidays)

The information provided Online is updated and no physical visit is required for the Services provided Online.

Home

About us

Registration

E-Services

Circulars

Guideline Value

Sitemap

Help

GUIDELINE VALUE & PROPERTY VALUATION

Guideline Value relating to 2.19 lakhs streets and over 4.46 Crores Survey Numbers/Subdivision numbers are available on this site for query.

For Property Valuation, Click on the Street Name from the Street List, where the property is located.

From: 1-7-2024 To: Current Date [To know your Zone and District Click Here](#)

View Guideline value for:

☐ Street ☒ Survey Number ☐
Composite Value

Select Criteria :

☐ Category Wise ☒ Survey Number
Wise

Zone:*

Trichy

Sub Registrar Office:*

Pudukkottai Joint I

Registration Village:*

9A NATHAMPANNAI

Survey Number:*

44

For GAUTAM POWER GENERATION PRIVATE LIMITED

Managing Director

Search

Reset

Search Criteria :

| | | | |
|--------------------|-----------------|-----------------------|---------------------|
| Zone: | TRICHY | Sub Registrar Office: | PUDUKKOTTAI JOINT I |
| Guideline Village: | 9A NATHAMPANNAI | Revenue Village: | NATHAMPANNAI |
| Revenue District: | PUDUKKOTTAI | Revenue Taluka: | PUDUKKOTTAI |

Below Search results are as on 08-Jan-2025 04:23 PM

4 items found, displaying all items.

1

| Sr.No. | Survey/Subdivision No. | Guideline Value (₹) (British Value) | Guideline Value (₹) (Metric Value) | Land Classification | Effective Start Date | G.O.Download |
|--------|------------------------|-------------------------------------|------------------------------------|--------------------------------|----------------------|--------------|
| 1 | <u>44/1</u> | 330/ Square Feet | 3555/ Square Metre | Residential Class III Type - I | 01-Jul-2024 | - |
| 2 | <u>44/12</u> | 330/ Square Feet | 3555/ Square Metre | Residential Class III Type - I | 25-Sep-2024 | - |
| 3 | <u>44/2</u> | 330/ Square Feet | 3555/ Square Metre | Residential Class III Type - I | 01-Jul-2024 | - |
| 4 | <u>44/3</u> | 330/ Square Feet | 3555/ Square Metre | Residential Class III Type - I | 01-Jul-2024 | - |

X For GAUTAM POWER GENERATION PRIVATE LIMITED

Go Back To Main Menu

Online Services

Managing Director

Encumbrance Certificate

Search

Stamp Vendor

Search/View EC

Society

Chit Funds

Marriage

Birth and Death

Firm

Duty and Fees

Duty and Fees

Reference

[Resize Text](#) - [+](#) [Reset](#)
[Screen Reader](#)

பதிவுத்துறை
REGISTRATION DEPARTMENT



For Complaints and
Clarifications, please
contact:

9498452110 /

9498452120 /

9498452130

(Monday to Friday 10 AM
to 5.45 PM, excluding
Government holidays)

For queries related to
software, please
contact:

1800 102 5174

(Monday to Friday 8 AM
to 8 PM, Saturday 10 AM
to 5 PM excluding
Government holidays)

The information provided Online is updated and no physical visit is required for the Services provided Online.

[Home](#)[About us](#)[Registration](#)[E-Services](#)[Circulars](#)[Guideline Value](#)[Sitemap](#)[Help](#)[More](#)

GUIDELINE VALUE & PROPERTY VALUATION

Guideline Value relating to 2.19 lakhs streets and over 4.46 Crores Survey Numbers/Subdivision numbers are available on this site for query.

For Property Valuation, Click on the Street Name from the Street List, where the property is located.

From: 1-7-2024 **To:** Current Date

Search Criteria :

| | | | |
|---------------------------|-----------------|------------------------------|---------------------|
| Zone: | Trichy | Sub Registrar Office: | Pudukkottai Joint I |
| Guideline Village: | 9A NATHAMPANNAI | Revenue Village: | NATHAMPANNAI |
| Revenue District: | PUDUKKOTTAI | Revenue Taluka: | PUDUKKOTTAI |

Below Search results are as on 28-Jan-2025 02:46 PM

[A](#) [B](#) [C](#) [D](#) [E](#) [F](#) [G](#) [H](#) [I](#) [J](#) [K](#) [L](#) [M](#) [N](#) [O](#) [P](#) [Q](#) [R](#) [S](#) [T](#) [U](#)
[V](#) [W](#) [X](#) [Y](#) [Z](#) [1](#) [2](#) [3](#) [4](#) [5](#) [6](#) [7](#) [8](#) [9](#) [0](#)

2 items found, displaying all items.

1

| Sr.No. | Street Name | Guideline Value (₹) (British Value) | Guideline Value (₹) (Metric Value) | Land Classification | Effective Start Date | G.O.Download |
|--------|-------------------|-------------------------------------|------------------------------------|-----------------------------------|----------------------|--------------|
| 1 | <u>M.J.NAGAR</u> | 330/ Square Feet | 3555/ Square Metre | Residential Class III Type - I | 01-Jul-2024 | - |
| 2 | <u>RASI NAGAR</u> | 455/ Square Feet | 4900/ Square Metre | Residential Special Type - II | 01-Jul-2024 | - |

Go Back To Main Menu

Online Services

Encumbrance Certificate

Search

- Stamp Vendor
- Search/View EC
- Society
- Chit Funds
- Marriage
- Birth and Death
- Firm

Duty and Fees

Duty and Fees

Reference

- Citizen Charter
- Tell me How
- User Manual

Download

- Utility Forms
- Circulars
- Latha Font
- Typewriter Interface Tool
- Typewriter Interface Manual
- Rupee Symbol
- Cyber Security Awareness
- Safe and Ethical AI
- TamilNadu Blockchain Policy
- Cyber Security Policy

External Links

- National Portal
- Cyber Resilience
- Cyber Security Incident Reporting
- Electronic/Digital Signature facility



L.N.MALVIYA INFRA PROJECTS PVT.LTD.

Office : No.30, 2nd Kannadhasan Street, Karaikudi - 630 002.
Sivagangai District, Tamil Nadu.

CIN NO. : U45201DL2010PTC373715

E- mail : trichy2karaikudionm@gmail.com | web.:www.lninfra.com

No. LNMIPPL/PO/PD/NHAI/T-K/2024-25/30

Date:18.01.2025

To,
The Project Director,
Project Implementation Unit,
National Highway Authority of India,
No.1, 2nd Floor, Subramaniapuram 3rd Street,
Karaikudi – 630 002,
Tamilnadu.

Sub: Consultancy services for Operation and maintenance of Trichy Bypass on NH-83 (Old-67) from KM 110.016 to KM 135.930; on Trichy – Pudukottai on NH-336 (Old-210) from KM 10.000 to KM 43.600; Pudukottai – Thirumayam on NH-36 (Old-210) from KM 43.600 to KM 66.000 Thirumayam – Karaikudi - Ramanathapuram on NH-536 (Old-210) from KM 66.000 to KM 174.000 in the state of Tamilnadu –
Requesting permission towards the Erection of 22KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy - Pudukkottai Section of NH-336 (Old NH-210) in the state of Tamil Nadu- reg

Ref: 1 .NHAI PIU Letter no:11035/31/2025-PIU-KKDI/34 dated:13.01.2025.

Dear Sir,

With reference to the above subject vide reference no. 1 the applicant, M/s.Gautam Power Generation Private Limited, Pudukottai has requested the Project Director, NHAI,PIU Karaikudi to seeking permission for the Erection of 22 KV Overhead Electrical Power Transmission Line crossing (across) at Km. 43/400 in Trichy – Pudukottai Section of NH – 336 (Old NH – 210).

In this regard the Authority Engineer has inspected the Site and examined the proposal in accordance with MoRTH guidelines No. RW/NH-33044/29/2015-S&R-(R) dated:22.11.2016.

Below are our observations and recommendations:

Location of Electrical Utility: The proposed electrical utility service is positioned at the extreme edge of the Right of Way (RoW), which complies with the MORTH guidelines. The overhead crossing is located 15 meters from the road center on both sides, ensuring it meets safety standards.

Vertical Clearance: The vertical clearance from the Finished Road Level (FRL) is 12.50 meters, which meets the required road crossing clearance. This clearance has been verified to be safe and in accordance with the applicable standards.


Channel Guarding: The proposed channel guarding is positioned at 11.0 meters from the FRL, ensuring safety and preventing conductor electrification. This measure has been reviewed and is deemed safe.

Considering the above findings that meet the vertical and horizontal clearance requirements outlined in IRC-32, we suggest granting permission to M/s Gautham Power Private Ltd to proceed with the proposed crossing."

Submitted for kind perusal and further necessary action.

Thanking you and assuring you of our best service.

Yours Sincerely
For M/S L.N Malviya Infra Projects Pvt. Ltd.
In Association with Infratech Solutions & consultant



Resident Engineer
(P.Manimaran)