

भारत सरकार  
सडक परिवहन और राजमार्ग मंत्रालय  
क्षेत्रीय कार्यालय, भुवनेश्वर  
प्लॉट संख्या - 184 (फायर स्टेशन चौक के पास)  
बरमुन्डा, भुवनेश्वर-751003  
दूरभाष : (0674) 2960994 & 2952994  
ई-मेल : [robbsr.morth@gmail.com](mailto:robbsr.morth@gmail.com)



Government of India  
Ministry of Road Transport & Highways  
Regional Office, Bhubaneswar  
Plot No. - 184 (Near Fire Station Square)  
Baramunda, Bhubaneswar-751003  
Ph. No.: (0674) 2960994 & 2952994  
E-mail: [robbsr.morth@gmail.com](mailto:robbsr.morth@gmail.com)

File No. RO/BBSR/Utility Services/NH-57/BBSR/99/2025 - 2299

Date: 19<sup>th</sup> Feb, 2025

**Invitation of Public Comments**

Sub: Permission for erection of 33 KV new with laying of 33KV UG cable from Atri Grid (km 282/700) to Sarua (km 286/000) PSS under ODSSP Ph-IV scheme along NH-57 from Baghamari Chhak to Sarua Panchayat Office and crossing on NH-57 at km 285/300 by UG near Sarua Panchayat Office - reg.

1. Superintending Engineer, NH Division, Bhubaneswar vide letter dated 08.01.2025 has submitted a proposal on the above mentioned subject as detailed below:

Sl. No.	Chainage from km to km	Side of laying	Details of RoW	Carriageway width (m)	Dia of pipe (In mm)	Total length (km)	Methodology
1	282/700 to 285/300	RHS	14.0	7.0	200 mm	2.600	HDD
2	285/300 to 286/000	LHS	14.0	7.0		0.700	HDD
3	285/300	Crossing	14.00	10.0		-	HDD

2. As per Ministry's OM No. RW/NH-33044/29/2015/S&R(R) dated 22.11.2016, the Highway Administrator will put out the application in the public domain for 30 days for seeking claims and objections (on grounds of public inconvenience, safety and general public interest, if any).


3. In view of above, comments of public for claims/objections, if any, on the above proposal are invited online as well as in hard copy. The strip plan/location details are enclosed herewith. The same should reach to the below mentioned address within 30 days from the date of uploading it in the website, beyond which no objection will be considered.

**Address:**

Regional Officer,  
Ministry of Road Transport & Highways,  
Plot No -184, Infront of CRPF Stadium,  
Baramunda, Bhubaneswar - 751003.

Encl: As above

Yours faithfully,

  
(Sudhansu Sekhar Sahu)  
Senior Technical Assistant  
For Regional Officer

Copy to:

- 1) The Senior Technical Director, NIC, Transport Bhawan, New Delhi - 110001- along with strip chart for uploading on the Ministry's website.
- 2) General public with request to furnish comments, if any, to the above mentioned address or by e-mail to "[robbsr.morth@gmail.com](mailto:robbsr.morth@gmail.com)"





हायरी संख्या 2220  
 तारीख 09.01.2025  
 सड़क परिवहन और राजमार्ग मंत्रालय

TEL -0674-2972908-(0)  
 eenh\_bbsr@yahoo.co.in

Please examine  
 10/01

OFFICE OF THE EXECUTIVE ENGINEER  
 NATIONAL HIGHWAY DIVISION BHUBANESWAR  
 PLOT NO-184, NAYAPALLI, PO-BARAMUNDA, BHUBANESWAR

Sr. TA To

No. 310/ Dt. 8-1-2025

The Regional Officer  
 MoRT&H, Bhubaneswar

Sub: - Permission for Erection of 33KV new with laying of 33KV UG Cable 1R3C400 from 220/132/33KV Atri Grid (282/700km) to Sarua (286/00km) 33/11KV PSS under ODSSP Ph-IV Scheme parallel to N.H.57 from Baghamari Chhak to Sarua Panchayat office & crossing NH.57 at km 285/300 by UG near Sarua Panchayat office.

Ref: - This office memo no.9728 dt. 13.12.2024

Sir,

In inviting a reference to the subject cited above, it is to submit herewith the following documents as received from TPCODL, BBSR- II Circle, Bhubaneswar alongwith the site inspection report in the prescribed format duly signed in for favour of information and necessary approval.

1. The layout plan alongwith cross section drawing & methodology are enclosed.
2. A strip plan showing across with chainages and LHS/RHS of road NH-57 is enclosed.
3. A site inspection report in the prescribed proforma duly signed by the all concerned is enclosed.
4. The necessary estimate for performance B.G & Licence Fees alongwith Bench Mark value issued by the concerned Sub-Registrar are enclosed herewith.

Yours faithfully,

Encl: - As above

Memo No. 311 / Dt. 08-1-2025

Copy submitted to the C.E.N.Hs (O), Bhubaneswar/ C.C.E. Northern, NH Circle, Bhubaneswar for favour of kind information and necessary action.

Superintending Engineer  
 N.H. Division, Bhubaneswar

Memo No. 312 / Dt. 08-1-2025

Copy to the Asst. Executive Engineer, N.H Sub-Division, Khordha for information and necessary action.

Superintending Engineer  
 N.H. Division, Bhubaneswar

Memo No. 313 / Dt. 08-1-2025

Copy to the HOG- Projects BBSR-II Circle, Bhubaneswar (trupti.mohanty@tpcentralodisha.com) for information and necessary action with reference to his letter No.211 dt.12.12.2024.

Superintending Engineer  
 N.H. Division, Bhubaneswar

Superintending Engineer  
 N.H. Division, Bhubaneswar

**Encloser to site inspection report for laying of 200 mm HDPE pipe for 33 KV Line Crossing along and across the road at sarua bazar end NH 57**

sl.no	NH NO	NH changing from km to km	side of laying (Lsh /Rsh/crossing)	Available ROW	Carriageway width	Embankment	Dia of utility including casing	Methodology( OPEN TRENCH/HDD)	Depth of Laaying from Ground Level	Width of Trench
1	NH-57	285/300	CROSSING	14 MTR	10M	AVG 1 MTR	200MM	HDD	2000MM	
2		286/00 TO 285/300	ALONG THE ROAD LHS	14 MTR	7M	AVG 1 MTR	200MM	HDD	2000MM	
3		285/300 TO 282/700	ALONG THE ROAD RHS	14 MTR	7M	AVG 3 MTR	200MM	HDD	2000MM	


*[Signature]*  
02/01/25  
M. S. Sarda, Bhubaneswar

*[Signature]*  
21/1/25

*[Signature]*  
02/01/25  
Trupti Sundar Mohanty  
Team Lead (Projects)  
Mobile No. 7008366152  
Email: trupti.mohanty@psnirbhidisha.com


*[Signature]*  
8/1/25  
SuperIntending Engineer  
N.H Division, Bhubaneswar  
8/1/25



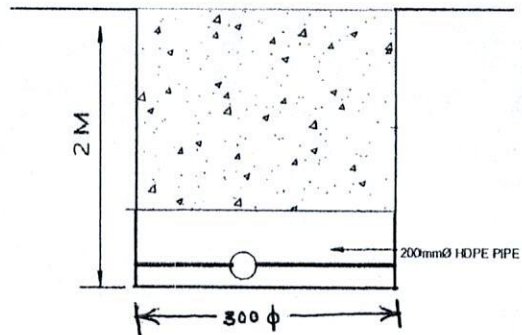

SECTION 1-1  
CROSS SECTION ON ALONG ROAD BY  
HDD METHOD AT SARUA BAGHMARI ROAD  
[CH. 285/300]

----- PROPOSED NH CROSSING  
GAP TO ALONG THE NH  
===== PIPE LINE LAID

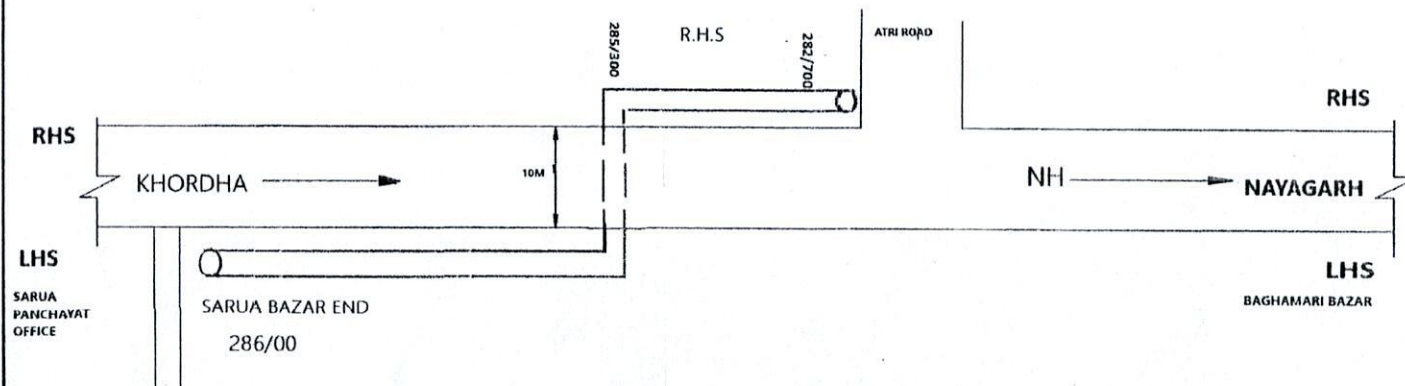

SUBMITTED BY :- JMC - 2018, 20

PROOF CHECKED BY :- M.H.H.T. ALLAHABAD, PRAYAGRAJ

APPROVED BY :- RURAL WATER SUPPLY & SANITATION, ODISHA

NOTES:  
1. ALL DIMENSIONS ARE IN M.


*Sanjay*  
02/07/25  
Project Engineer  
Rural Water Supply & Sanitation  
District Office, Nayagarh  
Phone No. 983661432  
Email: sanjay.pedra@nic.in

ID	PROJECT NAME	DATE	STATUS	REMARKS
1	TP Central Odisha Distribution Limited (TPC OD)			
2	TPC OD			
3	TPC OD			
4	TPC OD			
5	TPC OD			
6	TPC OD			
7	TPC OD			
8	TPC OD			
9	TPC OD			
10	TPC OD			

*Sanjay*  
02/07/25  
Project Engineer  
Rural Water Supply & Sanitation  
District Office, Nayagarh  
Phone No. 983661432  
Email: sanjay.pedra@nic.in

*Sanjay*  
02/07/25  
Project Engineer  
Rural Water Supply & Sanitation  
District Office, Nayagarh  
Phone No. 983661432  
Email: sanjay.pedra@nic.in

# STRIP ROAD MAP ALONG AND ACROSS THE NH-57

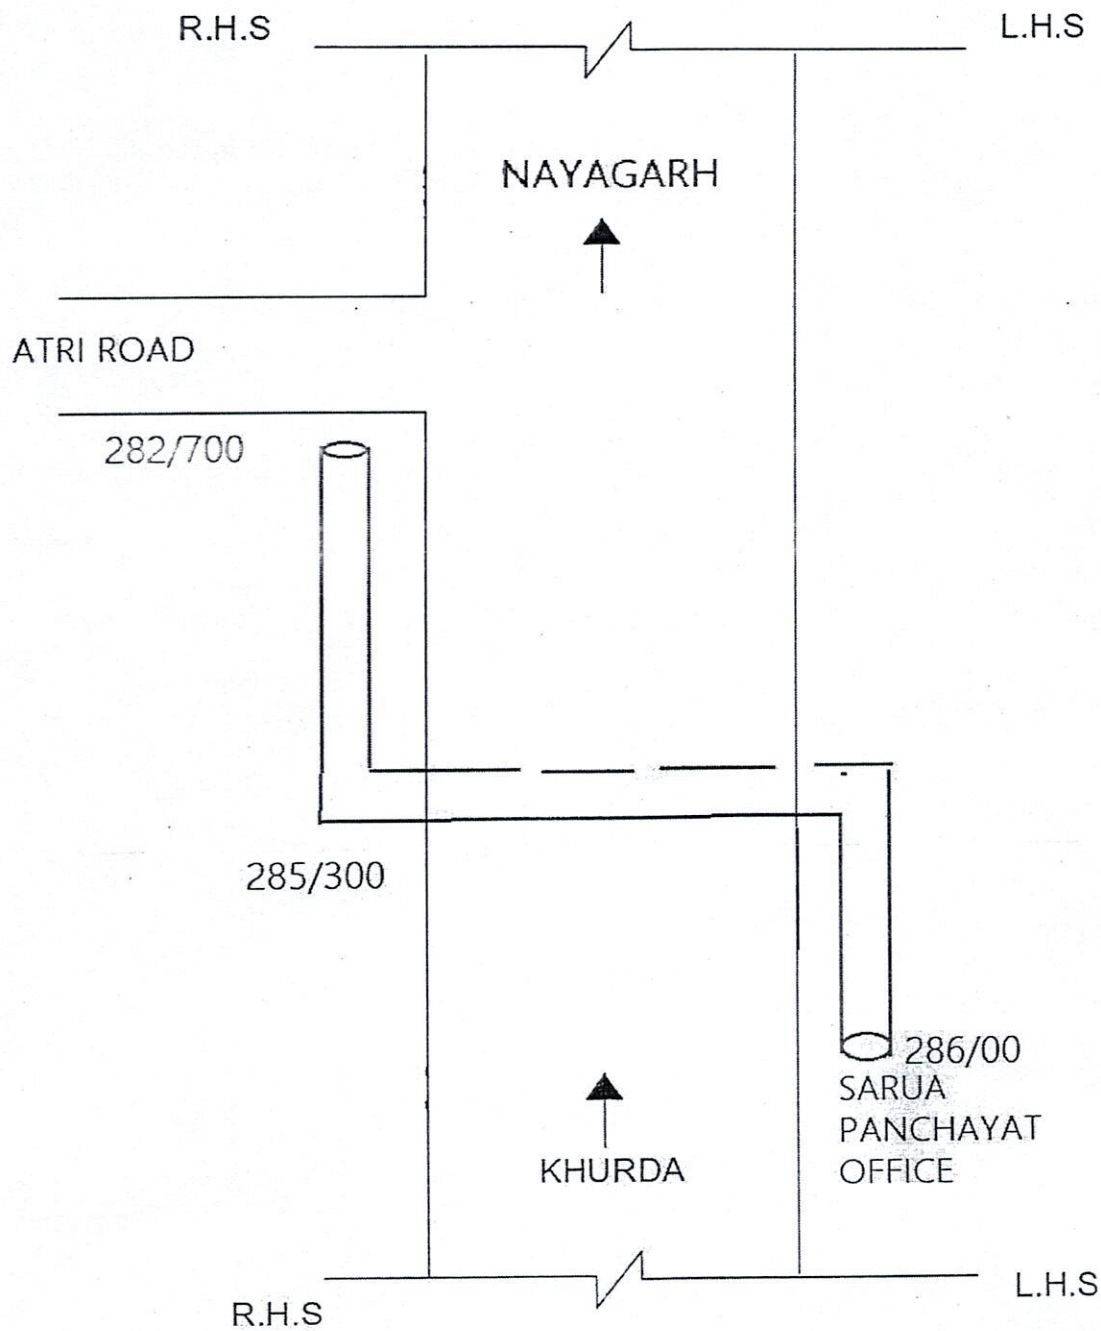

*[Signature]*  
02/01/25


*[Signature]*  
21/25


*[Signature]*  
21/25


Calculation for Performance Bank Guarentee as per utilized  
area of NH-57.(33 kv UG Cable at Sarua to Baghamari  
Panchayat office)

Sl No.	Pipe Dia (mm)	Length	Rate	Amount
1	200	15	100	1500.00
2	200	1000	100	100000.00
3	200	1000	100	100000.00
4	200	1300	100	130000.00
			TOTAL	331500.00

As per guidelines of Ministry circular on 22.11.2016,performance bank guarentee based on route meter valid 01 year initially as per rate Rs 100/mt for dia < 300mm and Rs 250/mt for dia > 300mm nipe.


  
Junior Engineer  
NH Section,Khordha


  
Assistant Executive Engineer  
NH Sub Division,Khordha


  
Superintending Engineer  
NH Division,Bhubaneswar



Calculation of License Fees ( 33 kv UG Cable at Sarua to Baghamari Panchayat office)											
Sl no	Block	Mouza	NH	Chainage	Length( mt)	Width/ Dia	Utilised NH land Area (Sqm)	Circle Rate(Acre)	Circle Rate(sqm)	License fee/annum (1.5%)	License fee/5 Year
1	Begunia	sarua	57	285/300 (crossing 15mt)	15	0.3	4.5	8265000	2042.254	137.852	689.261
2	Begunia	sarua	57	286/000 to 285/000 (LHS)	1000	0.3	300	8265000	2042.254	9190.141	45950.704
3	Begunia	Lokanathpur	57	285/000 to 284/000 (RHS)	1000	0.3	300	8250000	2038.547	9173.462	45867.309
4	Begunia	Baghamari	57	284/000 to 282/700 (RHS)	1300	0.3	390	7162400	1769.805	10353.358	51766.790
										28854.813	144274.064
										Say as	144274.000

  
 Junior Engineer  
 NH Section, Khordha

  
 Assistant Executive Engineer  
 NH Sub Division, Khordha

  
 Superintending Engineer  
 NH Division, Bhubaneswar



# OFFICE OF THE SUB-REGISTRAR, KHORDHA

E-mail: sr.khordha@gmail.com  
Phone: 06755-221920/220212

Letter No. 18

Date 03/01/2025

To,

Trupti Sundar Mohanty,  
HOG-Projects,  
BBSR-II Circle

Sub: Supply of Bench Mark Valuation of Mouza - Sarua, Lokanathpur & Baghamari.


Ref: Your Letter No-24-25/82 dated 02.01.2025

Sir,

With reference to the subject cited above, I am to furnish herewith the present Govt. Benchmark Valuation of Mouza - Sarua, Lokanathpur & Baghamari for your information for the year 2024-26 w.e.f 01.04.2024.

Village/Mouza	Sarua-50	Lokanathpur-51	Baghamari-52
<b>Khata No.</b>	NM	NM	NM
<b>Plot No.</b>	NM	NM	NM
<b>Category</b>	Highest BenchMark Valuation	Highest BenchMark Valuation	Highest BenchMark Valuation
<b>(BenchMark Valuation) per Acre</b>	Rs.82,65,000/- (Eighty Two Lakh Sixty Five Thousand) only	Rs.82,50,000/- (Eighty Two Lakh Fifty Thousand) only	Rs.71,62,400/- (Seventy One Lakh Sixty Two Thousand Four Hundred) only

Yours Faithfully

  
Sub-Registrar,  
Khordha




# TPCODL

Letter No: TPCODL/BBSR2/24-25/ 211

Date-12.12.24

To  
The Executive Engineer,  
NH Division  
Plot NO. -184, Nayapalli,  
Bhubaneswar

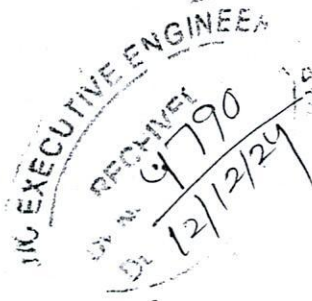

**Sub - Regarding Permission for Erection of 33 KV new with Laying of 33 kv UG Cable 1R\*3c\*400 from 220/132/33 kv Atri Grid to Sarua 33/11 kv PSS under ODSSP PH-IV SCHEME parallel to NH 57 from BAGHAMARI Chawk to Sarua Panchayat Office and crossing NH 57 by UG with 1R\*3c\*400 at near Sarua Panchayat Office.**

Dear Sir,

With reference to the above mentioned subject, we would like to intimate you that a proposal for **33 kv UG Cable 1R\*3c\*400 from 220/132/33 kv Atri Grid to Sarua 33/11 kv PSS under ODSSP-PH-IV SCHEME** from Atri 220/132/33 KV Grid to Sarua 33/11 kv PSS parallel way to NH 57 from Baghamari Chawk to Sarua Panchayat Office and crossing of NH 57 at near Sarua Panchayat Office has been approved under ODSSP PH-IV to mitigate the low voltage issue and provide reliable power supply in Sarua area.

Hence, It is requested to kindly grant your permission to start the execution of work in above mentioned route for improvement in reliability of power supply in Sarua area.

An early action in this regards will be highly solicited.

Thanks & Regards,

  
HOG-Projects

BBSR II Circle

Mob-7008366152

Email- trupti.mohanty@tpcentralodisha.com


*Estt (stock)*  
*Pl verify & intup*  
*[Signature]*

C.C:

1. Assistant Executive Engineer, NH Sub Division, Khordha
2. Circle Head, TPCODL, BBSR-2
3. Head Projects, TPCODL, BBSR-2, Paradeep & NED
4. Executive Engineer, TPCODL, Khordha

*28/12*  
*24/12*

33KV UG CABLE LAYING SARUA PSS TO BAGHMARI 3.5KM

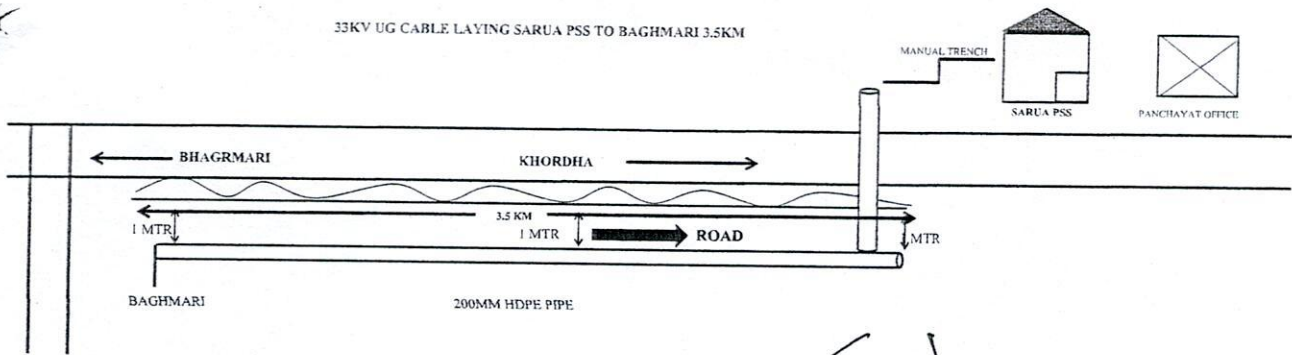

*Sushant*  
12/12/24  
Project Engineer  
Sarua PSS  
Baghmari  
3.5 KM  
200MM HDPE PIPE