



Government of India
Ministry of Road Transport & Highways
Office of the Regional Officer

No. 32, 2nd Floor, KSCFL Building, Race Course Road, BENGALURU-560 001
Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No.RW/BNG/ PER.CASES/BNG DVN/2021-22

Dated: 29.02.2024

Notice inviting Public Comments on the Proposal for crossing & laying of underground cable of 66KV-3 Row X 1C X 240 sqmn (66KV HTUG) from Pandavapura Railway Station to MUSS substation, Pandavapura by open trench method from Km:599.507 to Km:601.400 crossing at Km:601.400 by HDD Method and crossing at Km: 601.900 by open trench method below the existing Railway Over Bridge (ROB) on NH-150A Jevargi - Chamaraanagar Section in the State of Karnataka submitted by the MRN Cane power and BIO-Refineries Pvt Ltd- Reg.

Reference: Executive Engineer, NH Division, Bengaluru letter No. EE/NHDB/AE-2/NH-150A/NOC/Cable/2023-24/2018 dated 27.12.2023.


The Executive Engineer, NH Division, Bengaluru vide letter cited under reference above, has submitted proposal on above mention subject.

2. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and dated 17.04.2023 is generally found in order.

3. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority


The Regional Officer-Civil
Ministry of Road Transport & Highways
No.32, 2nd Floor, Race Course Road, Bangalore-560 001
Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765


(Sandesh.K)

Asst. Engineer(C)
for Regional Officer

Encl: As above

Copy to: (i) ✓ The Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001
for uploading on Ministry's website.
(ii) The Executive Engineer, National Highway Division Bengaluru, for
information.


(Sandesh.K)

Asst. Engineer(C)
for Regional Officer


FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject: Proposal for crossing & laying of underground cable of 66KV-3 Row X 1C X 240 sqmn (66KV HTUG) from Pandavapura Railway Station to MUSS substation, Pandavapura by open trench method from Km:599.507 to Km:601.400 crossing at Km:601.400 by HDD Method and crossing at Km: 601.900 by open trench method below the existing Railway Over Bridge (ROB) on NH-150A Jevargi - Chamarajanagar Section in the State of Karnataka submitted by the MRN Cane power and BIO-Refineries Pvt Ltd- Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	a) Application No.	
	b) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	c) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	



annexure -1

Ministry of Road Transport and Highways

GOVERNMENT OF KARNATAKA

(PUBLIC WORKS . PORTS AND INLAND WATER TRANSPORT DEPARTMENT)
NATIONAL HIGHWAYS

Office of the Executive Engineer, National Highways, Bangalore Division,
No.13/4 , 4th Floor CFC Building Nrupathunga Road Bangalore -560001
Ph No -080-22211207 E- Mail -executive_engi@yahoo.com Fax -080-22211207

NO: EE/NHDB /AE-2/ NH-150A/NOC/Cable /2023-24

To,

The Regional Officer,
MoRT&H, No.32 (2nd Floor), KSCFL Building,
Race Course Road, Bengaluru - 560 001.

Sir,

Sub: NOC for " Crossing & laying of underground cable of 66KV-3 Row X 1C X 240 sqmm (66KV HTUG) from Pandavapura Railway Station to MUSS sub station , Pandavapura by open trench method from Km: 599.507 to Km: 601.400, crossing at Km: 601.400 by HDD Method and crossing at Km: 601.900 by open trench method below the existing Railway Over Bridge (ROB) on NH-150A Jevargi-Chamarajanagar Section in the State of Karnataka" submitted by the MRN Cane power and Bio-Refineries Pvt Ltd", (wholly owned subsidiary of M/s. Nirani Sugars Ltd., & Lessee of Pandavapura Sahakari Sakkare Karkhane Ltd.)-Reg.

Ref: Assistant Executive Engineer, NH sub division, Mysuru letter no: 891-92 dated: 12.12.2023.

With reference to the above subject, the proposal for "Crossing & laying of underground cable of 66KV-3 Row X 1C X 240 sqmm (66KV HTUG) from Pandavapura Railway Station to MUSS sub station , Pandavapura by open trench method from Km: 599.507 to Km: 601.400, crossing at Km: 601.400 by HDD Method and crossing at Km: 601.900 by open trench method below the existing Railway Over Bridge (ROB) on NH-150A Jevargi-Chamarajanagar Section in the State of Karnataka" has been submitted by the MRN Cane power and Bio-Refineries Pvt Ltd., (wholly owned subsidiary of M/s. Nirani Sugars Ltd., & Lessee of Pandavapura Sahakari Sakkare Karkhane Ltd.)".

As per the submitted proposal it has been intended to sale the excess power generated in the Sugar factory, where in it is necessary to lay the 66KV UG cable.

Accordingly, the construction of Cable jointing chamber at an interval of 1000 M of size 5M X 2M X 1.8M is also submitted.

The Assistant Executive Engineer, NH sub division, Mysore vide letter cited at above reference has submitted the proposal.

The proposal is herewith examined in light of Ministry Circular no: RW/NH-33044/29/2015/S&R(R) dated: 22.11.2016 and latest amendment no: NH-36094/01/2022-S&R(P & B) dated: 17.04.2023.


The License Fee as per the Ministry Circular dated: 17.04.2023, which works out to **Rs. 2,87,152** for 5 years and a Bank Gurantee of **Rs. 4,73,250**. Further, the MRN Cane power and Bio-Refineries Pvt Ltd., Department is ready to deposit the Licensee fee and the Bank Guarantee as per the norms of the Ministry.

Hence, the proposal for laying of HTUG cable along with the draft agreement, check list, necessary undertaking and licensee fee & BG calculation are here with submitted for obtaining concurrence from the Competent Authority at the earliest.


It is here by requested your kind self to communicate the NOC for laying of HTUG Cable as the earliest as the work is of prime importance.

Enclosure: 3 sets of proposals.

Yours faithfully,


Executive Engineer
National Highway Division,
Bengaluru.

DRAWING SHOWING THE PLAN AND CROSS SECTION OF PROPOSED UNDER GROUND CABLE ---66KV 3R x 1C x 240 Sq. mm. NH-150A AT CH - 599.507KM TO CH- 601.910KM

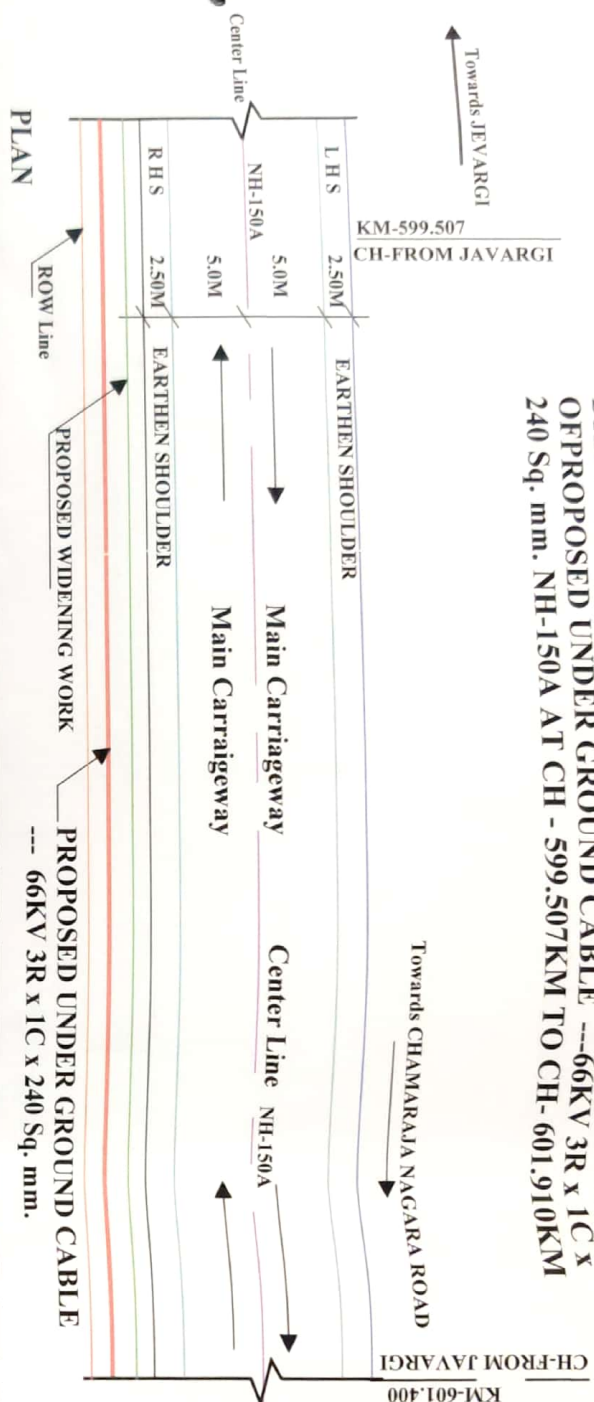

FROM CH - 599.507KM TO CH- 601.910KM



Name of work:- Sketch showing for Permission for crossing & laying of underground cable of 66KV-3Rowx1Cx240sq.mm. (HTUG) from "MRN Canepower and Bio-refineries Pvt. Ltd., (wholly owned Subsidiary of M/s. Nirani Sugars Ltd., & Lessee of Pandavapura Sahakari Sakkare Karkhane Ltd.) Pandavapura Railway Station to MUSS Sub Station Pandavapura on NH150A open trenching from Km599+507 to Km601+400, HDD crossing at Km601+400 and crossing at below the existing Railway Over Bridge (ROB) at Km601.900 by open trench in Jevargi - Chamarajanagara Section in the Karnataka State

DRAWING PREPARED

APPLICANT

[Signature]

[Signature]
Chief General Manager
MRN Canepower and Bio-refineries Pvt. Ltd.,
Pandavapura-571, 435

[Signature]
Assistant Executive Engineer
N H Sub Division, Mysuru

[Signature]
Executive Engineer
N.H. Division, Bangalore
N H Division, Bengaluru

DATE:-

DRAWN:-

CHECKED:-

APPROVED:-

TITLE:-
PROPOSED UNDER GROUND CABLE
--- 66KV 3R x 1C x 240 Sq. mm.

SECTION "-NH-150A AT
CH - 599.507KM TO CH- 601.910KM



SCALE:-

DRG NO:-

REVISED NO:-

N
SCALE = NTS

DRAWING SHOWING THE PLAN AND CROSS SECTION
OF PROPOSED UNDER GROUND CABLE — 66KV 3R x 1C x
240 Sq. mm. NH-150A AT CH - 599.507KM TO CH-601.910KM

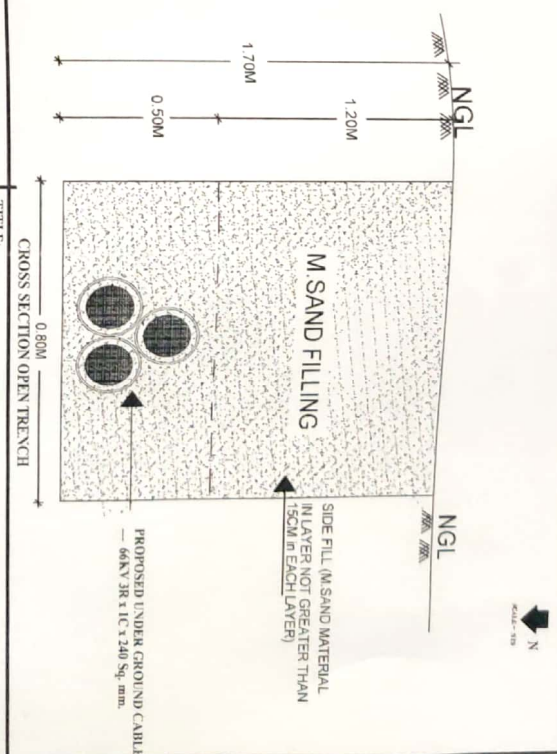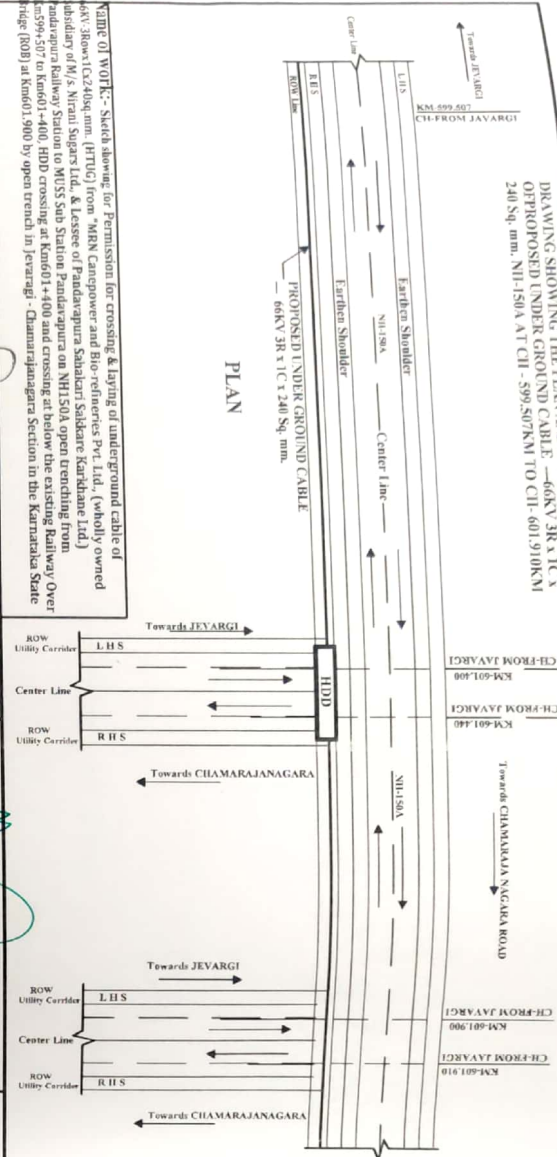


NAME OF WORK:- Stack showing for Permission for crossing & laying of underground cable of
66KV 3R x 1C x 240 Sq. mm. (HDD) from "MEN Caneppower and Bio-refineries Pvt. Ltd. (wholly owned
subsidiary of Biji's Mineral Super Ltd. & Lessee of Pandarapura Sahakar Sahakar Karthana Ltd.)
Pandarapura Railway Station to WSS Sub Station Pandarapura on NH-150A open trenching from
CH-599.507 to CH-601.910. HDD crossing at Km601.400 and crossing at below the existing Railway Over
Bridge (HOB) at Km601.900 by open trench in Jevargi - Chamarajanagara Section in the Karnataka State
Highway (HOB) at Km601.900 by open trench in Jevargi - Chamarajanagara Section in the Karnataka State

DRAWING PREPARED	APPLICANT	DATE	TITLE
<i>[Signature]</i>	<i>[Signature]</i> Chief General Manager MRN Caneppower and Bio-refineries Pvt. Ltd. Pandarapura-571 435		PROPOSED UNDER GROUND CABLE SECTION :- NH-150A AT CH - 599.507KM TO CH- 601.910KM
	Executive Engineer N.H. Division, Bangalore	CHECKED	SCALE: NTS
	<i>[Signature]</i>	APPROVED	DRG. NO.
			REVISED NO.

Name of work:- Sketch showing for Permission for crossing & laying of underground cable of 66KV-3Rowx1Cx240sq.mm. (HTUG) from "MRN Canepower and Bio-refineries Pvt. Ltd., (wholly owned subsidiary of M/s. Nirani Sugars Ltd., & Lessee of Pandavapura Sahakar Sakkare Karkhane Ltd.) Pandavapura Railway Station to MUSS Sub Station Pandavapura on NH150A open trenching from Km599+507 to Km601+400, HDD crossing at Km601+400 and crossing at below the existing Railway Over Bridge (ROB) at Km601.900 by open trench in Javaragi - Chamaraajanagera Section in the Karnataka State


CH-FROM JAVARGI
KM-601.400

DRAWING SHOWING THE PLAN AND CROSS SECTION OF HDD
PROPOSED UNDER GROUND CABLE ---66KV 3R x 1C x 240 Sq. mm.
NH-150A AT CH - 601.400 KM TO CH- 601.440KM

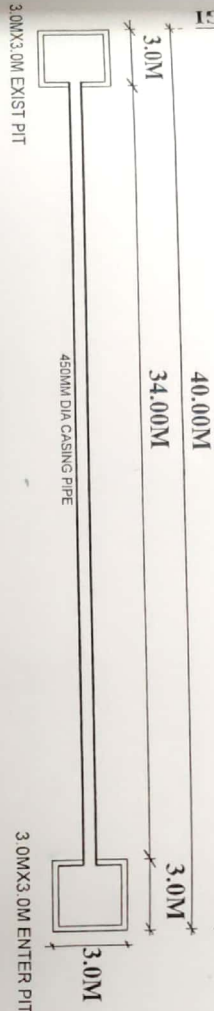

PLAN OF HDD

CH-FROM JAVARGI
KM-601.440

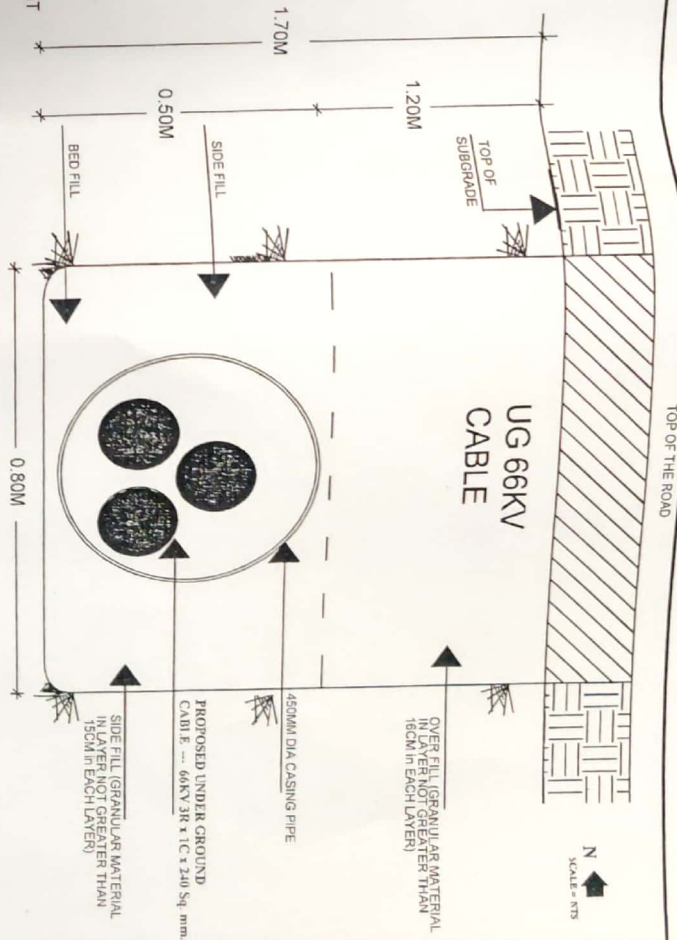

CROSS SECTION OF HDD

DRAWING PREPARED <i>Pradyumn DK</i>	APPLICANT <i>Pradyumn DK</i> Chief General Manager MRN Canepower and Bio-refineries Pvt. Ltd., Pandavapura-571 435.	Assistant Executive Engineer NH Division, Bangalore <i>Pradyumn DK</i>	Executive Engineer NH Division, Bangalore <i>Pradyumn DK</i>	DATE:-	TITLE:- PROPOSED UNDER GROUND CABLE		
				DRAWN:-	SECTION "A" - NH-150A AT CH - 599.507KM TO CH- 601.910KM		
				CHECKED:-	SCALE:-	DWG NO:-	REVISED NO:-
				APPROVED:-			