

No. RW/PAT/NH/104/10.929/Over-Head Crossing/2020 2075

Government of India

Ministry of Road Transport & Highways
(Office of Chief Engineer cum Regional officer-Patna)
Vill-Chakmusa, Near Nakati Bhawani mandir on NH-98
Post- Mohammadpur Kurji Via Khagaul, Patna- 801105, Bihar

Dated: 04.03.2020

Invitation of public comments

Sub: - Proposal for permission for National Highway Overhead crossing of 400 KV D/C Sitamarhi (New)-Motihari Transmission line to Chorma-Sheohar on NH-104 at Ch. 10.929 Km near village Dulma

Sir,


Powergrid Mithilanchal Transmission Ltd. has submitted the subject Proposal for permission for National Highway Overhead crossing of 400 kv D/C Sitamarhi (New)-Motihari Transmission line to Chorma-Sheohar NH-104 at Ch. 10.929 Km near village Dulma through Chief Engineer, NH (North) Wing, RCD, Bihar vide letter no. 560 (Anu) dated 20.02.2020 to this office.

2. In this regard, objection of the public if any on grounds of public inconvenience, safety and general public interest, are invited on the subject proposal and hard copy of the same should reach to below mentioned address within 30 days from the day of uploading, beyond which no objection will be considered.

Address:-

The CE-Regional Office,
Ministry of Road Transport & Highways,
(Office of the Chief Engineer cum Regional officer, Patna)
Vill-Chakmusa, Near Nakati Bhawani mandir on NH-98
Post- Mohammadpur Kurji Via Khagaul, Patna- 801105, Bihar

Yours Faithfully,


(Mridul Rakesh Mishra)
Assistant Executive Engineer,
For CE-Regional officer,
Patna

Copy to:-


1. Senior Technical Director, NIC, Transport Bhawan, New Delhi-110001.- For uploading on Ministry's website.
2. Powergrid Mithilanchal Transmission Ltd, ERTS-I, Power Grid Corporation of India Ltd., Powergrid, Muzaffarpur, NH-77 , Dariyapur Kafan, Muzaffarpur-844127.
3. EE, NH Division, Motihari

20

RE- INSPECTION

A Line Diagram for Proposed Transmission line at Ch.10.929 Km of NH-104 (AP28/0-AP29/0)

To SITAMARHI

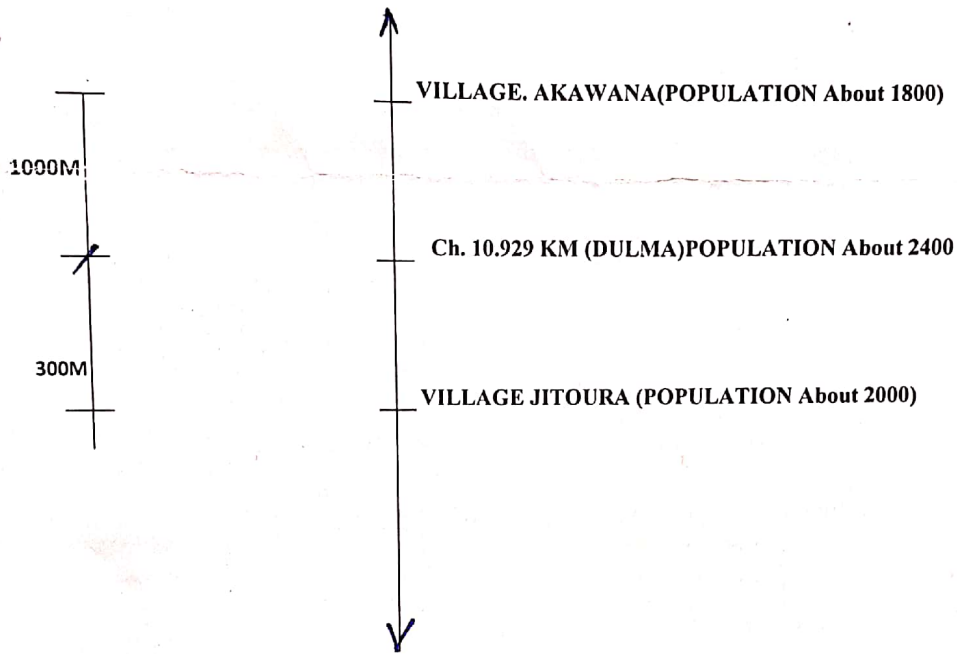

NOT TO SCALE


M. G. Singh
25/01/20
JE,
N.H.DIVISION
MOTIHARI

B. Singh
25/01/2020
AE,
N.H.DIVISION
MOTIHARI

J. Singh
25-1-2020
EE,
N.H.DIVISION
MOTIHARI

Joint Inspection report

Subject: -Overhead crossing of 400 KV D/C Sitamari-Motihari line between km stone 10 and 11
Chainage- 10.929 Km
VIII-DULMA
Clearance for NH-19.10 Mtr

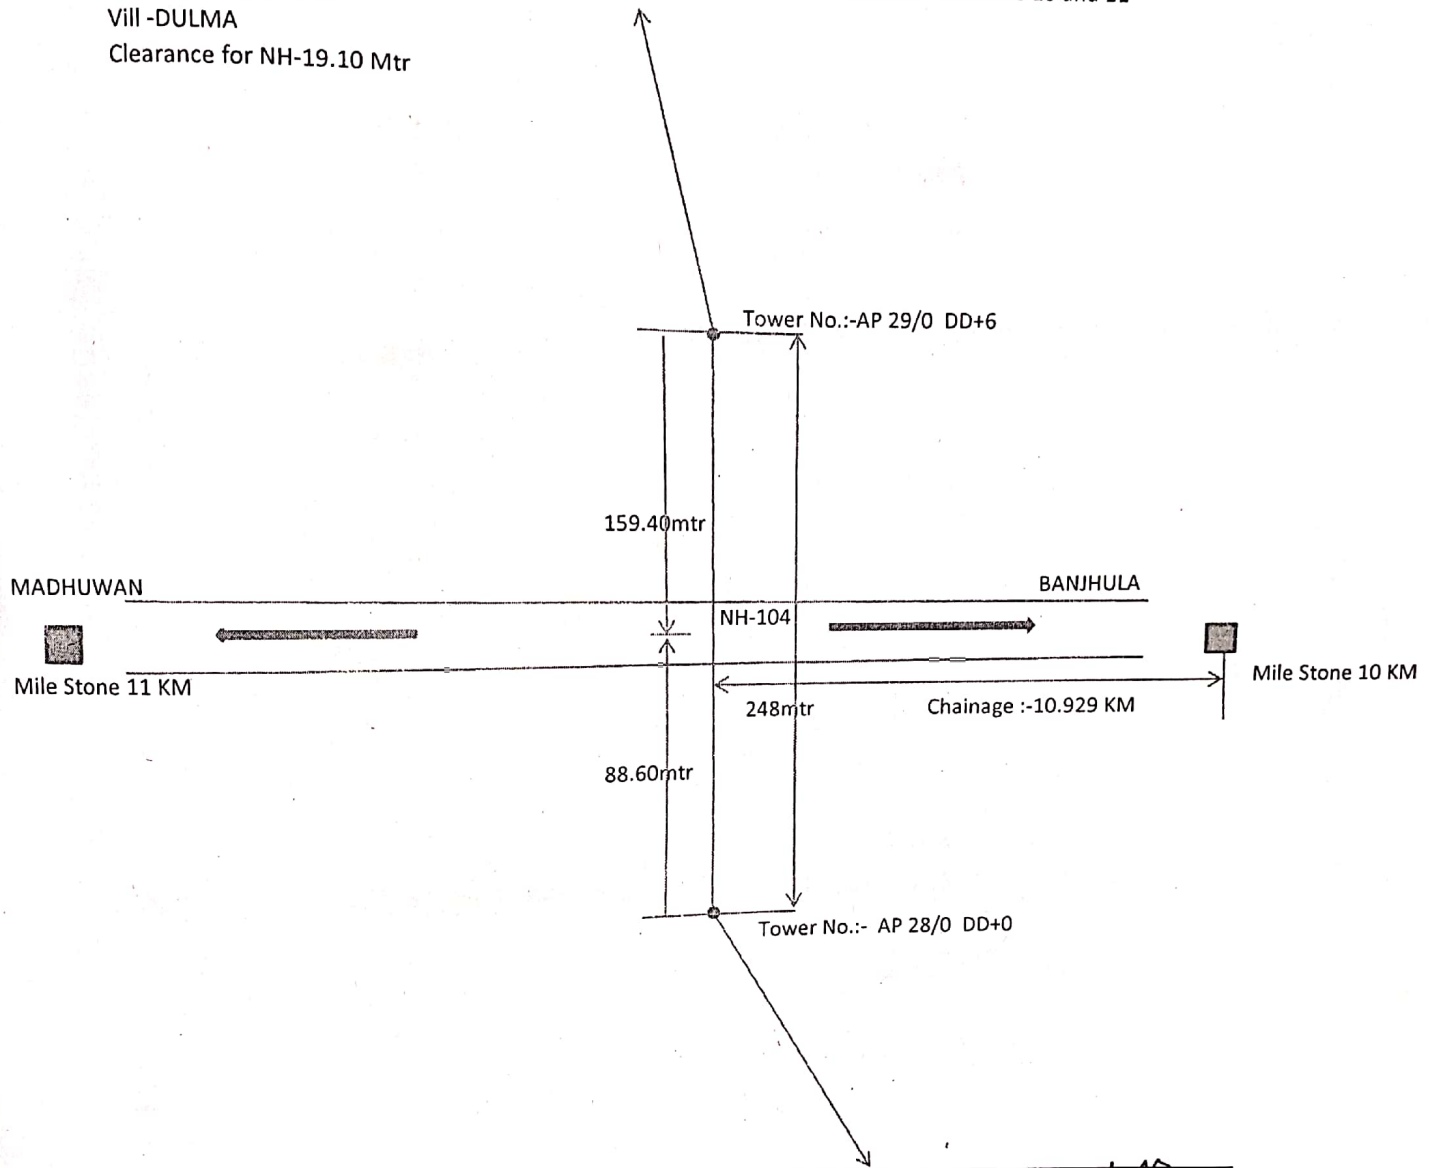

Signature:-

Jai Prakash Singh YADAV	Lovkesh Sharma Field Engineer (Electrical) Power Grid Mithilanchal Transmission Ltd Sitamarhi	J. E.	J. E.	J. E.

EXECUTIVE ENGINEER
N.H-DIVISION, MOTIHARI