

No. RW/PAT/NH/104/7.957 /Over-Head Crossing/2020 2076  
Government of India  
Ministry of Road Transport & Highways  
(Office of Chief Engineer cum Regional officer-Patna)  
Vill-Chakmusa, Near Nakati Bhawani mandir on NH-98  
Post- Mohammadpur Kurji Via Khagaul, Patna- 801105, Bihar

Dated: 04.03.2020

Invitation of public comments

**Sub: -** Proposal for permission for National Highway Overhead crossing of 400 KV D/C Sitamarhi (New)-Motihari Transmission line to Banarjula-Chorma on NH-104 at Ch. 7.957 km near village Barapakar

Sir,

Powergrid Mithilanchal Transmission Ltd. has submitted the subject Proposal for permission for National Highway Overhead crossing of 400 kv D/C Sitamarhi (New)-Motihari Transmission line to Banarjula-Chorma NH-104 at Ch. 7.957 km near village Barapakar through Chief Engineer, NH (North) Wing, RCD, Bihar vide letter no. 560 (Anu) dated 20.02.2020 to this office.

2. In this regard, objection of the public if any on grounds of public inconvenience, safety and general public interest, are invited on the subject proposal and hard copy of the same should reach to below mentioned address within 30 days from the day of uploading, beyond which no objection will be considered.

Address:-

The CE-Regional Office,  
Ministry of Road Transport & Highways,  
(Office of the Chief Engineer cum Regional officer, Patna)  
Vill-Chakmusa, Near Nakati Bhawani mandir on NH-98  
Post- Mohammadpur Kurji Via Khagaul, Patna- 801105, Bihar

Yours Faithfully,




(Mridul Rakesh Mishra)  
Assistant Executive Engineer,  
For CE-Regional officer,  
Patna.

Copy to:-

1. Senior Technical Director, NIC, Transport Bhawan, New Delhi-110001.- For uploading on Ministry's website.
2. Powergrid Mithilanchal Transmission Ltd, ERTS-I, Power Grid Corporation of India Ltd., Powergrid, Muzaffarpur, NH-77 , Dariyapur Kafan, Muzaffarpur-844127.
3. EE, NH Division, Motihari

**RE-INSPECTION**

A Line Diagram for Proposed Transmission line at Ch.7.957 Km of NH-104 (AP30/0-AP31/0)

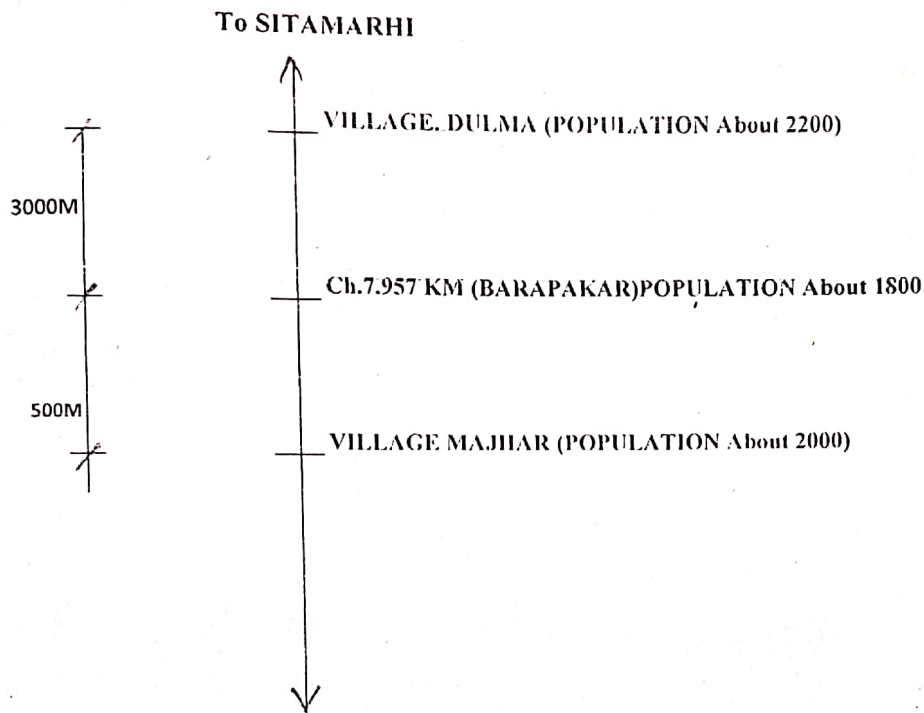

NOT TO SCALE


M. G. H. M. S.  
25/01/20  
JE  
NH Division, Motihari

Bevinod  
25/01/2020  
AE  
NH Division, Motihari

G. J. S. M.  
25-1-2020  
Executive Engineer  
NH Division, Motihari

## Joint Inspection report

Subject:- Overhead crossing of 400 KV D/C Sitamarhi-Motihari line between km stone 7 and 8  
Chainage- 7.957 Km  
VIII -BARAPAKAR  
Clearance for NH-19.80 Mtr

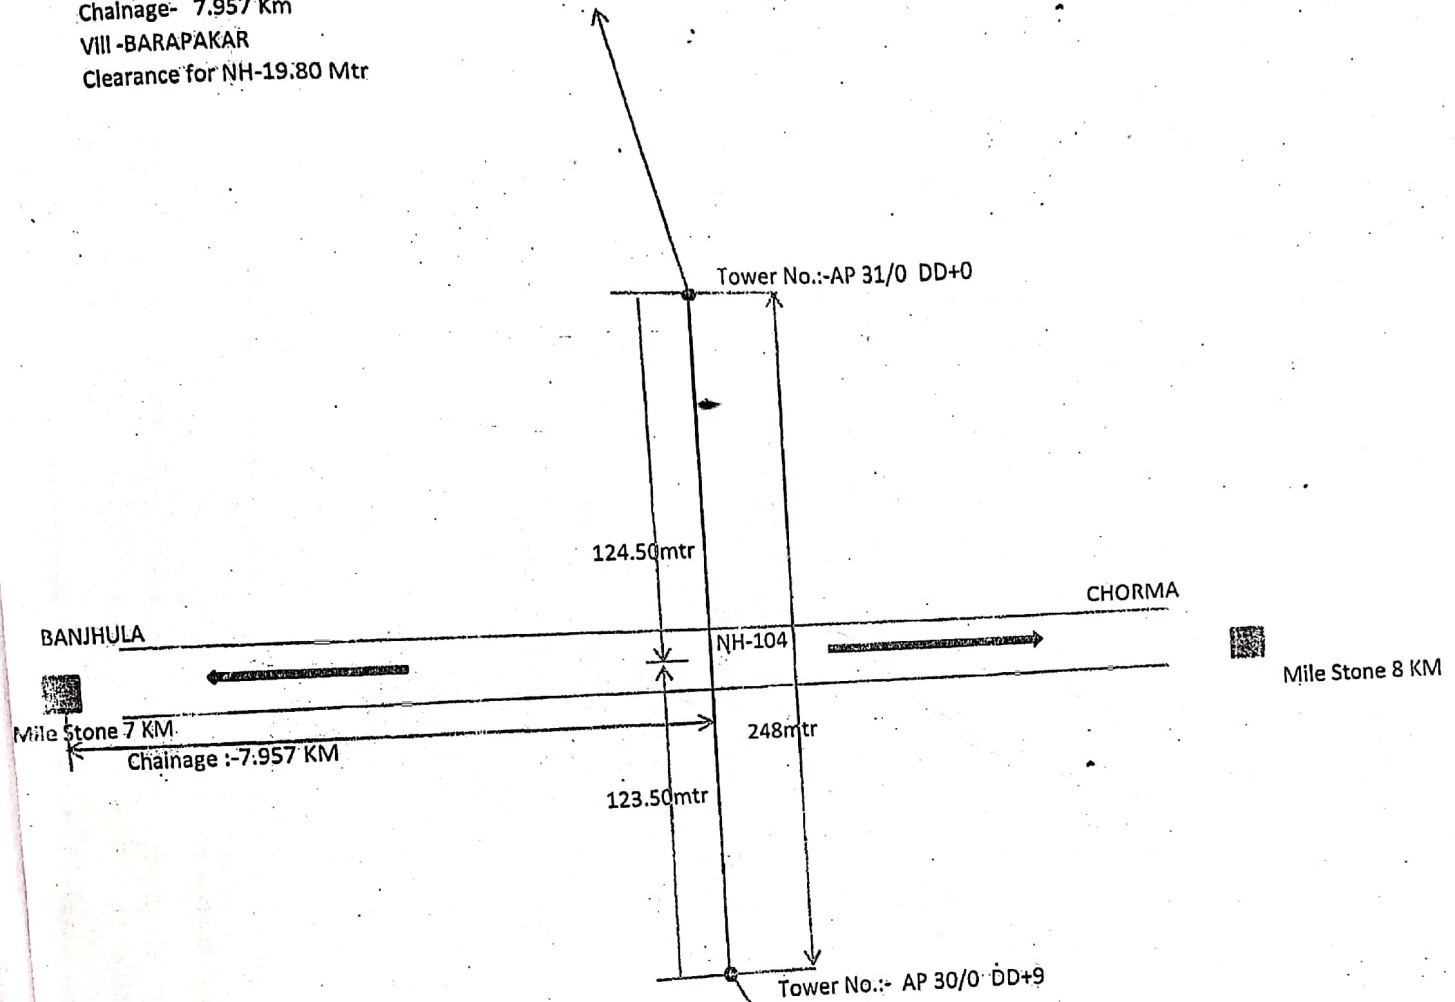

Signature:-

JAGROOP SINGH  
YADAV

Lovkesh Sharma  
Field Engineer (Electrical)  
Power Grid Mithilanchal Transmission Ltd.  
Sitamarhi

EXECUTIVE ENGINEER  
NH-DIVISION, MOTIHARI