



सत्यमेव जयते

# भारतीय राष्ट्रीय राजमार्ग प्राधिकरण

(सड़क परिवहन एवं राजमार्ग मंत्रालय, भारत सरकार)

## National Highways Authority of India

(Ministry of Road Transport and Highways, Government of India)

क्षेत्रीय कार्यालय-पश्चिम उ०प्र०, लखनऊ Regional Office - West UP, Lucknow.

3/248, विशाल खण्ड, गोमती नगर, लखनऊ-226010 (उ.प्र.)

3/248, Vishal Khand, Gomti Nagar, Lucknow-226010 (UP)

दूरभाष / Phone : 0522-4960291, टेलीफैक्स / Fax : 0522-4950680

ई-मेल / E-mail : rowestup@nhai.org, rowestup@gmail.com



19001/1/RO-W-UP/NH-19/Ch.282.300/Underground/2673

Dated: 27/02/2024

### INVITATION OF PUBLIC COMMENTS

**Sub:** Proposal of NOC for laying of 02Nos of 11KV UG Cable across the NH-19 (Agra-Etawah Section) at 11KV Karikheda Feeder of 33/11KV Ukhrend Sub-station located at 282+300 and Ch. 282+700 & 01No. of 11KV UG cable at 11KV Nagla Khari Feeder of 33/11KV Ukhrend Sub-Station of 11KV Nagla Khari Feeder at Ch. 284+040 in Tehsil-Sirsaganj, District-Firozabad in the state of Uttar Pradesh.

Executive Engineer, DVVNL, EDD-Sirsaganj District-Firozabad has submitted the proposal for laying of 02Nos of 11KV UG Cable across the NH-19 (Agra-Etawah Section) at 11KV Karikheda Feeder of 33/11KV Ukhrend Sub-station located at 282+300 and Ch. 282+700 & 01No. of 11KV UG cable at 11KV Nagla Khari Feeder of 33/11KV Ukhrend Sub-Station of 11KV Nagla Khari Feeder at Ch. 284+040 in Tehsil-Sirsaganj, District-Firozabad in the state of Uttar Pradesh.

2. As per the guidelines, issued by the Ministry vide OM No. RW/NH-33044\*/29/2015/S&R (R) dated 22/11/2016, the application shall be put out in the public domain for 30 days for seeking claims and objections (on grounds of public inconvenience, safety and general public interest).

3. In view of above, comments of the public on the above application is invited to the below mentioned address, which should reach by this office within 30 days from the date of publication beyond which no comments shall be entertained.

The Regional Officer,  
National Highways Authority of India,  
Regional Office, UP-West, Lucknow  
3/248, Vishal Khand Gomti Nagar Lucknow-226010

This issues with the approval of RO-UP (West), Lucknow.

Encl: As above.

(N.P. Singh)

Dy. General Manager (Tech)

Copy to:

1. Web admin, NHAI-HQ-with request for uploading on the NHAI website.
2. The Technical Director, NIC, Transport Bhawan, New Delhi- with request for uploading on the Ministry's website.
3. Executive Engineer, DVVNL, EDD-Sirsaganj District-Firozabad for information.
4. PD, PIU- Agra- for information.




### Checklist

Guidelines for processing the proposal for laying of Electrical Cable across the NH-19 (Old NH-02) vested with the Authority, NHAI.

Sr. No.	Item	Information/Status	Remarks
1.1	General Information	Dakshinanchal Vidhyut Vitran Nigam Limited, Registered office – Urja Bhavan, 220 kV S/s Bypass Road, Sikandra, Agra. Corresponding office at Executive Engineer, Electricity Distribution Division – Sirsaganj, Firozabad	
1.2	National Highway Number	NH-19 (Old NH-02)	
1.3	State	Uttar Pradesh	
1.4	Location	Firozabad	
1.5	Chainage in Km.	282+300, 282+700, 284+040	
1.6	Length in Km.		
1.7	Width of available ROW in meters		
	a. left side from the center line towards increasing chainage/km direction	As per typical section	
	b. Right side from center line towards increasing chainage/km direction	As per typical section	-
1.8	Proposal to lay cable		
	a. Left side from center line towards increasing chainage /km direction	As per typical section	
	b. Right side from center line towards increasing chainage/ km direction	As per typical section	
1.9	Proposal to acquire land		
	a. Left side from center line towards increasing chainage /km direction	Not Required	
	b. Right side from center line towards increasing chainage /km direction	Not required	
1.10	Whether the proposal is on the same side where the land is not to be acquired	Not required	
	If not, then where to lay Electrical Cable	Within available ROW	
1.11	Details of already laid services.	No	

*Devg*





Sanjay Verma  
Project Director  
National Highways

Dev Datt Singh  
Dy. Manager (Tech)  
National Highways Authority  
Implementation Unit-Agra



	if any along the proposed route		
1.12	Number of Existing lanes (2/4/6/8 lanes)	6 Lanes	
1.13	Proposed number of lanes (2 lanes with paved shoulders/4/6/8 lanes)	Not proposed	
1.14	Service road existing or no		
	a. Left side from the Center line	Both side Existing Service Road	
	b. Right side from the Center line		
1.15	Proposed Service Road		
	a. Left side from the Center line	N/A	
	b. Right side from the Center line		
1.16	Whether proposal to lay cable is after the service road or between the Main Carriageway	Electrical Cable will be laid at the Extreme edge of the RoW	
1.17	The permission for laying of Electric cable shall be considered for approval/rejection	For Approval	
	a. Where the RoW is more than 45m, then the duct cable shall be laid at the edge of the RoW within the Utility corridor of 2m width keeping in view of the future widening	Extreme edge of RoW	
	b. Where land is yet to be acquired for 6-laning and the position of carriageway has been decided then the cable shall be laid at the edge of RoW within Utility Corridor of 2.0m width on that side of existing carriageway where extra land is not proposed to be acquired for 6-laning	Not required	
	c. Where the widening plan for 6-laning is not yet decided		
	d. Where ROW is restricted and adequate only to accommodate the carriageway, Central Verge, shoulders and drains (e.g. Highways in cutting through Hilly Rolling Terrain) the cable shall be laid clear of		

*Devs*

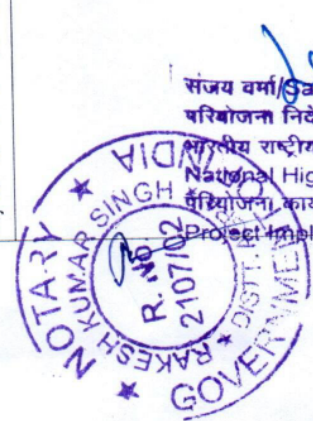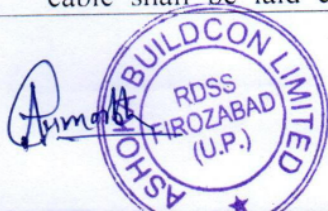



संजय वर्मा/Sanjay Verma  
परियोजना निदेशक/Project Director  
राष्ट्रीय राष्ट्रीय राजमार्ग प्राधिकरण/Dev Datt Singh  
National Highways Authority of India (नकाशे)/Dy. Manager (Tech)  
प्रियोजना कार्यान्वयन इकाई-आगरा/राष्ट्रीय राजमार्ग प्राधिकरण/  
Project Implementation Unit, Agra Highways Authority of India

अधिसूचना कार्यान्वयन इकाई-आगरा  
विद्युत वितरण खण्ड  
सिरसागंज



	the drain.		
	e. Where land strip for Utility corridor cannot be conveniently earmarked (Available ROW restricted to the toe of the embankment) for laying of ducts, the permission may be refused	Sufficient space to accommodate Utility Corridor available	
1.18	Number of Applicants in the same stretch	Single Applicant	
1.19	Whether the case of Multiple Licenses	Single	
1.20	If so, furnish a joint implement programmer to lay their respective ducts within stipulated time frame	No Multiple Applicants, Only Single Applicant involved	
1.21	If crossing of the road involved. If yes, it shall be through the trench less technology	Yes, the proposed crossings shall be laid through HDD (Trenchless) technology	
2	Documents enclosed with the proposal		
2.1	Cross section showing the size of trench for open trenching method (normal size of 1.65m x 0.5m wide)	Not required, the cable will be laid through HDD Method.	
2.2	Cross-section showing the size of pit location for HDD Method	Enclosed	
2.3	Strip Plan/Route Plan showing the OFC Cable, Chainage, width of RoW, Important mile stone, Intersections, Cross Drainage works etc.	Enclosed	
2.4	Methodology for laying of OFC	HDD Method	
2.4.1	Open Trenching Method. If yes, methodology of refilling the trench	Not Applicable, HDD Method is adopted	
2.4.2	Horizontal Directional Drilling (HDD) Method	Yes	
2.4.3	Laying OFC/cable through CD Works and method of laying (Whether to be hung outside the parapet)	NA	
3	Draft license agreement signed by two witnesses	Yes	
4	Performance Bank Guarantee		
5	Affidavit/Undertaking from the Applicant for		
5.1	Not to damage any other Utility.	Undertaking enclosed	

*Debraj*

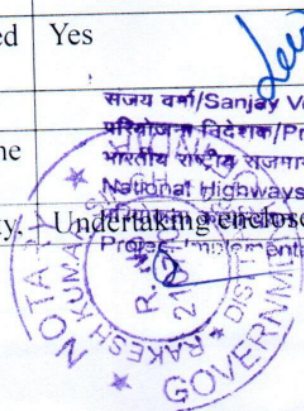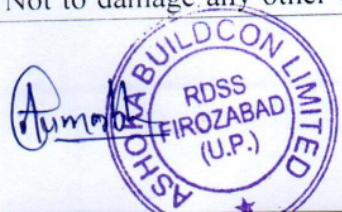

संजय वर्मा/Sanjay Verma  
 परियोजना निदेशक/Project Director  
 भारतीय राष्ट्रीय राजमार्ग प्राधिकरण/  
 National Highways Authority of India  
 कार्यालय-आगरा  
 Project Implementation Unit-Agra

देव दत्त/Dev Datt Singh  
 प्रबंधक (तकनीकी)/Dy. Manager (Tech)  
 भारतीय राष्ट्रीय राजमार्ग प्राधिकरण/  
 National Highways Authority of India  
 कार्यालय-आगरा  
 Implementation Unit-Agra

अभिषेक अभियन्ता  
 विद्युत वितरण खण्ड  
 सिरसा



	if damaged, then to pay the losses either to NHAI or the Concessionaire of NHAI		
5.2	Renewal of Bank Guarantee	Undertaking enclosed	
5.3	For confirming all standard conditions of Ministry's Circulars and NHAI Guidelines	Undertaking enclosed	
5.4	For shifting of OFC/cable as and when required by NHAI at their own cost	Undertaking enclosed	
5.5	For shifting of OFC/Cable due to six-laning/widening of NHAI)	Undertaking enclosed	
5.6	For Indemnity against all damages and claims clause (xviii of the License Agreement)	Undertaking enclosed	
5.7	For Traffic Movement during laying of Electric Cable to be managed by the applicant	Undertaking enclosed	
5.8	If any claim is raised by the Concessionaire of the NHAI, then the same has to be paid by the applicant	Undertaking enclosed	
6	Affidavit/Power of Attorney in favor of Authorized Signatory	Yes, Enclosed	
7	Certificate from the Project Director		
7.1	Certification that the proposal conforms to all the standard Conditions of the Ministry of Road Transport and Highways Circular issued vide letter no. RW/NH-33044/29/2015/S&R(R) dated 22.11.2016	Yes	
7.2	Certification from PD in the following format  1. For 6-Laning a) Where feasibility is available "I do certify that there will be no hinderance to the feasibility report considering proposed structures at the said location  b) In case feasibility report is not available "I do certify that the sufficient ROW is available at side for accommodating six laning	N/A	

संजय वर्मा / Sanjay Verma  
परियोजना निदेशक / Project Director  
भारतीय राष्ट्रीय राजमार्ग प्राधिकरण /  
National Highways Authority of India  
परियोजना कार्यान्वयन इकाई-आगरा  
Project Implementation Unit-Agra

देव दत्त सिंह / Dev Datt Singh  
रूप. प्रबन्धक (तक) / Dy. Mana  
भारतीय राष्ट्रीय राजमार्ग प्राधिकरण  
National Highways Authority  
परियोजना कार्यान्वयन इकाई-आगरा  
Project Implementation Unit-Agra

Subs

ASHOKA BUILDING LIMITED  
RDSS  
FIROZABAD  
(U.P.)

INDIA  
R. NO. 210702  
RAKESH KUMAR SINGH \* DIST. AGRA  
GOVERNMENT

अधिसूचना अभियन्ता  
विद्युत वितरण खण्ड  
सिरसा



8	As per guidelines License fees shall be paid in advance	Department will pay fee after issuing demand note	
9	If NH section proposed is taken up by the NHAI on the BOT Basis – a clause is to be inserted in the agreement – The permitted highway on which the licensee has been granted the right to lay electric cable has also been agreed as a right of way to the Concessionaire under the concession agreement for up-gradation of (..... Section from km. .... of NH no. .... on build, operate and transfer basis] and therefore, the licensee shall honour the same.	Not Applicable	
10	Who will supervise the work of laying OFC	Dakshinanchal Vidhyut Vitran Nigam Limited	
11	Who will ensure that the defects in road portion after the crossing of Electric cable are corrected and if not corrected what action will be taken	National Highways Authority of India	
12	Who will pay for the claims of the damages done/disruption in working of Concessionaire, if asked by the Concessionaire of the NHAI	Dakshinanchal Vidhyut Vitran Nigam Limited	
13	A Certificate from Project Director that he will enter the proposed permission in the register of records of the permission in the prescribed proforma	Yes	
14	If any previous approval for laying of electric cable, then photocopy of register of records of permission accorded be also enclosed in the proposal	yes	

संजय वर्मा/Sanjay Verma  
 परियोजना निदेशक/Project Director  
 भारतीय राष्ट्रीय राजमार्ग प्राधिकरण/भारतीय राष्ट्रीय राजमार्ग प्राधिकरण/  
 National Highways Authority of India  
 सहायक निदेशक/अतिरिक्त प्रमुख कार्यन्वयक इकाई-आगरा  
 Project Implementation Unit-Agra

For Dakshinanchal Vidhyut Vitran Nigam Limited

*Arora*



*Dev Datt Singh*

Executive Engineer  
 Electricity Distribution Division-Sirsaganj  
 अधिशासी  
 Firozabad  
 विद्युत वितरण खण्ड  
 सिरसागंज