



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण

(सड़क परिवहन एवं राजमार्ग मंत्रालय, भारत सरकार)


National Highways Authority of India

(Ministry of Road Transport & Highways, Govt. of India)

क्षेत्रीय कार्यालय (उत्तराखण्ड) - मकान नं०-58/37 बलबीर रोड, देहरादून-248001

Regional Office (Uttarakhand) - House No.-58/37, Balbir Road, Dehradun-248001

दूरभाष/Phone : 0135-2669752 ई-मेल/E-mail : routtarakhand@nhai.org वेबसाइट/Website : www.nhai.gov.in



58063/NHAI/RO-UKD/2014/ 20378

November, 07, 2024

Invitation of Public Comments

Sub:- Proposal for laying of 6" Dia underground electric cable line of Uttarakhand Power Corporation Limited, along the (Sitarganj Tanakpur Road) on NH-125, from Ch. 0.000 to Ch. 01.400 RHS is total length 1.4 Km., in Sitarganj in the state Uttarakhand - reg.

It is to inform all concerned that UPCL, 132KV Substation Campus Kathgodam, Tedi Puliya, Haldwani has submitted the subject proposal to PIU-Rudrapur for grant of permission towards laying of 6" Dia underground electric cable line of Uttarakhand Power Corporation Limited, along the (Sitarganj Tanakpur Road) on NH-125, from Ch. 0.000 to Ch. 01.400 RHS is total length 1.4 Km., in Sitarganj in the state Uttarakhand through HDD method.

2. The proposed location for laying of 6" Dia underground electric cable line are tabulated hereunder: -

(i)	National Highway	NH-125
(ii)	Name of Public Utility	6" Dia underground electric cable line of Uttarakhand Power Corporation Limited, along the (Sitarganj Tanakpur Road) on NH-125, from Ch. 0.000 to Ch. 01.400 RHS is total length 1.4 Km

3. As per the Guidelines issued by Ministry vide OM No. RW/NH-33044/29/2015S&R(R) dated 22.11.2016, the application is to put out in the public domain for 30 days for seeking public comments/objections (on the ground of public inconvenience, safety and general public interest).

In view of the above, comments/objections of the public on the above application are invited to the below mentioned address, which should reach by this office within 30days from the date of uploading beyond which no comments shall be entertained.

**The Regional Officer,
National Highways Authority of India
(Ministry of Road, Transport & Highways)**

**Regional Office-Uttarakhand
House No.-58/37, Balbir Road, Dehradun-248001**

This is being issued with the approval of C.G.M (Tech.) cum Regional Officer-Uttarakhand.

Yours faithfully,


(Signature)
(Priyanka Yaishnava Arora)
Manager (Tech.)



For Regional Officer-Uttarakhand

Encl: As above.


Copy to:

- 1) Web Admin-NHAI HQ, New Delhi: - with request for uploading on NHAI website.
- 2) The Technical Director, NIC, Transport Bhawan, New Delhi: - with request for uploading on Ministry's Website.
- 3) PD, PIU-Rudrapur- for information & suitable necessary action.

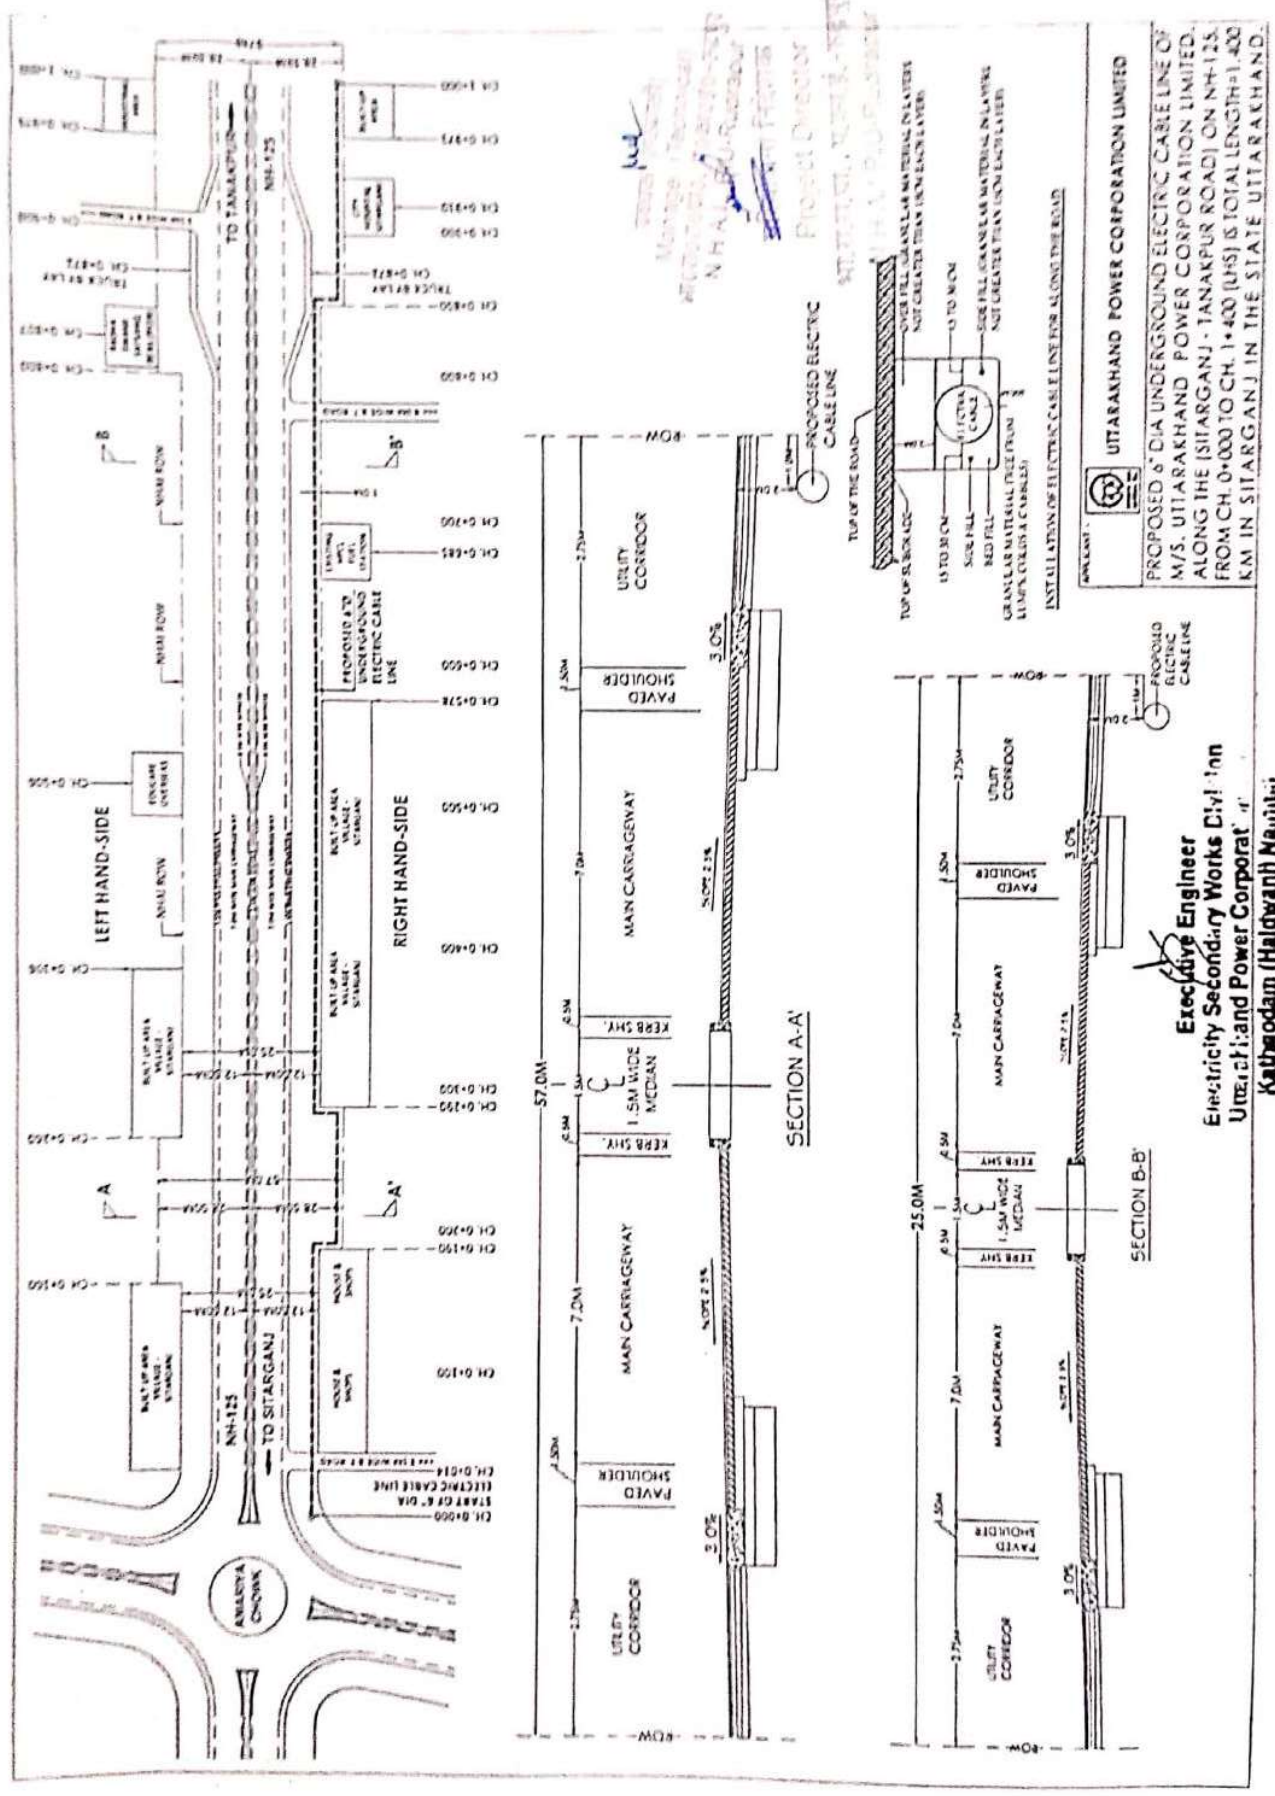


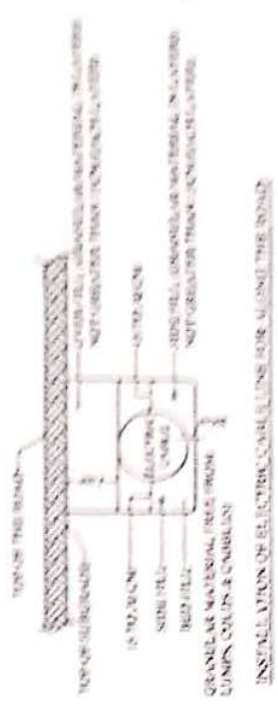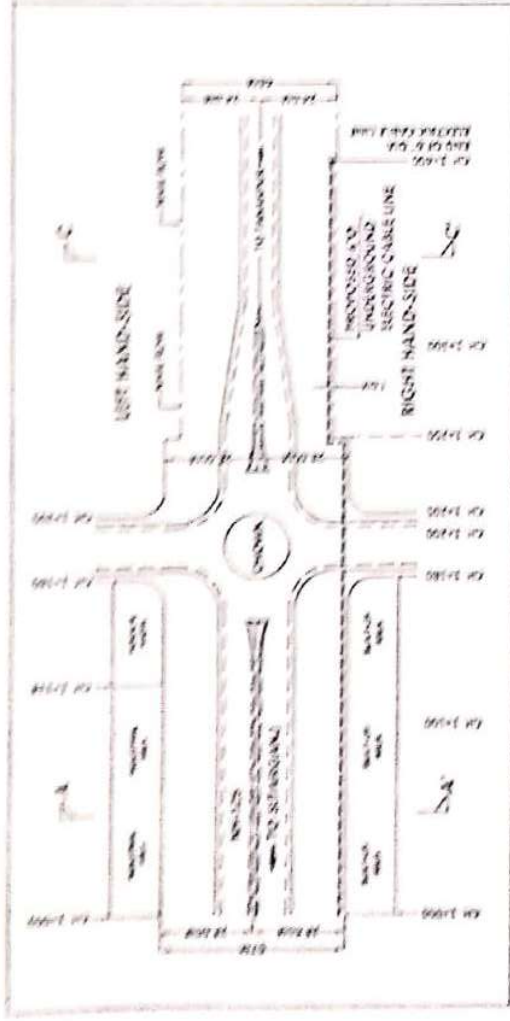

INSTALLATION OF ELECTRIC CABLE LINE FOR ALONG THE ROAD

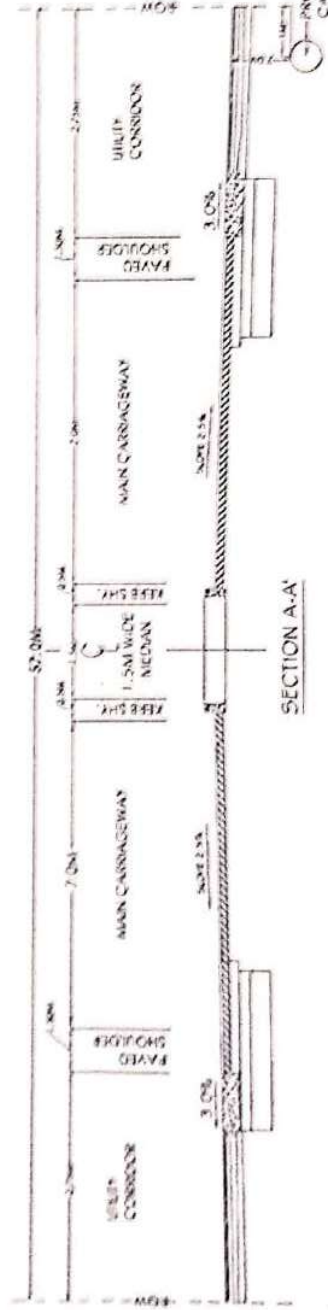

SECTION A-A

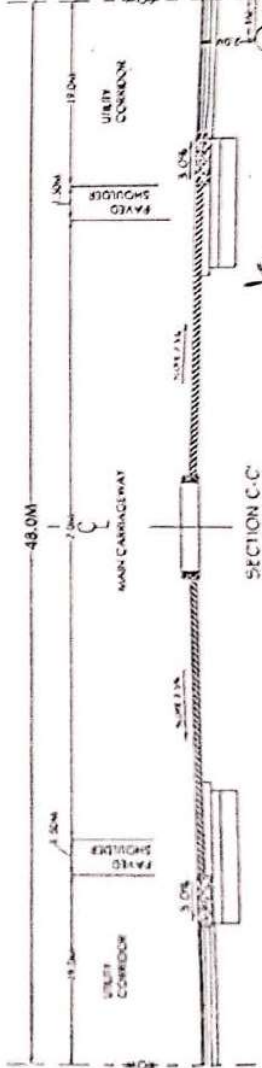

SECTION C-C

UTARAKHAND POWER CORPORATION LIMITED
PROPOSED 8" DIA UNDERGROUND ELECTRIC CABLE LINE OF
M/S. UTARAKHAND POWER CORPORATION LIMITED,
ALONG THE (SITARGANJ - LANAKPUR ROAD) ON NH-125,
FROM CH 0+000 TO CH 1+400 (LWS) IS TOTAL LENGTH=1.400
KM IN SITARGANJ IN THE STATE UTARAKHAND.

Executive Engineer
Electricity Secondary Works Division
Uttarakhand Power Corporation Ltd.
Rudrapur (Haldwani) Nainital

CHECK LIST

Guidelines for Accommodation of Public and Industrial Utility Services along and across National Highways.

Ministry's circular No.RW/NH-33044/29/2015/S&R* dated 22.11.2016.

Check list for getting approval for laying of cables on NH land

S. No.	Item	Information/ Status	Remarks
1	General Information		
1.1	Name and Address of the Applicant	Registered office at 132KV Substation Campus Kathgodam Tedhi Puliya, Haldwani (Nainital)", through Shri Brij Mohan bhatt working as Engineer in (M/s Uttarakhand Power Corporation Ltd)	
1.2	National Highway Number	Sitarganj to Tanakpur Road	
1.3	State	Uttarakhand	
1.4	Location	FROM CH. 0+000 TO CH. 01+400 RHS IS TOTAL LENGTH=1.40 KM,	
1.5	(Chainage in Km)	FROM CH. 0+000 TO CH. 01+400 RHS IS TOTAL LENGTH=1.40 KM,	
1.6	Length in Meters	Along length 1Km	
1.7	Width of available ROW	25m	
	(a) Left side from center line towards increasing Chainage/ km direction	12.50m	
	(b) Right side from center line towards increasing Chainage/ km direction	12.50m	
1.8	Proposal to lay underground Electric cable	Yes	
	(a) Left side from center line towards increasing Chainage/ km direction	N/A	
	(b) Right side from center line towards increasing Chainage/ km direction	Laying along the Carriageway only	
1.9	Proposal to acquire land	N/A	
	(a) Left side from center line		
	(b) Right side from center line		
1.10	Whether proposal is in the same side where land is not to be acquired	Yes, As Per Drawing Attached	
	If not then where to lay underground Electric cable	Within available ROW	
1.11	Details of already laid services, if any, along the proposed route.	N/A	
1.12	Number of lanes (2/4/6/8 lanes) existing	4 Lanes	

प्रबंधक (तकनीकी)
Manage. (Technical)
आगरा 0 रा 0 प्रा 0, प 0 का 0 ई 0 - रा 0 पुर
N.H.A.I., PIU-Rudrapur


Executive Engineer
Electr. Secondary Works Division
U. P. C. L. Haldwani (Nainital)


1.13	Proposed Number of lanes (2 lane with paved shoulders / 4/6/8 lanes)	NA	
1.14	Service road existing or not	NA	
	If yes then which side		
	(a) Left side from center line	Yes	
	(b) right side from center line	Yes	
1.15	Proposed Service Road		
	(a) Left side from center line	NA	
	(b) Right side from center line	NA	
1.16	Whether proposal of lay underground Electric cable is after the service road or between the service road and main carriageway	After the main carriageway	
1.17	The permission for laying underground Electric cable shall be considered for approval/ rejection	For Approval	
	(i) Where the ROW is more than 45 m then the duct cable shall be laid at the edge of right of way within the utility corridor of 2m width, duly keeping in view the future widening.	ROW is 25m	
	(ii) Where land is yet to be acquired for 4 laning and the position of new carriageway has been decided then the cable shall be laid at the edge of right of way within the utility corridor of 2m width, on that side of existing carriageway where extra land is not proposed to be acquired for 4 – laning.	No	
	(iii) Where the widening plan for 4 – laning is not yet decided and available ROW is around 30m or less, a judicious decision would need to be taken for permitting the laying of cable/ duct. This could be within 1.5m to 2m of utility corridor at the edge of existing ROW, duly keeping in view the possible widening plans.	ROW Available 25m	
	(iv) Where ROW is restricted and adequate only to accommodate the carriageway, central verge, shoulders and drain (e.g., highways in cutting through hilly/ rolling terrain), the cable shall be laid clear of the drain.	N/A	
	(v) Where land strip for utility corridor cannot be conveniently ear-marked (available ROW restricted to the toe of the embankment) for laying of cable/ ducts, the permission may be refused.	N/A	
1.18	No. of applicants on the same stretch	Single Applicant	
1.19	Whether the case of multiple licenses	No	
1.20	If so, furnish a joint implementation programmer to lay their respective ducts within stipulated time frame.	N/A	
1.21	If crossings of the road involved. If yes it shall only be through trench – less technology	NA	
2	Documents/ drawing enclosed with the proposal.	Yes	
2.1	Cross-section showing the size of trench for open trenching method.	Yes, Drawings are enclosed	
2.2	Cross section showing the size of pit and location of	Shown in drawing	

Manager (Technical)
 NHAI, Bhubaneswar
 NHAI, Bhubaneswar


Executive Engineer
 Secondary Works Division
 U. P. C. L. Haldwari (Nainital)



	Electric cable for HDD method.		
2.3	Strip plan/ Route Plan showing the Electric cable, Chainage, width of ROW, distance of proposed cable from the edge of ROW, important mile stone, intersection, cross drainages works etc.	Shown in drawing	
2.4	Methodology for laying of underground Natural Electric cable.	HDD	
2.4.1	Laying of underground Natural Electric cable along the National Highway through Open trenching method. or trench less method.	Yes through HDD trenchless & trenching Method	
2.4.2	Horizontal Direction Drilling (HDD) Method for crossing of National Highway.	Yes, through HDD trenchless method	
2.4.3	Laying of underground Natural Electric cable through CD works and method of laying (whether to be hung outside parapet).	N/A	
3.	Draft License Agreement signed by two witnesses	Yes	
4	Performance Bank Guarantee		
4.1	Confirmation of BG has been obtained as per NHAI guidelines	BG Shall be submitted as per NHAI/ MORTH Guidelines	
5	Affidavit / Undertaking from the Applicant for		
5.1	Not to damage to other utility, if damaged then to pay the losses either to NHAI or to the concerned agency	Yes Enclosed	
5.2	Renewal of Bank Guarantee	Yes	
5.3	Confirming all standards condition of NHAI guidelines.	Yes Enclosed	
5.4	Shifting of PNG/OFC/ Cables as and when required by NHAI	Yes Enclosed	
5.5	Shifting due to 6 Lanning / widening of NH	Yes Enclosed	
5.6	Indemnity against all damages and claims clause (xxiv).	Yes Enclosed	
5.7	Traffic movement during laying of PNG/OFC/ Cables to be managed by the applicant.	Yes Enclosed	
5.8	If any claim is raised by the concessionaires, then the same has to be paid by the applicant.	Yes Enclosed	
5.9	Certificate for 6 – laning from the applicant in the following format: - “We do undertake that I will relocate service road/ approach road/ utilities at my own cost notwithstanding the permission granted within such time as will be stipulated by NHAI” for future six – laning or any other development.”	Yes Enclosed	
6	Power of Attorney in favour of authorized signatory	Yes Enclosed	
7	Copy of DOT license	N/A	
8	Certificate from the Project Director		
8.1	Certificate for confirming of all standard condition issued vide Ministry Circular No.RW/NH-33044/17/2000/S&R dated 29.09.200 and NHAI guidelines issued vide No. NHAI/OEC/2k/Vol II dated:	Yes Enclosed	


 प्रबन्धक (प्रौद्योगिकी)
 Manager. (Technical)
 भारतीय राष्ट्रीय राजमार्ग प्राधिकरण
 N H A.I., PIU-Rudrapur


 इंजीनियर
 Electry. Secondary Works Division
 U. P. C. L. Haldwani (Nainital)

	07.11.2000 and Ministry Circular No. RW/NH33044/27/2000 S&R dated: 21.03.2006.		
8.2	Certificate for 4 – laning from PD in the following format.	4 Lane	
	(a) Where feasibility is available "I do certify that there will be no hindrance to existing 4- laning based on the feasibility report considering proposed structures at the said location".	Yes Enclosed	
9	The agreement fee shall be charged.	Yes Enclosed	
10	If NH section proposed to be taken up by NHAI on BOT basis a clause in para 17 to be inserted in the agreement "The permitted the right to lay cable/ duct has also been granted as a right of way to the concessionaire under the concession agreement for up- gradation of section from km of NHAI Noon build operate and transfer basis and therefore, the licensee shall honor the same.	N/A	
11	Who will supervise the work of laying of PNG/OFC/ cable	M/s Uttarakhand Power Corporation Limited.	
12	Who will ensure that the defects in road portion after laying of PNG/OFC/ Cable are corrected and if not corrected then what action will be taken	M/s Uttarakhand Power Corporation Limited.	
13	Who will pay the claims for damages done/ disruption in working of Concessionaire if asked by the Concessionaire	M/s Uttarakhand Power Corporation Limited.	
14	If any previous approval is accorded for laying of cable, then Photocopy of register of records of permissions accorded as maintained by PD (as per Ministry Circular No. RW/NH-33044/29/2015/S&R* dated 22.11.2016 as referred in Para 4 above is enclosed or not.	No	


 Authorized Signatory
 (M/s. Uttarakhand Power Corporation Limited)
 Executive Engineer
 Elect. Secondary Works Division
 U. P. C. L. Haldwari (Nainital)


 Project Director
 NHAI-PIU, Rudrapur

 Project Director
 NHAI-PIU, Rudrapur