



Government of India

Ministry of Road Transport & Highways

Office of the Chief Engineer-Regional Officer

No. 32, 2nd Floor, KSCFL Building,

D. Devaraj Urs Road, (Race Course Road), BENGALURU-560 001

Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No.RW/BNG/PER.CASES/BNG.DVN/2015 /520

Dated: 10.09.2020

Notice Inviting Public Comments on laying of HT Under Ground Cable along Bangalore - Mysore NH - 275 from Km 342.387 to 342.787 on LHS & one no. crossing at Km 342.387 through HDD method by M/s. BWS&S Board.

Reference: The Executive Engineer, NH Division, Bengaluru letter No. EE/NHDB/AE-1/BWSSB/2020-21/297-99 dated 06.06.2020.

The Executive Engineer, NH Division, Bengaluru vide letter cited under reference above, has submitted proposals seeking permission for laying of HT Under Ground Cable along Bangalore - Mysore NH - 275 from Km 342.387 to 342.787 on LHS & one no. crossing at Km 342.387 through HDD method by M/s. BWS&S Board.

1. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and is generally found in order.

2. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

The Chief Engineer-Regional Officer

Ministry of Road Transport & Highways

Office of the Chief Engineer-Regional Officer

No. 32, 2nd Floor, KSCFL Building,

D. Devaraj Urs Road, (Race Course Road), BENGALURU-560 001

Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

(S.Sadananda Babu)

Superintending Engineer

For Chief Engineer - Regional Officer

Enclosed: As above.

Copy to : (i) Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.

(ii) The Executive Engineer, STP /V.V Division, B.W.S.S.B, Mysore Road, Nayandahalli, Bengaluru - 560039 for information.

(S.Sadananda Babu)

Superintending Engineer

For Chief Engineer - Regional Officer

FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject : Permission for laying of HT Under Ground Cable along Bangalore - Mysore NH - 275 from Km 342.387 to 342.787 on LHS & one no. crossing at Km 342.387 through HDD method by M/s. BWS&S Board - Regd.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	xiii) Application No.	
	xiv) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	xv) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

ಕಾರ್ಯನಿರ್ವಾಹಕ ಅಭಿಯಂತರರು
ಕಛೇರಿ ರಾಷ್ಟ್ರೀಯ ಹೆದ್ದಾರಿ ವಿಭಾಗ,
ಬೆಂಗಳೂರು.
e-mail- executive_engi@yahoo.com



ಕರ್ನಾಟಕ ಸರ್ಕಾರ

Office of the Executive Engineer
National Highways Division,,
No.13/4 , 4th Floor CFC
Building Nrupathunga Road
Bangalore -560001
Ph No -080-22211207

No.EE/ NHDB/AE-1/BWSSB/2020-21/

297-99

Date-06/06/2020

To,

The Chief Engineer (RO),
MoRT&H, K.R.Circle,
Bengaluru.

O/o. THE CE-RO
MORT&H, BENGALURU

Diary No.: 240

Date: 10/06/2020

Sir,

Sub: - Construction of 20MLD Sewage Treatment Plant at Doddabele-
Requesting to accord approval for laying of HT UG cable along
Bangalore-Mysore NH-275 from Km 342.387 to 342.787 on RHS of
the increasing chainage in the State of Karnataka-Reg.

- Ref: 1. This office letter no.3100-102 dated:29.01.2020
2.Chief Engineer-Regional Officer, MoRTH, Bengaluru letter
no.RW/BNG/PER.CASES/BNG-DVN/2015/76 dated:18.05.2020
3. This office letter no. dated:04.06.2020
4.Assistant Executive Engineer, National Highway sub-division,
Bengaluru letter no.38 dated: 04.06.2020

With reference to above subject, proposal for laying HT UG cable to 20MLD
sewage Treatment Plant along Bangalore-Mysore NH-275 from Km 342.387 to 342.787 on
RHS in the State of Karnataka for total length of 400 m was proposed by the BWSSB and
same was submitted to your kind self-vide letter under ref (1).

Further, some clarifications were sought vide letter cited under ref (2) pertaining
to proposal. Assistant Executive Engineer, National Highway sub-division, Bengaluru
has re submitted the drawings showing the details of carriage way, Row and UG cable
distance from the centre line and cross-sectional details for every 50M interval.

The same is submitted, with a request to consider the above compliance and
accord the permission as the issue involves larger public interest.

Encl: As above

Yours faithfully,




Executive Engineer,
N.H.Division, Bengaluru

Plan and drawing
8/6/2020


SE

on 8/6/20
20

on 8/6/20
19/6/2020
LDC
BSR

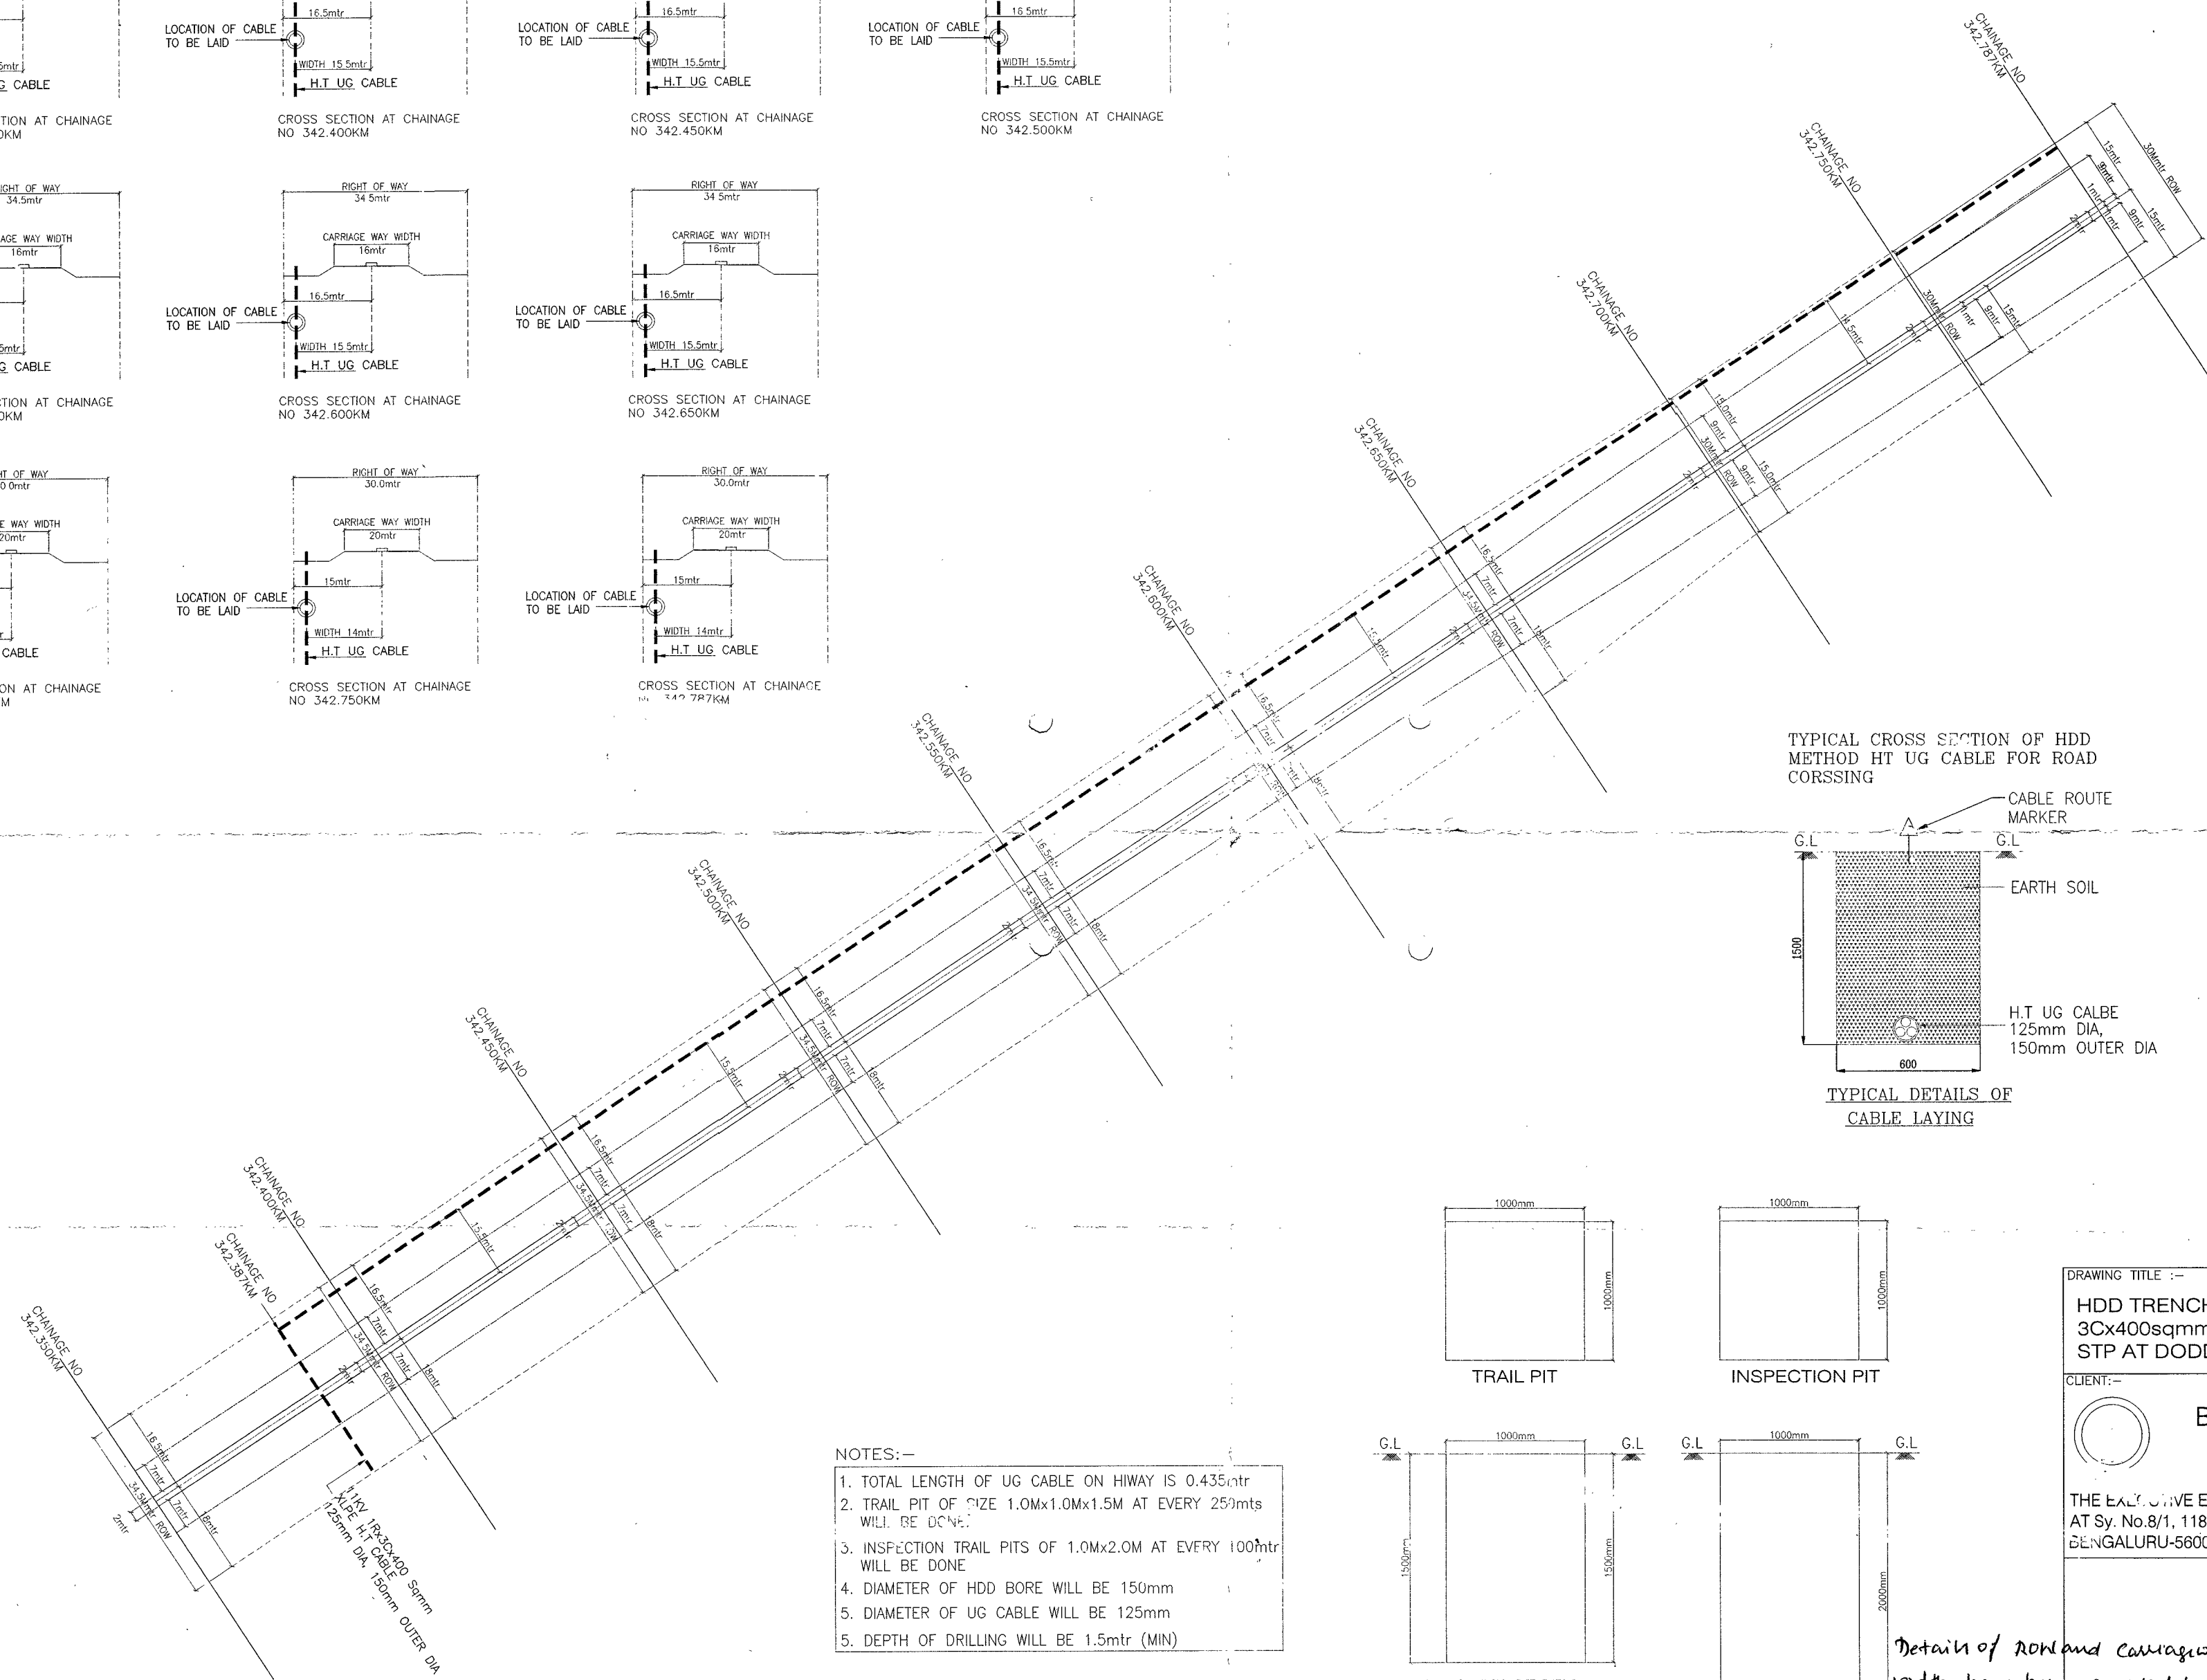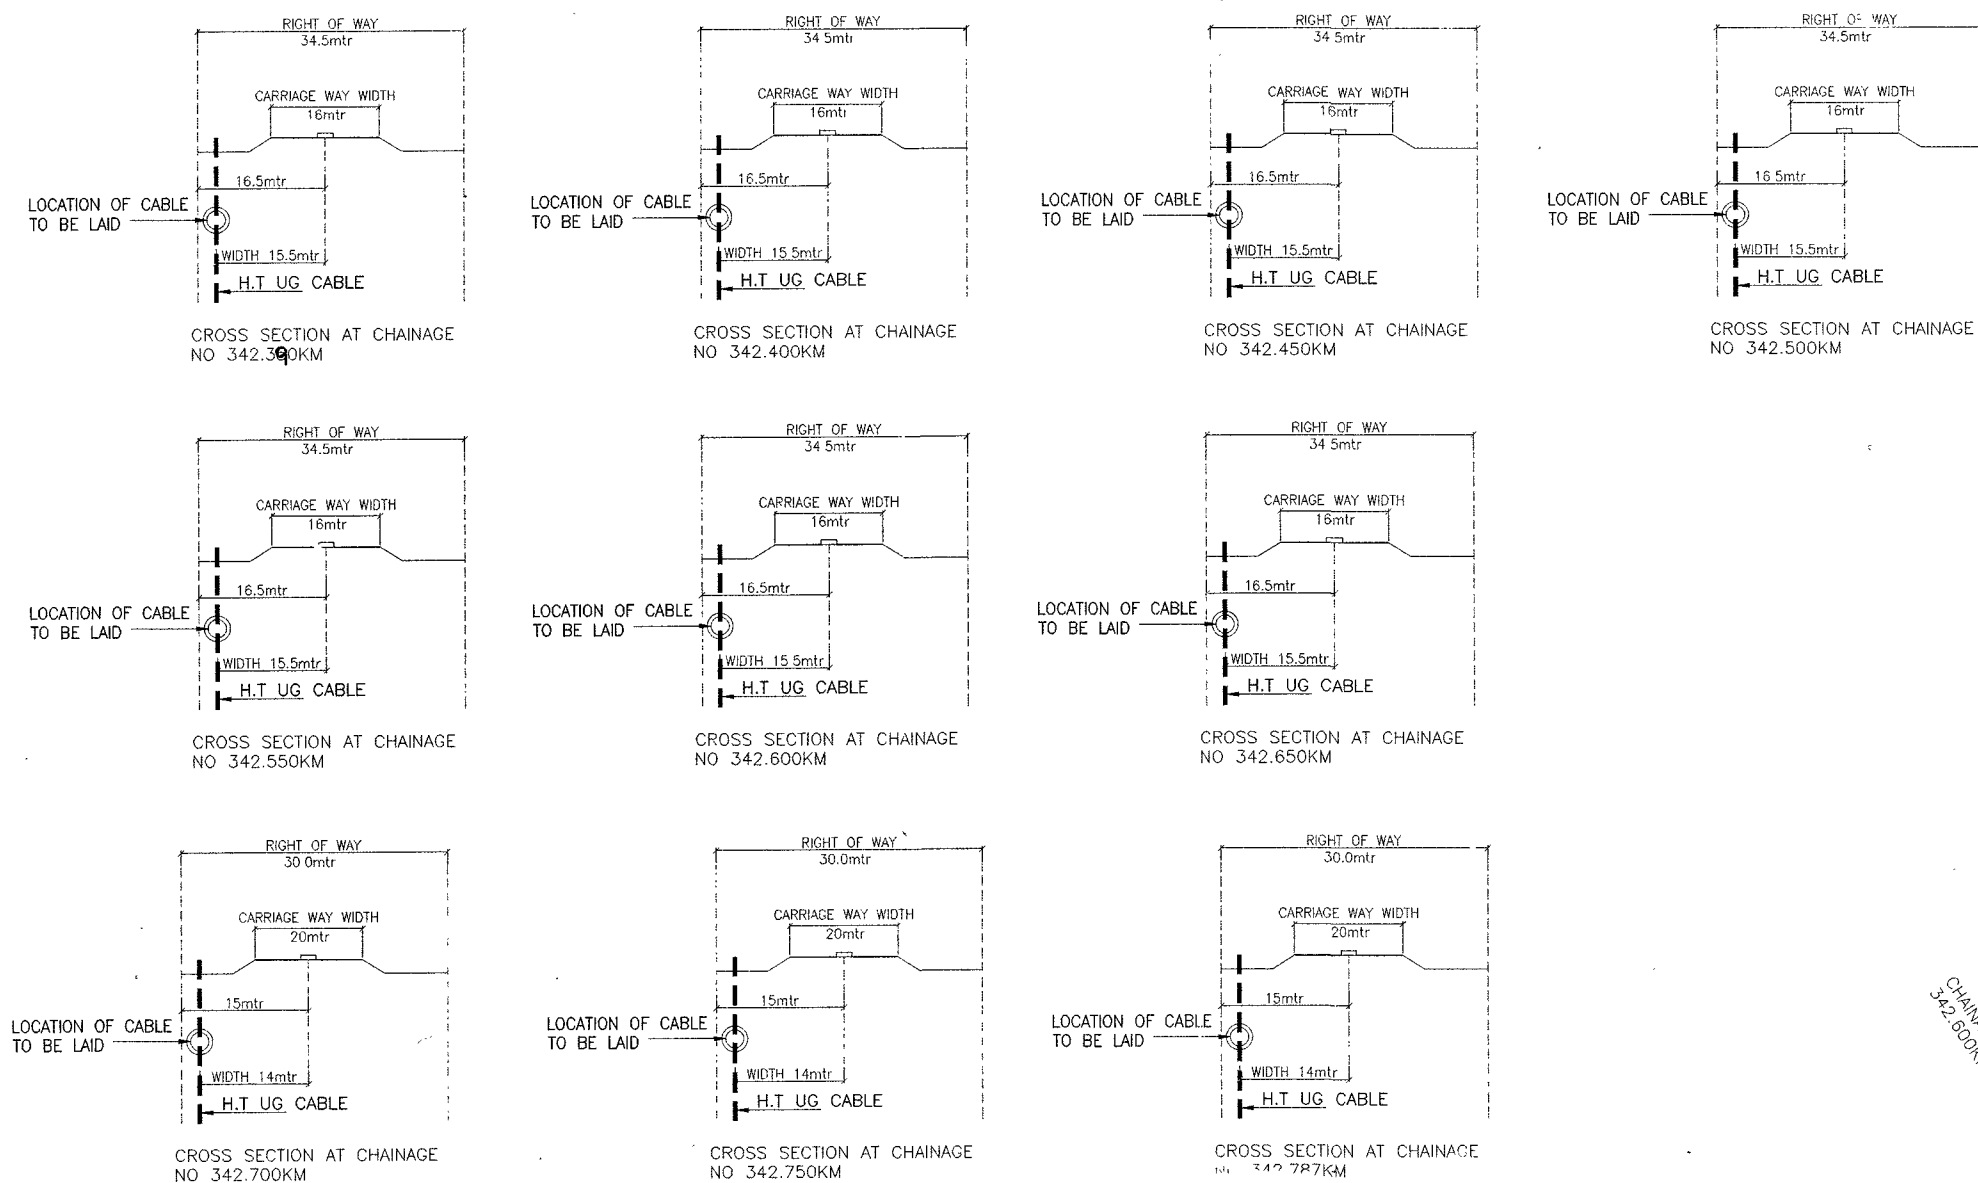


TYPICAL CROSS SECTION OF HDD METHOD HT UG CABLE FOR ROAD CROSSING

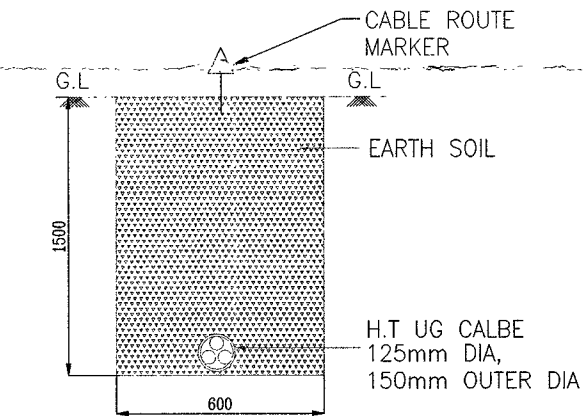


TYPICAL DETAILS OF CABLE LAYING


TYPICAL CROSS SECTION OF HDD METHOD HT UG CABLE FOR ALONG WITH NH

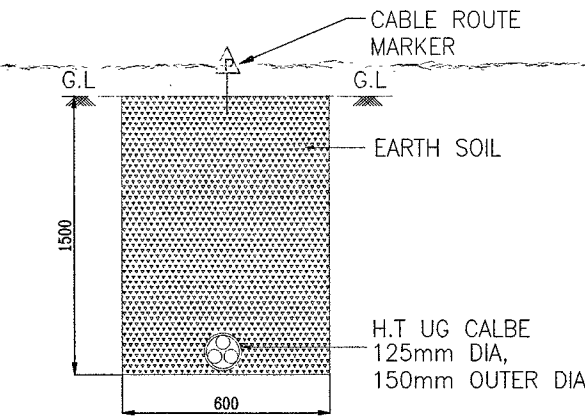


TYPICAL DETAILS OF CABLE LAYING




TRAIL PIT



INSPECTION PIT

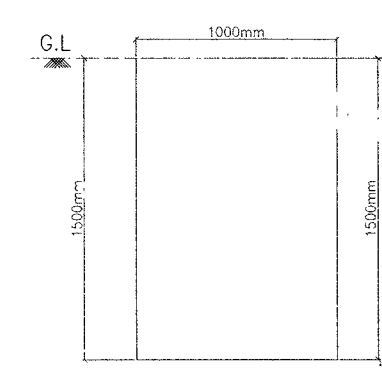

TRAIL PIT SECTION

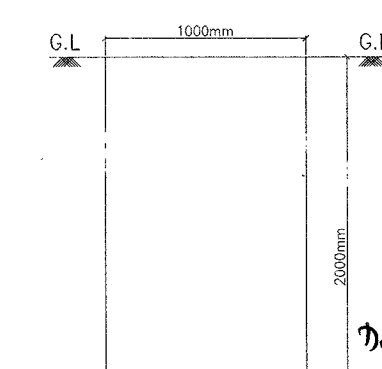

INSPECTION PIT SECTION

- NOTES:-
1. TOTAL LENGTH OF UG CABLE ON HIWAY IS 0.435mtr
 2. TRAIL PIT OF SIZE 1.0Mx1.0Mx1.5M AT EVERY 250mts WILL BE DONE
 3. INSPECTION TRAIL PITS OF 1.0Mx2.0M AT EVERY 100mtr WILL BE DONE
 4. DIAMETER OF HDD BORE WILL BE 150mm
 5. DIAMETER OF UG CABLE WILL BE 125mm
 6. DEPTH OF DRILLING WILL BE 1.5mtr (MIN)

DRAWING TITLE :-
HDD TRENCHLESS METHOD FOR HT 3Cx400sqmm CABLE WORKS FOR 20MLD STP AT DODDABELE

CLIENT:-
BANGALORE WATER SUPPLY AND SEWERAGE BOARD

THE EXECUTIVE ENGINEER, ELE. DIV., BWSSB, EXISTING 20 MLD STP AT Sy. No.8/1, 118, 119/1 AND 119/2 DODDABELE VILLAGE, KENGERI, BANGALURU-560060.

Executive Engineer
BANGALORE WATER SUPPLY AND SEWERAGE BOARD
Mysore Road, Nayandahalli, Bangalore - 560060

Executive Engineer
N.H. Division, Bangalore

Assistant Executive Engineer
(STP-V.V) 2 Sub Division, B.W.S.S.B.
Mysore Road, Nayandahalli, Bangalore - 560060

Detail of Road and Carriageway width have been provided by NH authority.