



RW/BNG/PER.CASES/CTD.DVN/2015

Government of India

Ministry of Road Transport & Highways

(Office of the Chief Engineer-Regional Officer, MoRTH, Bengaluru)

PWD Annexe Building, KR Circle, Bangalore-560 001

Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765 (F)

Dated: 14.08.2019

Notice Inviting Public Comments on laying of 110 KV electrical cable and OFC cable along NH 206 from Km 210.943 to 212.720 (RHS) at the extreme edge of the National Highway ROW, for a total length of 1777 mts. including 3 crossings at cross roads, by Karnataka Power Transmission Corporation Ltd., through manual / HDD method.

Reference: The Executive Engineer, NH Division, Chitradurga letter No. EE/NHD/CTA/AE-4/Electrical Cable & OFC/2019-20/433 dated 03.07.2019.

The Executive Engineer, NH Division, Chitradurga vide letter cited under reference above, has submitted a proposal seeking permission for laying of 110 KV electrical cable and OFC cable along NH 206 from Km 210.943 to 212.720 (RHS) at the extreme edge of National Highway ROW, for a total length of 1777 mts. including 3 crossings at cross roads, by Karnataka Power Transmission Corporation Ltd., by open trenching method and by HDD method at cross roads. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and is generally found in order.

2. As per above said Ministry's guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

Chief Engineer-Regional Officer

Ministry of Road Transport & Highways

PWD Annexe Building, GF, KR Circle, Bangalore-560 001


Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765 (F)

Enclosed: As above.

Copy to : (i) Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.

(ii) The Executive Engineer, NH Division, Chitradurga for information.

(iii) The Executive Engineer, Major Works Division, K.P.T.C. L, Shimoga for information.


(S. Sadananda Babu)

Superintending Engineer

For Chief Engineer - Regional Officer


(S. Sadananda Babu)

Superintending Engineer

For Chief Engineer - Regional Officer

FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.


Subject: Permission for laying of 110 KV electrical cable and OFC cable along NH 206 from Km 210.943 to 212.720 (RHS) at the extreme edge of the National Highway ROW, for a total length of 1777 mts. including 3 crossings at cross roads, by Karnataka Power Transmission Corporation Ltd., through manual / HDD method.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	m) Application No.	
	n) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	o) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

PROPOSED 110kV KPTCL CABLE ROUTE.

ROUTE: 212.720km to 212.600km of NH-206, Shivamogga - Sagara road.

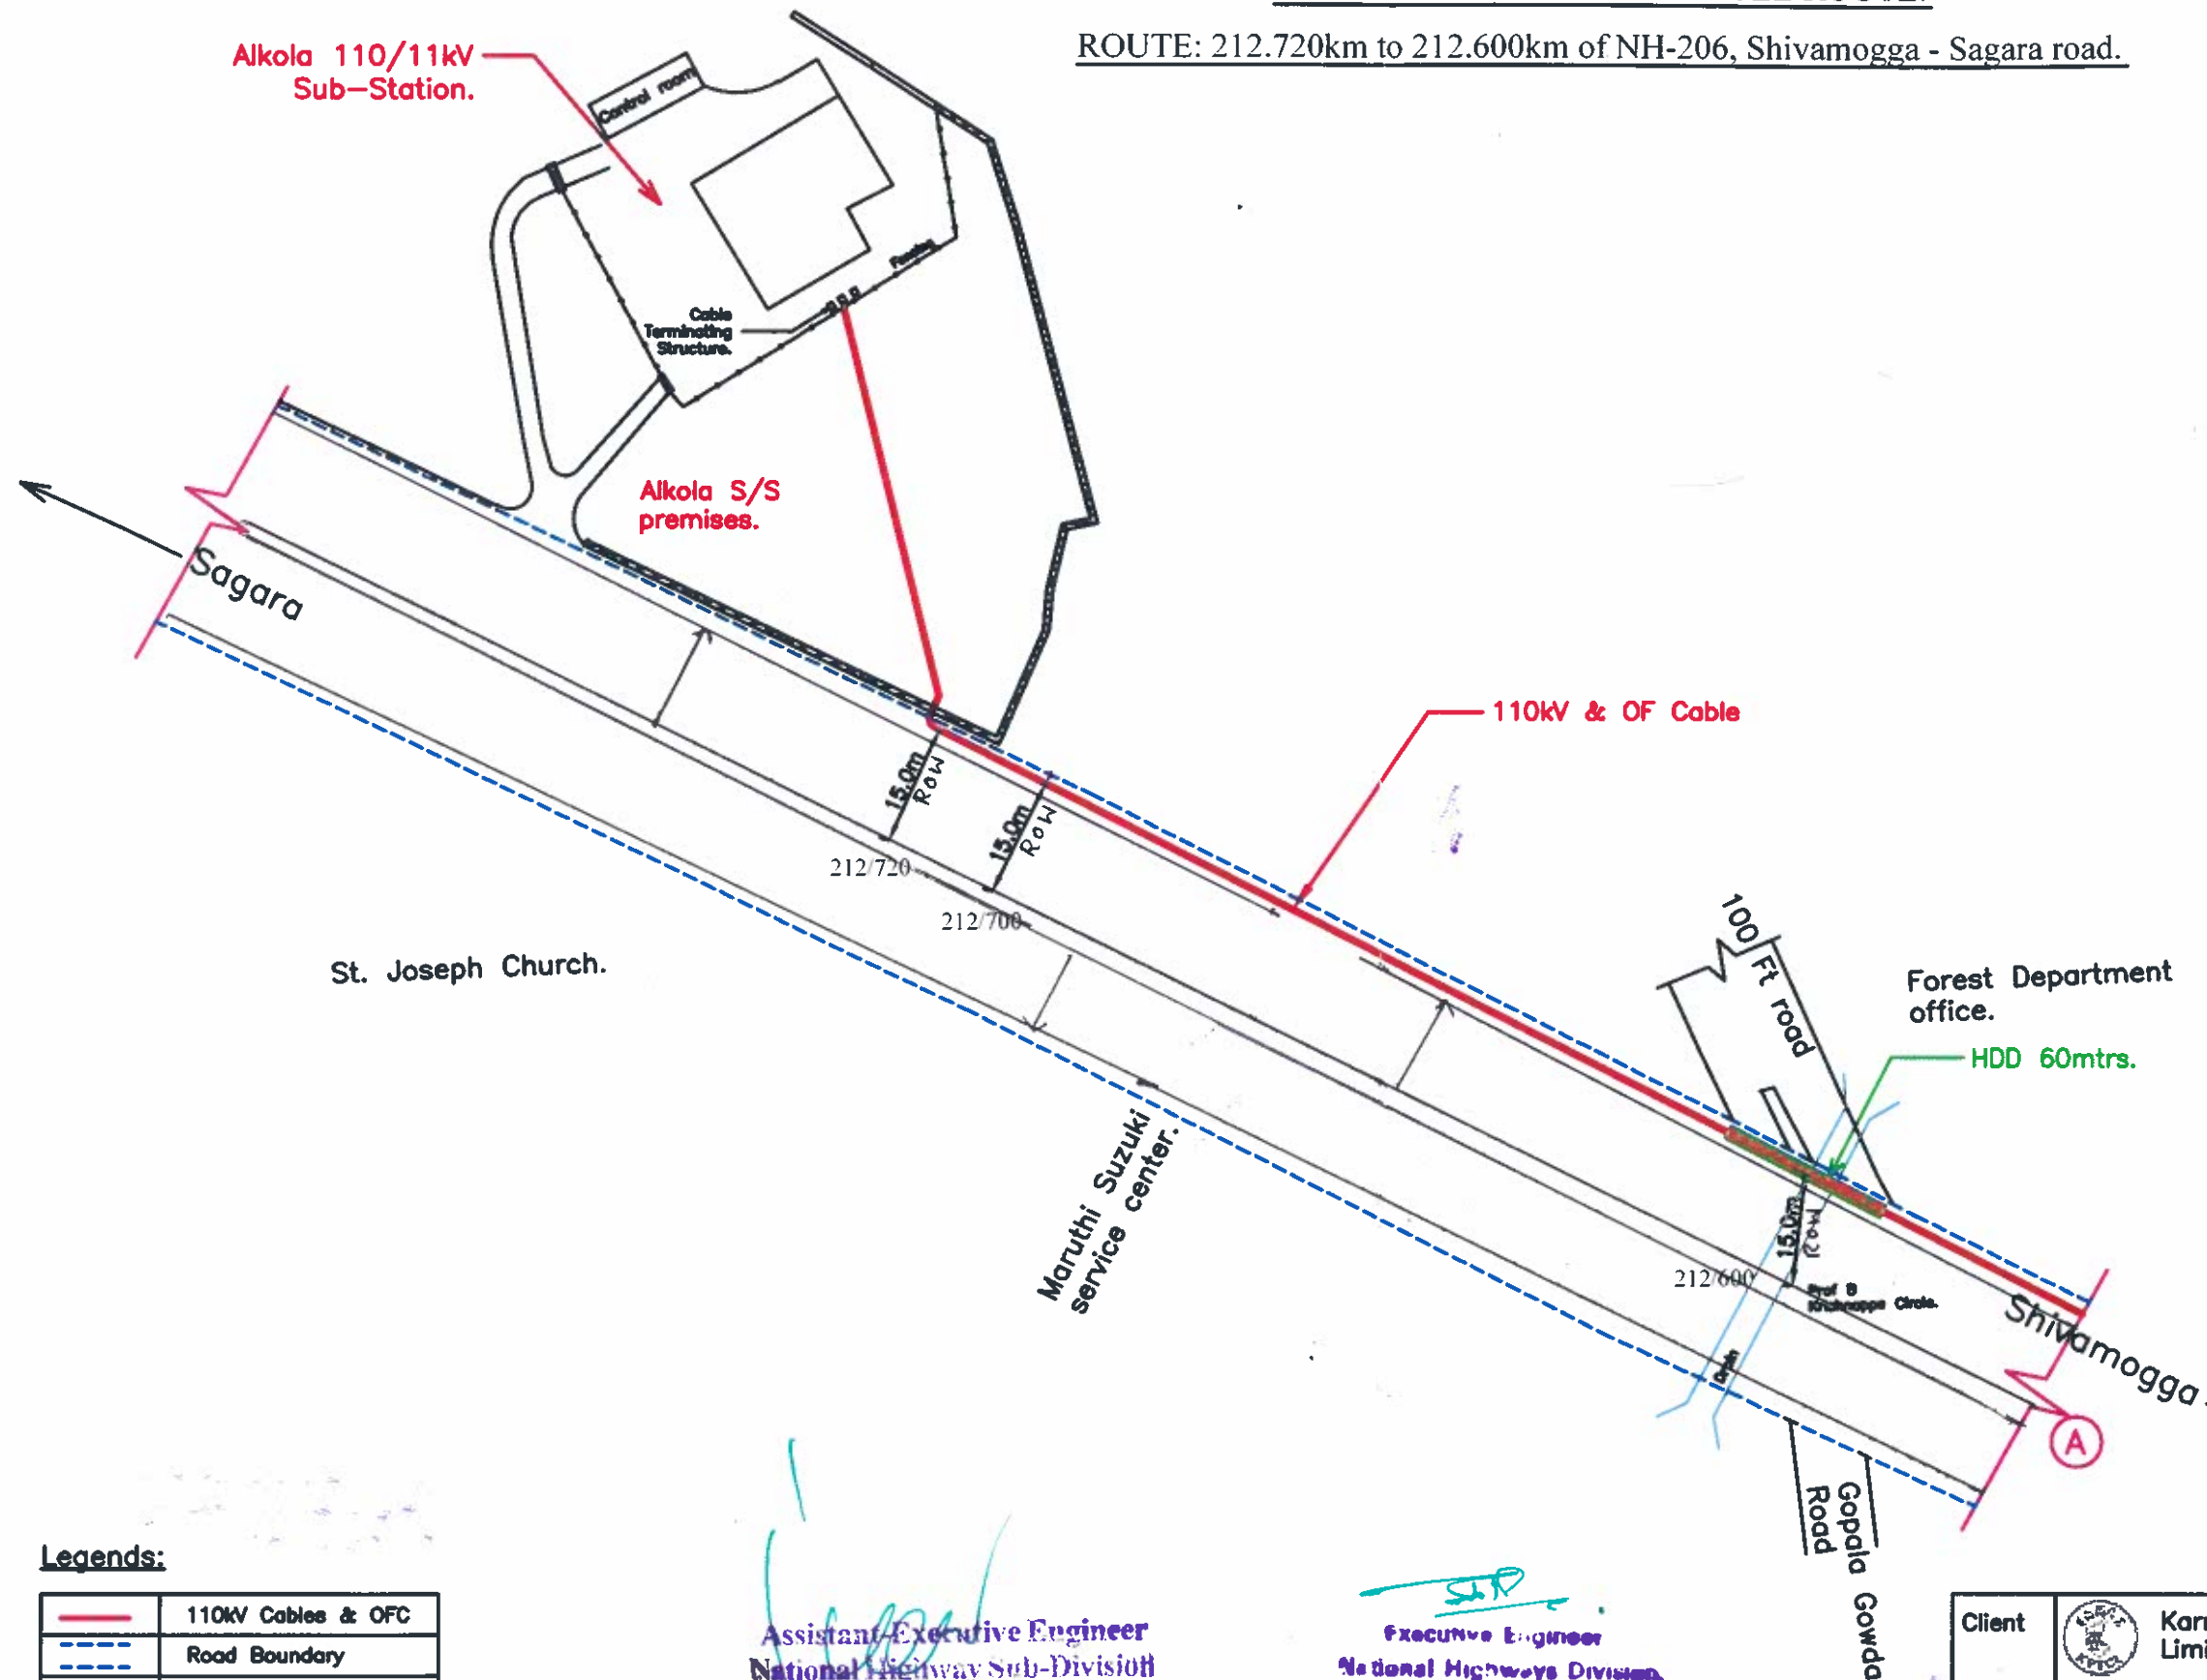


Legends:

—	110kV Cables & OFC
---	Road Boundary
---	Center line of road
—	HDD Crossings
—	Drain / culvert cross




Assistant-Executive Engineer
National Highway Sub-Division
SHIMOGA-577 205

Executive Engineer
National Highways Division
CHITHALURGA.

Client	 Karnataka Power Transmission Corporation Limited, Shivamogga.
Project	Running of 110kV, 1Cx240 Sq.mm, Copper conductor, XLPE Insulated, Lead sheathed (Single circuit with spare cable - 4runs) UG cable for a route length 2.123kms from existing 110/11kV Alkola Sub-Station to proposed 110/11kV Sub-Station in the premises of McGann Hospital in Shivamogga city, Shivamogga Taluk.
Dwg. No.	UCL/KPTCL/EHV-301/1-A, Rev. 0 Not to Scale Date: 06.06.16

Executive Engineer (Elect)
Major Works Divn
R.P.T.C. L. SHIVAMOGGA

PROPOSED 110kV KPTCL CABLE ROUTE.
 ROUTE: 212.600km to 212.000km of NH-206, Shivamogga - Sagara road.

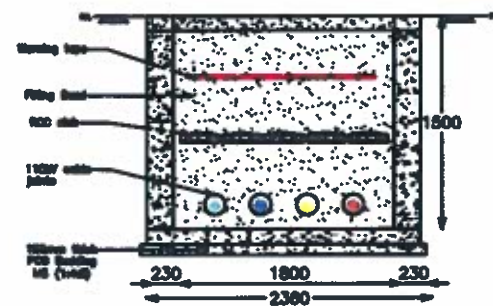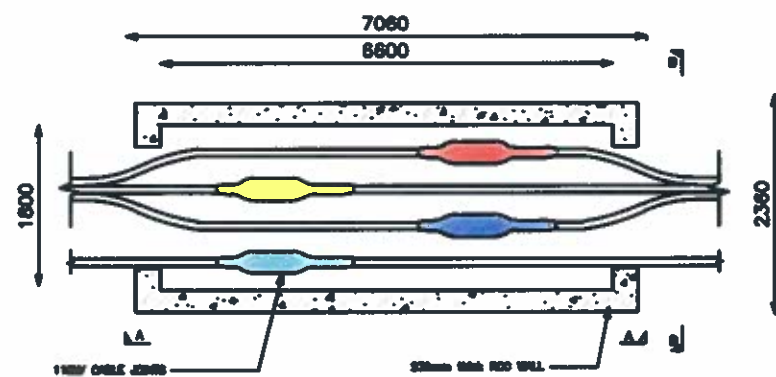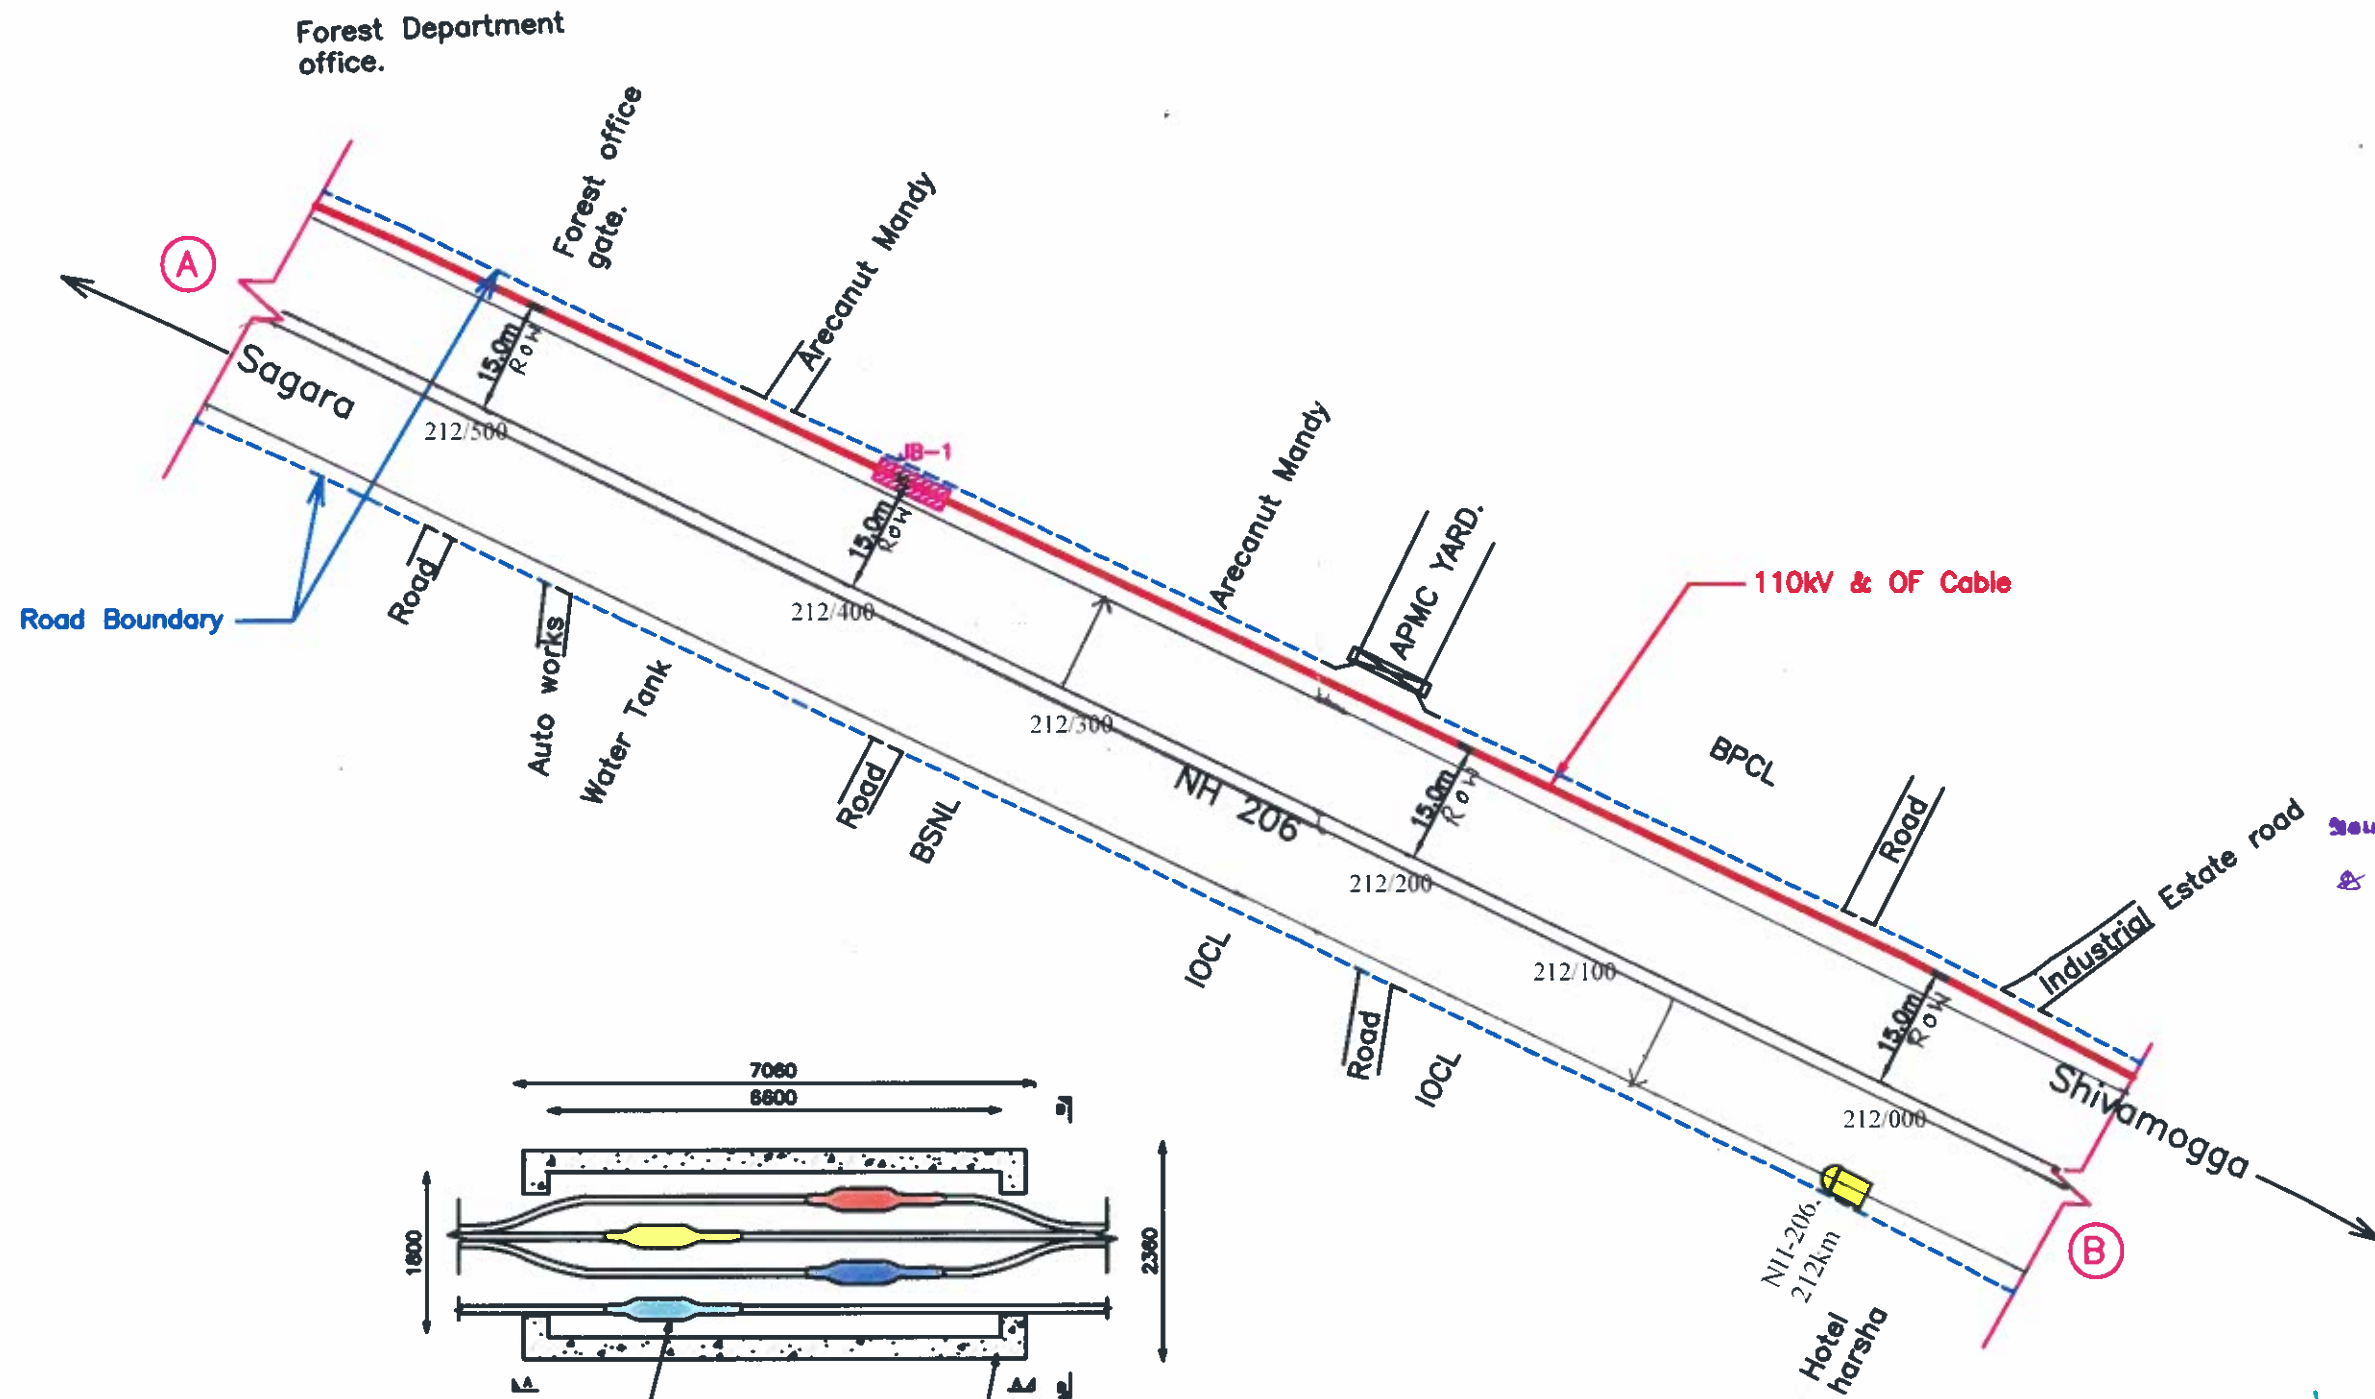

Legends:

—	110kV Cables & OFC
---	Road Boundary
—	Center line of road
—	HDD Crossings
—	Drain / culvert cross




(Signature)
 Assistant-Executive Engineer
 National Highway Sub-Division
 SHIVAMOGGA-377 205

(Signature)
 Executive Engineer (Elect)
 Major W. Division
 K.P.T.C. L. SHIVAMOGGA

Client	Karnataka Power Transmission Corporation Limited, Shivamogga.
Project	Running of 110kV, 1Cx240 Sq.mm, Copper conductor, XLPE insulated, Lead sheathed (Single circuit with spare cable - 4runs) UG cable for a route length 2.123kms from existing 110/11kV Alkale Sub-Station to proposed 110/11kV Sub-Station in the premises of McGann Hospital in Shivamogga city, Shivamogga Taluk.
Drg. No.	UCL/KPTCL/EHV-301/1-B, Rev. 0 Not to Scale Date: 08.08.18

PROPOSED 110kV KPTCL CABLE ROUTE.

ROUTE: 212.000km to 211.500km of NH-206, Shivamogga - Sagara road.

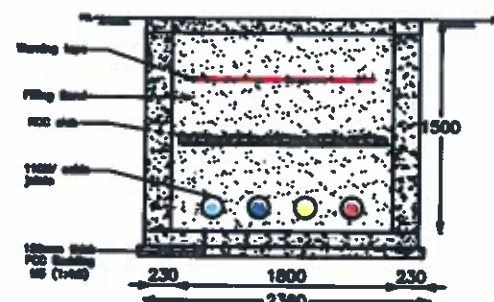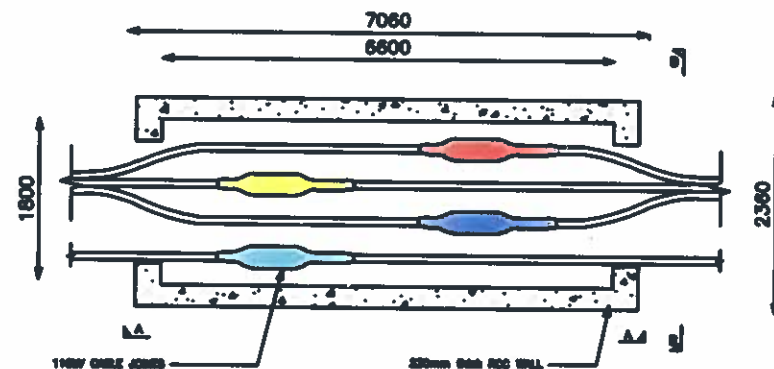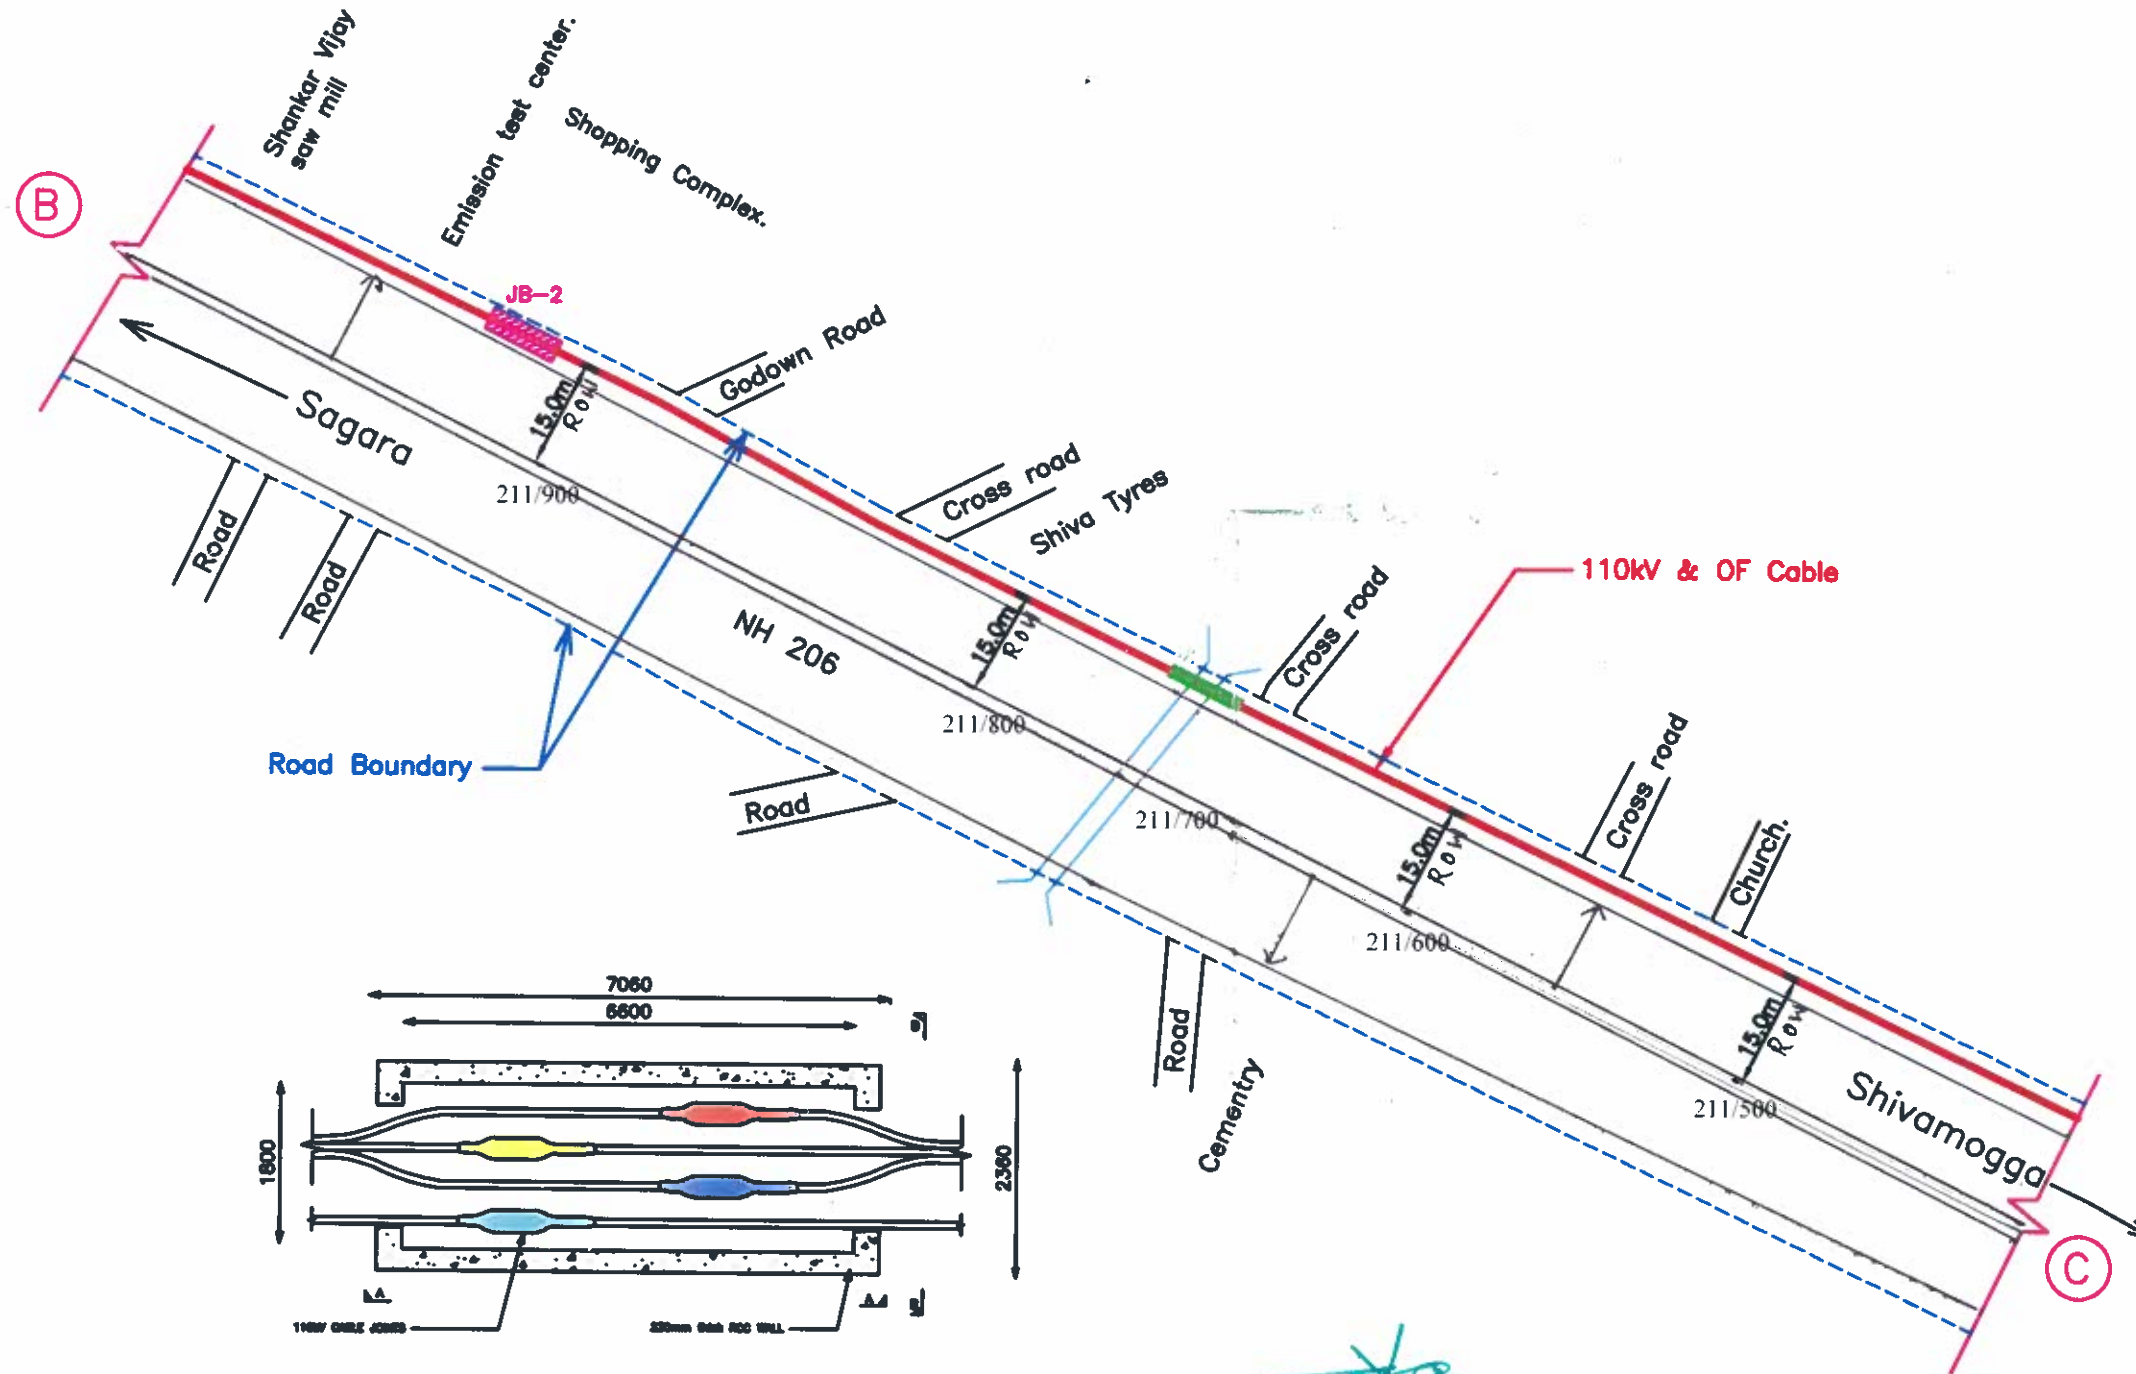

Legends:

—	110kV Cables & OFC
---	Road Boundary
—	Center line of road
—	HDD Crossings
—	Drain / culvert cross

Assistant-Executive Engineer
National Highway Sub-Division
SHIMOGGA-577 205


Executive Engineer,
National Highways Division,
CHITRADURGA.

L. K. S. / 18/12/18
Executive Engineer (Elec)
Major V. Division
K.P.T.C. L. SHIVAMOGGA


Client	Karnataka Power Transmission Corporation Limited, Shivamogga.
Project	Running of 110kV, 1Cx240 Sq.mm, Copper conductor, XLPE insulated, Lead sheathed (Single circuit with spare cable - 4runs) UG cable for a route length 2.123kms from existing 110/11kV Alkola Sub-Station to proposed 110/11kV Sub-Station in the premises of McGann Hospital in Shivamogga city, Shivamogga Taluk.
Drg. No.	UCL/KPTCL/EHV-301/1-C, Rev. 0 Not to Scale Date: 08.08.18

PROPOSED 110kV KPTCL CABLE ROUTE.

ROUTE: 211.500km to 210.943km of NH-206, Shivamogga - Sagara road.

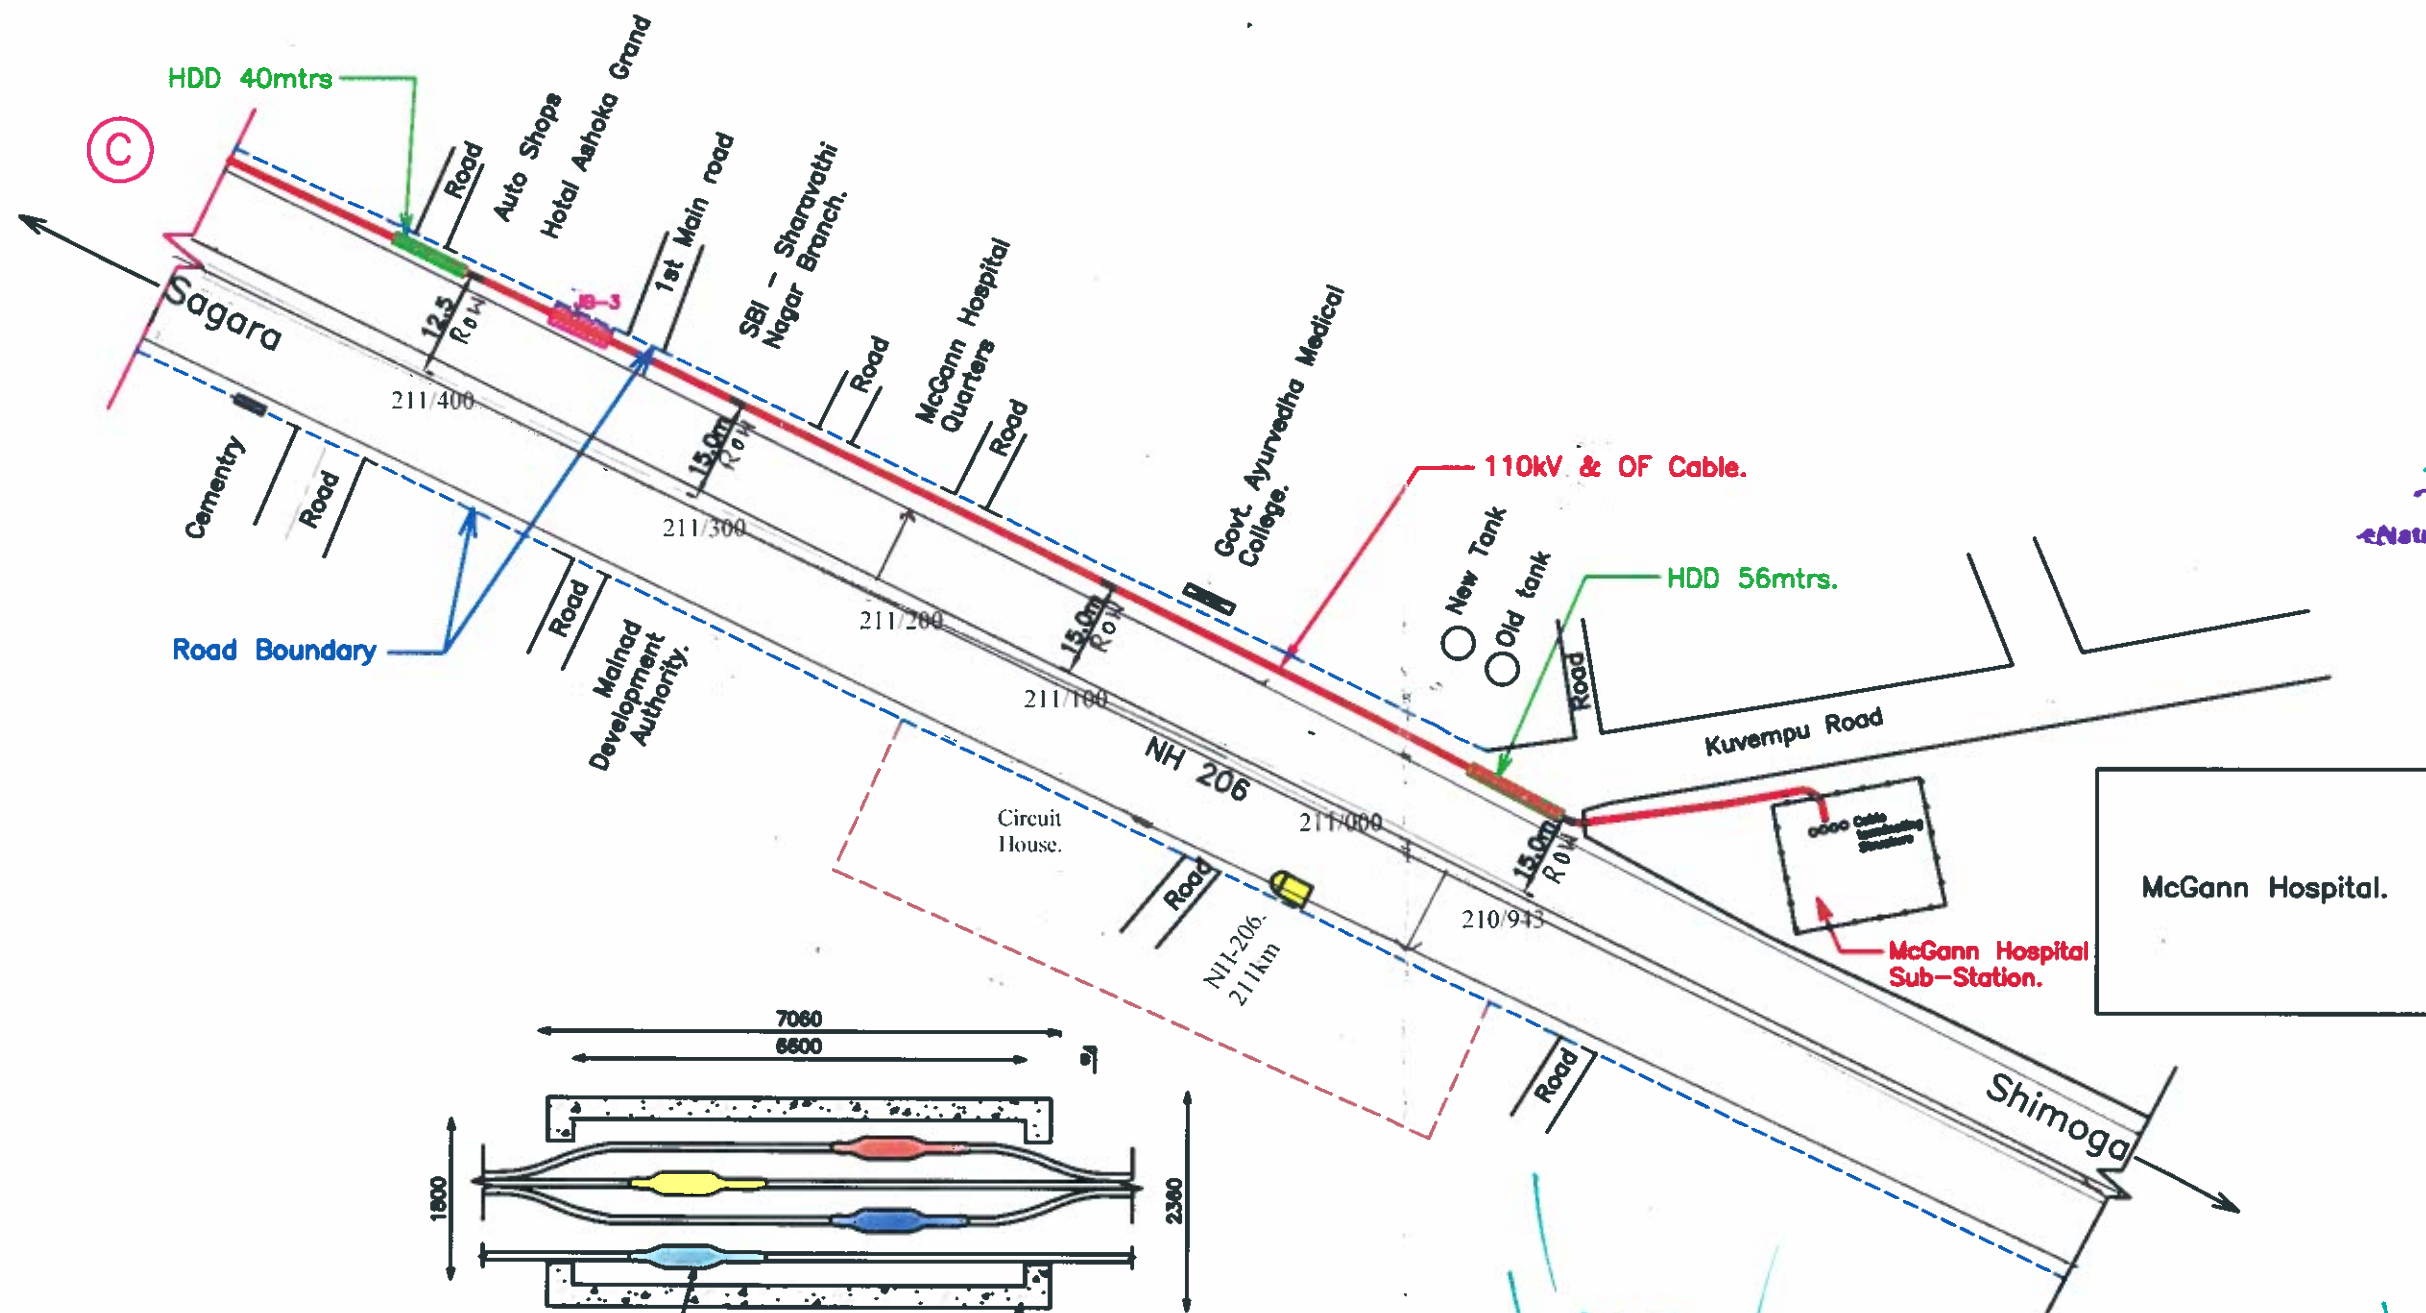


S.R.P.
Executive Engineer,
National Highways Division,
CHITRADURGA.

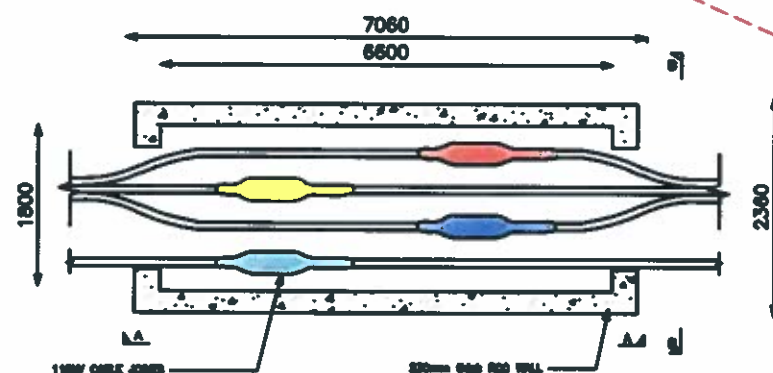

Legends:

—	110KV Cables & OFC
---	Road Boundary
---	Center line of road
—	HDD Crossings
---	Drain / culvert cross

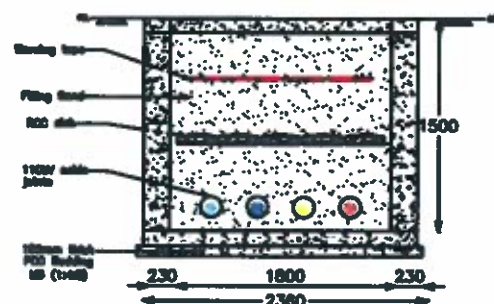

S.R.P.
Assistant Executive Engineer
National Highway Sub-Division
SHIMOGA-577 205

L. K. Kulkarni
Executive Engineer (Elect)
Major Works Division
K.P.T.C. L. SHIVAMOGGA

Client	Karnataka Power Transmission Corporation Limited, Shivamogga.
Project	Running of 110KV, 1Cx240 Sq.mm, Copper conductor, XLPE insulated, Lead sheathed (Single circuit with spare cable - 4 runs) UG cable for a route length 2.123kms from existing 110/11KV Alkole Sub-Station to proposed 110/11KV Sub-Station in the premises of McGann Hospital in Shivamogga city, Shivamogga Taluk.
Org. No.	UCL/KPTCL/EHV-301/1-D, Rev. 0
Not to Scale	Date: 06.08.18